

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726916

Luminaire Tested: **MRI-DRV-FLD4C-20-L927 F4LC-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726916
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-20-L927 F4LC-W-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI
LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1897.0 lumens
Efficiency: N/A
Efficacy: 87.0 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726916
CATALOG NUMBER: MRI-DRV-FLD4C-20-L927 F4LC-W-X-LI

Luminous Intensity Polar Plot

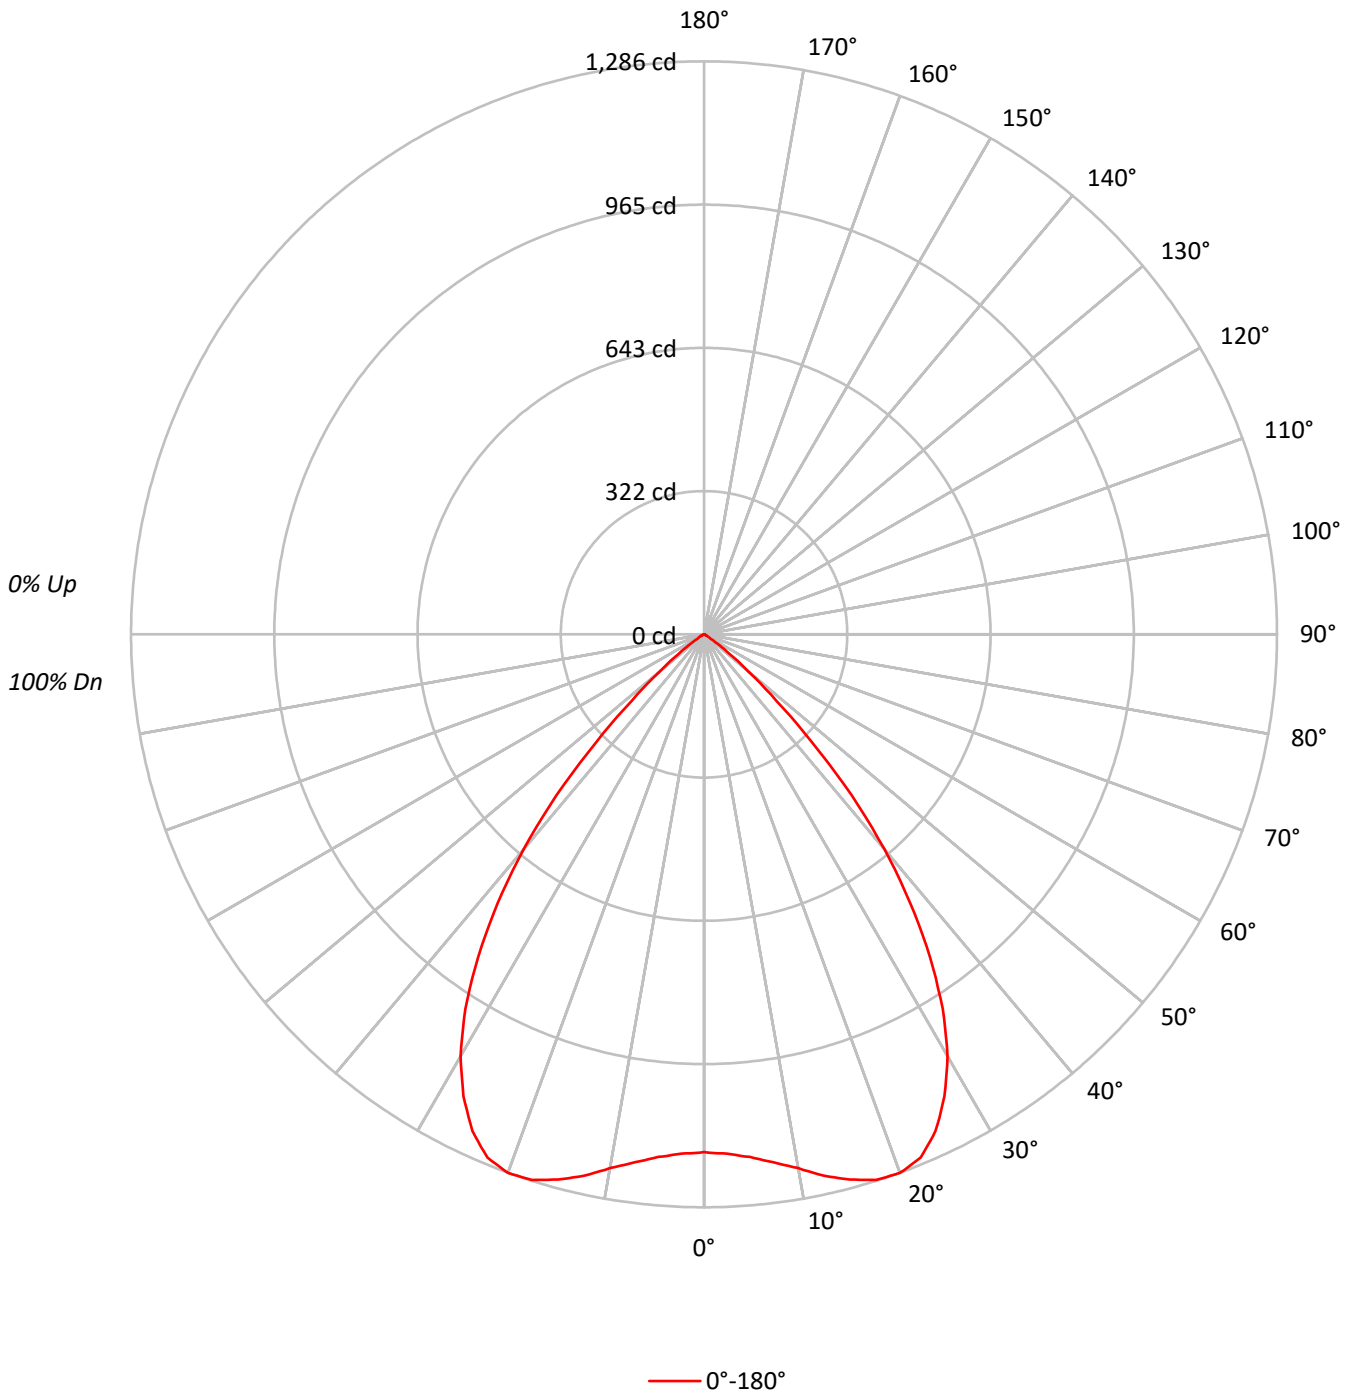



TEST NUMBER: P726916
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L927 F4LC-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92	92	92	92
2	106	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84	84	84	84
3	100	93	87	83	98	92	86	82	89	85	81	86	83	80	84	81	78	77	77	77	77
4	94	86	79	75	92	84	79	74	82	77	73	80	76	72	78	75	72	70	70	70	70
5	88	79	72	68	87	78	72	67	76	71	67	74	70	66	73	69	65	64	64	64	64
6	83	73	66	62	82	72	66	61	71	65	61	69	64	60	68	63	60	58	58	58	58
7	78	68	61	56	77	67	61	56	66	60	56	64	59	55	63	59	55	54	54	54	54
8	74	63	56	52	72	62	56	51	61	55	51	60	55	51	59	54	51	49	49	49	49
9	69	59	52	48	68	58	52	47	57	51	47	56	51	47	55	50	47	45	45	45	45
10	66	55	48	44	65	54	48	44	53	48	44	53	47	44	52	47	43	42	42	42	42

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	142793
5°	145213
10°	151782
15°	161095
20°	168155
25°	166691
30°	155023
35°	132609
40°	101036
45°	59263
50°	25324
55°	7454
60°	2138
65°	1279
70°	790
75°	1044
80°	0
85°	0



TEST NUMBER: P726916
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L927 F4LC-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	113.7	6.0
10°-20°	358.7	18.9
20°-30°	559.6	29.5
30°-40°	544.5	28.7
40°-50°	271.9	14.3
50°-60°	42.1	2.2
60°-70°	5.1	0.3
70°-80°	1.4	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1032.0	54.4
0°-40°	1576.4	83.1
0°-60°	1890.5	99.7
0°-90°	1897.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1897.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1162	
5°	1178	114
15°	1267	359
25°	1230	560
35°	884	544
45°	341	272
55°	35	42
65°	4	5
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P726916
CATALOG NUMBER: MRI-DRV-FLD4C-20-L927 F4LC-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1162.3
2.5°	1166.6
5°	1177.5
7.5°	1194.9
10°	1216.7
12.5°	1244.8
15°	1266.6
17.5°	1284.0
20°	1286.2
22.5°	1270.9
25°	1229.7
27.5°	1168.8
30°	1092.8
32.5°	997.3
35°	884.2
37.5°	760.4
40°	630.0
42.5°	491.0
45°	341.1
47.5°	219.4
50°	132.5
52.5°	71.7
55°	34.8
57.5°	15.2
60°	8.7
62.5°	6.5
65°	4.4
67.5°	4.4
70°	2.2
72.5°	2.2
75°	2.2
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)