

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726970

Luminaire Tested: **MRI-DRV-FLD4C-20-L935 F4LC-N-X-H**

Issue Date: 08/03/2023



**Test Information**


Test Method: LM-79-08  
Report Number: P726970  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207666)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 08/03/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: MRI-DRV-FLD4C-20-L935 F4LC-N-X-H  
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI  
LEDS, 4LBNH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1262.0 lumens  
Efficiency: N/A  
Efficacy: 57.9 lumens/watt  
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 21.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P726970  
CATALOG NUMBER: MRI-DRV-FLD4C-20-L935 F4LC-N-X-H

### Luminous Intensity Polar Plot

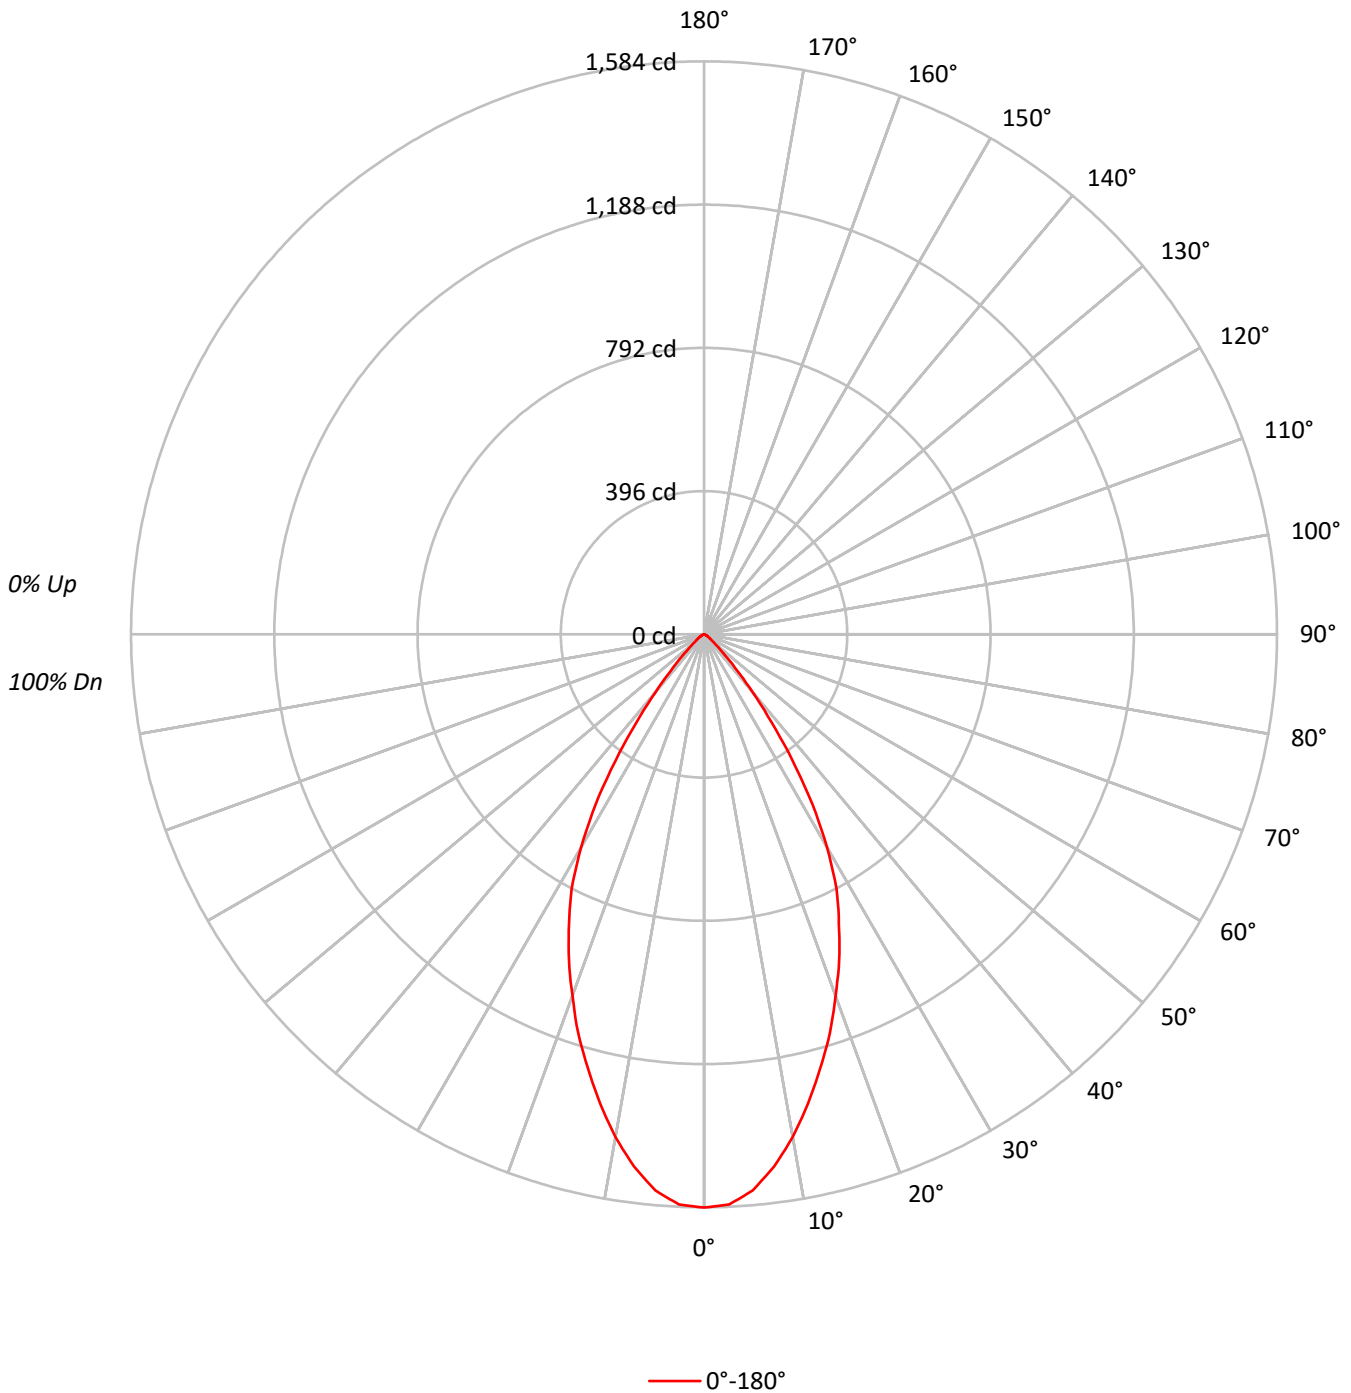



TEST NUMBER: P726970  
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L935 F4LC-N-X-H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	93
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58
9	76	66	60	56	74	65	60	56	65	59	56	64	59	56	63	59	55	54
10	72	62	57	53	71	62	56	53	61	56	53	60	56	52	60	55	52	51

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	194661
5°	190324
10°	175983
15°	157903
20°	139001
25°	119626
30°	96336
35°	64130
40°	33358
45°	15098
50°	6556
55°	4391
60°	2826
65°	2006
70°	1652
75°	1092
80°	0
85°	0



TEST NUMBER: P726970  
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L935 F4LC-N-X-H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	143.0	11.3
10°-20°	346.8	27.5
20°-30°	402.6	31.9
30°-40°	266.6	21.1
40°-50°	74.8	5.9
50°-60°	18.8	1.5
60°-70°	7.1	0.6
70°-80°	2.4	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	892.3	70.7
0°-40°	1159.0	91.8
0°-60°	1252.5	99.2
0°-90°	1262.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1262.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1584	
5°	1543	143
15°	1242	347
25°	882	403
35°	428	267
45°	87	75
55°	20	19
65°	7	7
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P726970  
CATALOG NUMBER: MRI-DRV-FLD4C-20-L935 F4LC-N-X-H

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1584.5
2.5°	1577.6
5°	1543.3
7.5°	1483.8
10°	1410.7
12.5°	1328.3
15°	1241.5
17.5°	1156.9
20°	1063.2
22.5°	976.3
25°	882.5
27.5°	793.4
30°	679.1
32.5°	557.9
35°	427.6
37.5°	306.4
40°	208.0
42.5°	134.9
45°	86.9
47.5°	52.6
50°	34.3
52.5°	25.1
55°	20.5
57.5°	16.0
60°	11.5
62.5°	9.2
65°	6.9
67.5°	4.6
70°	4.6
72.5°	2.3
75°	2.3
77.5°	2.3
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)