

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727000

Luminaire Tested: **MRI-DRV-FLD4C-20-L940 F4LC-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727000
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-20-L940 F4LC-M-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1898.0 lumens
Efficiency: N/A
Efficacy: 87.1 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727000
CATALOG NUMBER: MRI-DRV-FLD4C-20-L940 F4LC-M-X-LI

Luminous Intensity Polar Plot

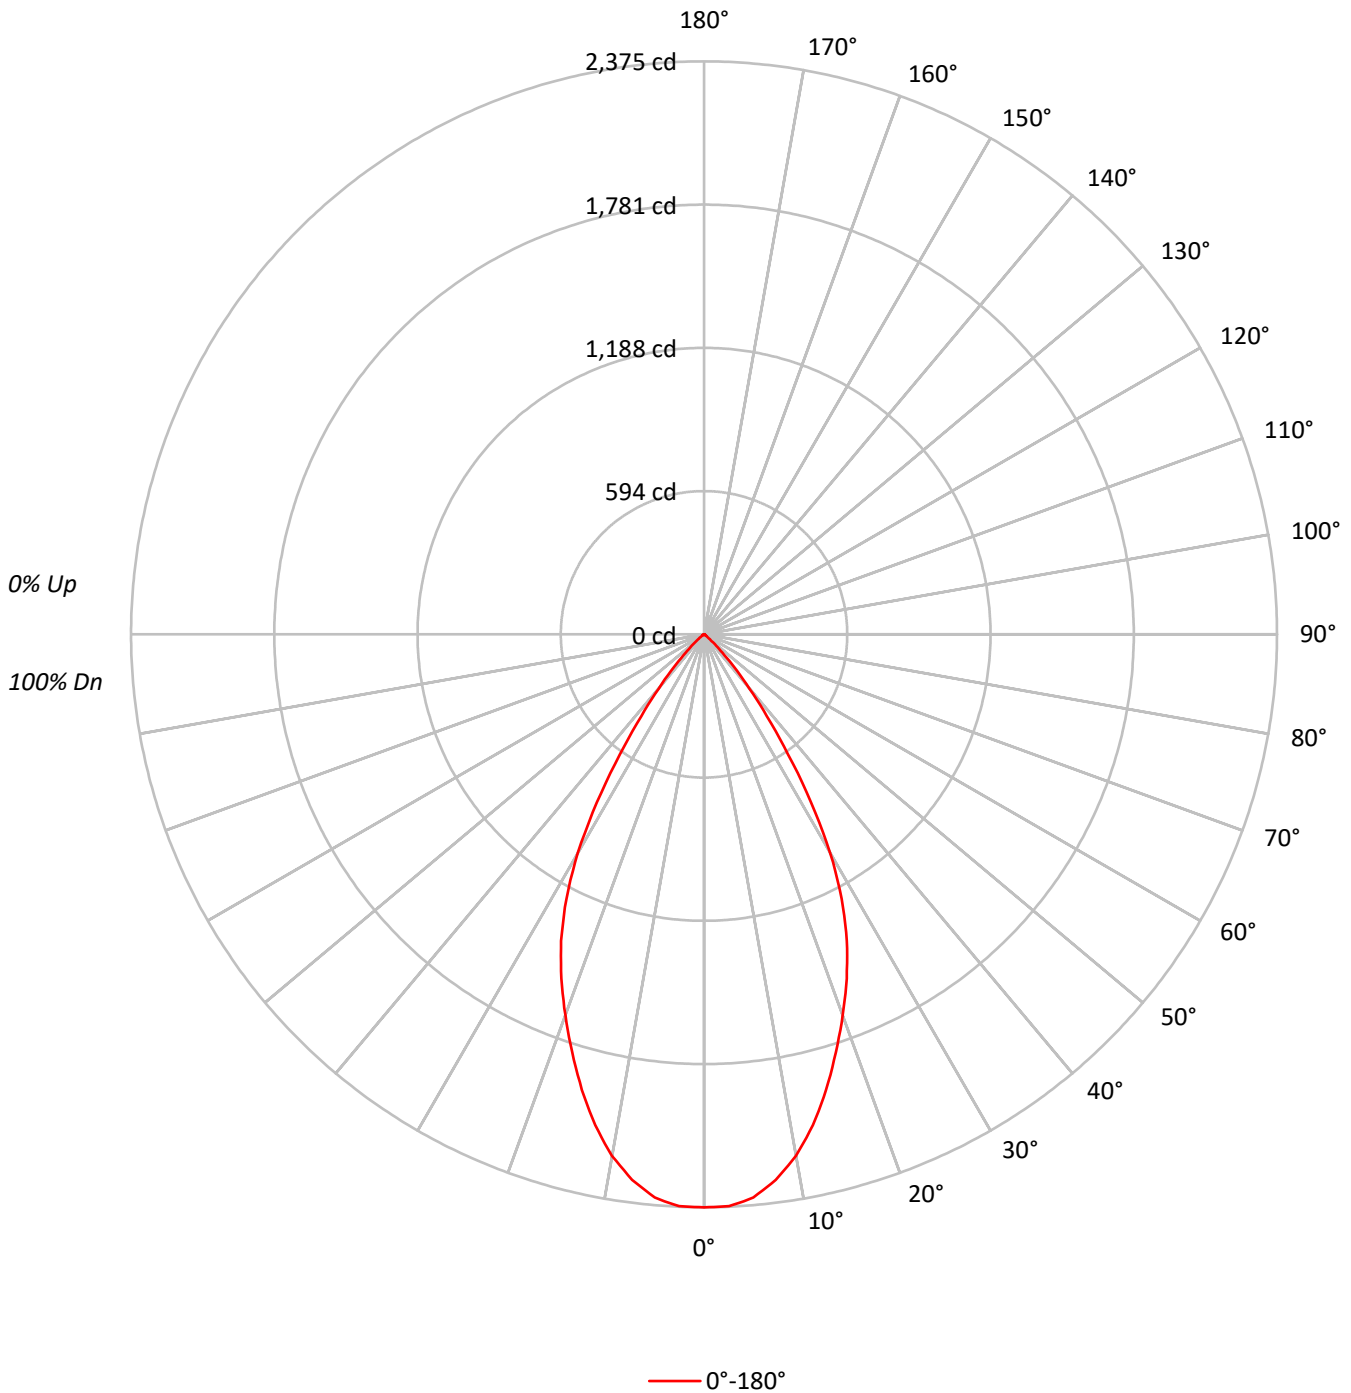



TEST NUMBER: P727000
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L940 F4LC-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	291814
5°	289032
10°	273886
15°	248664
20°	219731
25°	189965
30°	148498
35°	91066
40°	46733
45°	18573
50°	6020
55°	2078
60°	1794
65°	1424
70°	862
75°	1139
80°	0
85°	0



TEST NUMBER: P727000
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L940 F4LC-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	218.8	11.5
10°-20°	544.8	28.7
20°-30°	633.3	33.4
30°-40°	387.8	20.4
40°-50°	96.3	5.1
50°-60°	11.3	0.6
60°-70°	4.2	0.2
70°-80°	1.6	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1396.9	73.6
0°-40°	1784.6	94.0
0°-60°	1892.2	99.7
0°-90°	1898.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1898.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2375	
5°	2344	219
15°	1955	545
25°	1401	633
35°	607	388
45°	107	96
55°	10	11
65°	5	4
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P727000
CATALOG NUMBER: MRI-DRV-FLD4C-20-L940 F4LC-M-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	2375.3
2.5°	2372.8
5°	2343.7
7.5°	2280.5
10°	2195.5
12.5°	2083.8
15°	1955.1
17.5°	1816.7
20°	1680.7
22.5°	1544.6
25°	1401.4
27.5°	1236.2
30°	1046.8
32.5°	825.7
35°	607.2
37.5°	427.4
40°	291.4
42.5°	182.1
45°	106.9
47.5°	60.7
50°	31.5
52.5°	14.6
55°	9.7
57.5°	7.3
60°	7.3
62.5°	4.9
65°	4.9
67.5°	2.4
70°	2.4
72.5°	2.4
75°	2.4
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)