

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727036

Luminaire Tested: **MRI-DRV-FLD4C-20-L950 F4LC-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727036
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-20-L950 F4LC-M-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 5000K, 90 CRI
LEDS, 4LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1937.0 lumens
Efficiency: N/A
Efficacy: 88.9 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727036
CATALOG NUMBER: MRI-DRV-FLD4C-20-L950 F4LC-M-X-LI

Luminous Intensity Polar Plot

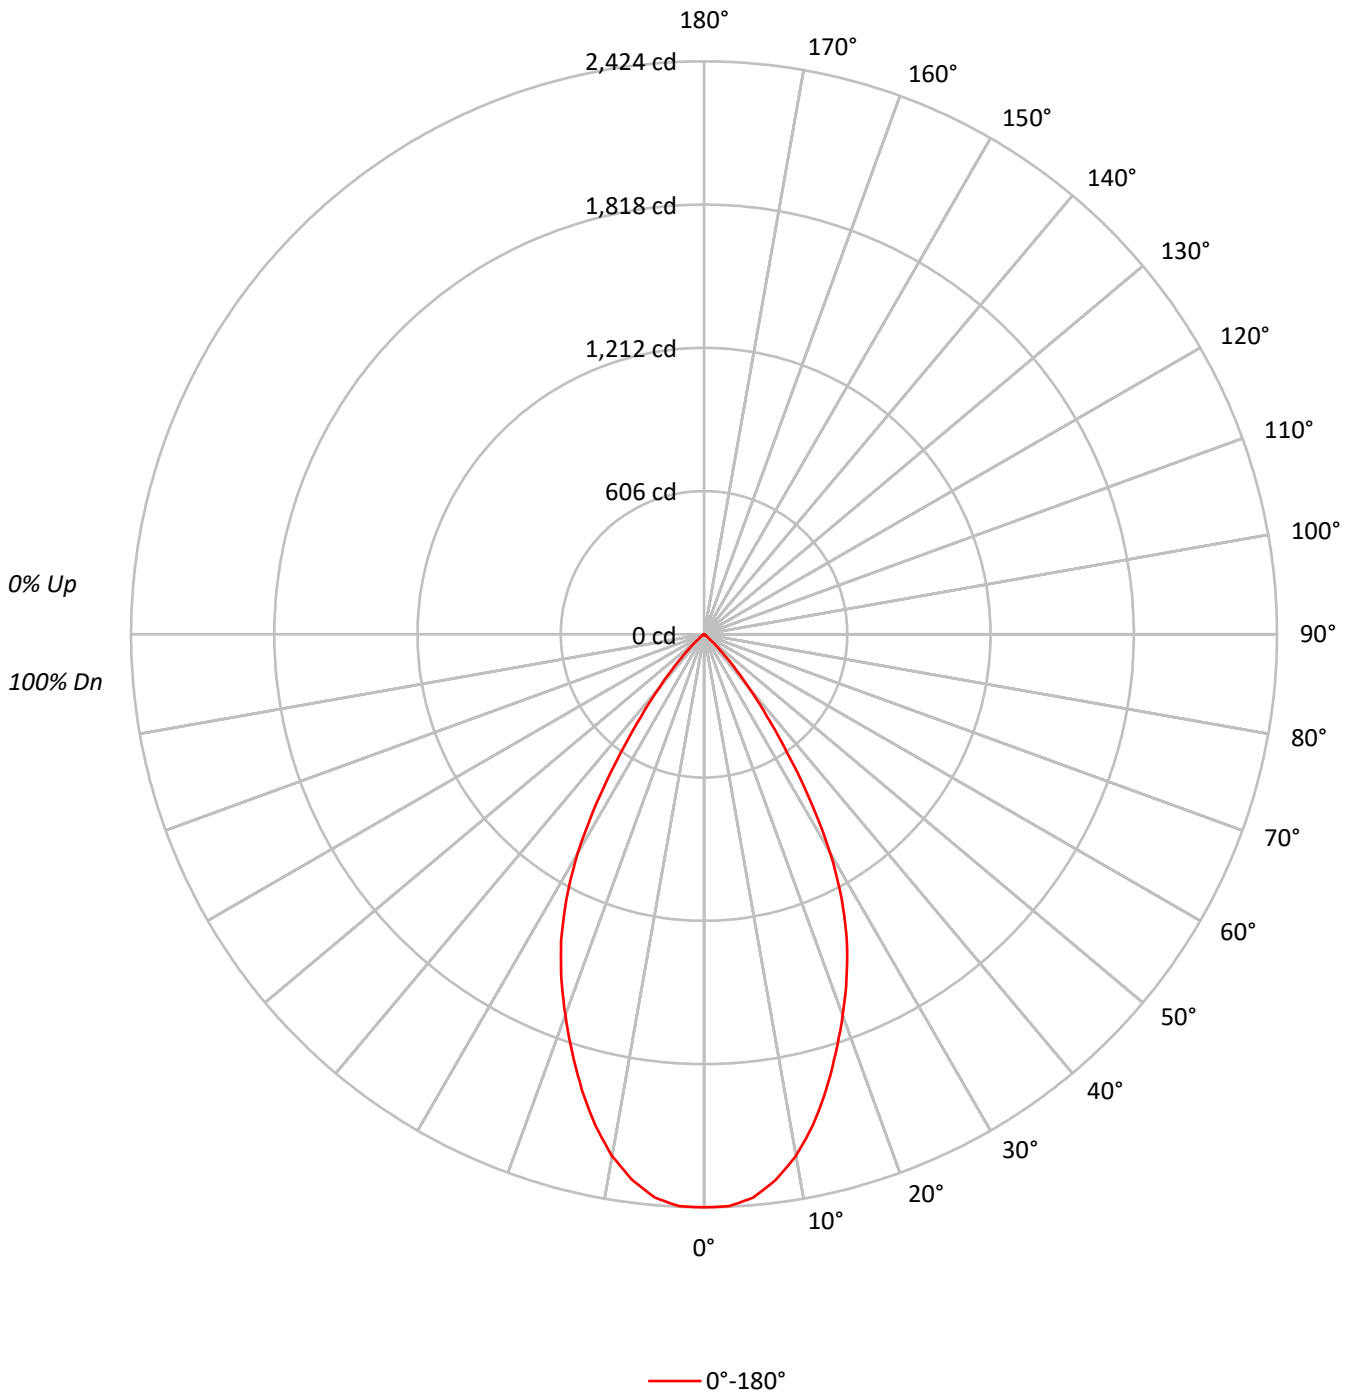



TEST NUMBER: P727036
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L950 F4LC-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94	94	94	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88	88	88	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82	82	82	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76	76	76	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71	71	71	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67	67	67	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63	63	63	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52	52	52	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	297809
5°	294976
10°	279512
15°	253777
20°	224242
25°	193869
30°	151548
35°	92940
40°	47695
45°	18955
50°	6154
55°	2120
60°	1818
65°	1453
70°	898
75°	1187
80°	0
85°	0



TEST NUMBER: P727036
 CATALOG NUMBER: MRI-DRV-FLD4C-20-L950 F4LC-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	223.3	11.5
10°-20°	556.0	28.7
20°-30°	646.3	33.4
30°-40°	395.8	20.4
40°-50°	98.3	5.1
50°-60°	11.5	0.6
60°-70°	4.3	0.2
70°-80°	1.6	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1425.6	73.6
0°-40°	1821.3	94.0
0°-60°	1931.1	99.7
0°-90°	1937.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1937.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2424	
5°	2392	223
15°	1995	556
25°	1430	646
35°	620	396
45°	109	98
55°	10	11
65°	5	4
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P727036
CATALOG NUMBER: MRI-DRV-FLD4C-20-L950 F4LC-M-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2424.1
2.5°	2421.6
5°	2391.9
7.5°	2327.4
10°	2240.6
12.5°	2126.6
15°	1995.3
17.5°	1854.0
20°	1715.2
22.5°	1576.4
25°	1430.2
27.5°	1261.6
30°	1068.3
32.5°	842.7
35°	619.7
37.5°	436.2
40°	297.4
42.5°	185.9
45°	109.1
47.5°	62.0
50°	32.2
52.5°	14.9
55°	9.9
57.5°	7.4
60°	7.4
62.5°	5.0
65°	5.0
67.5°	2.5
70°	2.5
72.5°	2.5
75°	2.5
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)