

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727144

Luminaire Tested: **MRI-DRV-FLD4C-30-L935 F4LC-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727144
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-30-L935 F4LC-M-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 4LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2795.0 lumens
Efficiency: N/A
Efficacy: 88.5 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727144
CATALOG NUMBER: MRI-DRV-FLD4C-30-L935 F4LC-M-X-LI

Luminous Intensity Polar Plot

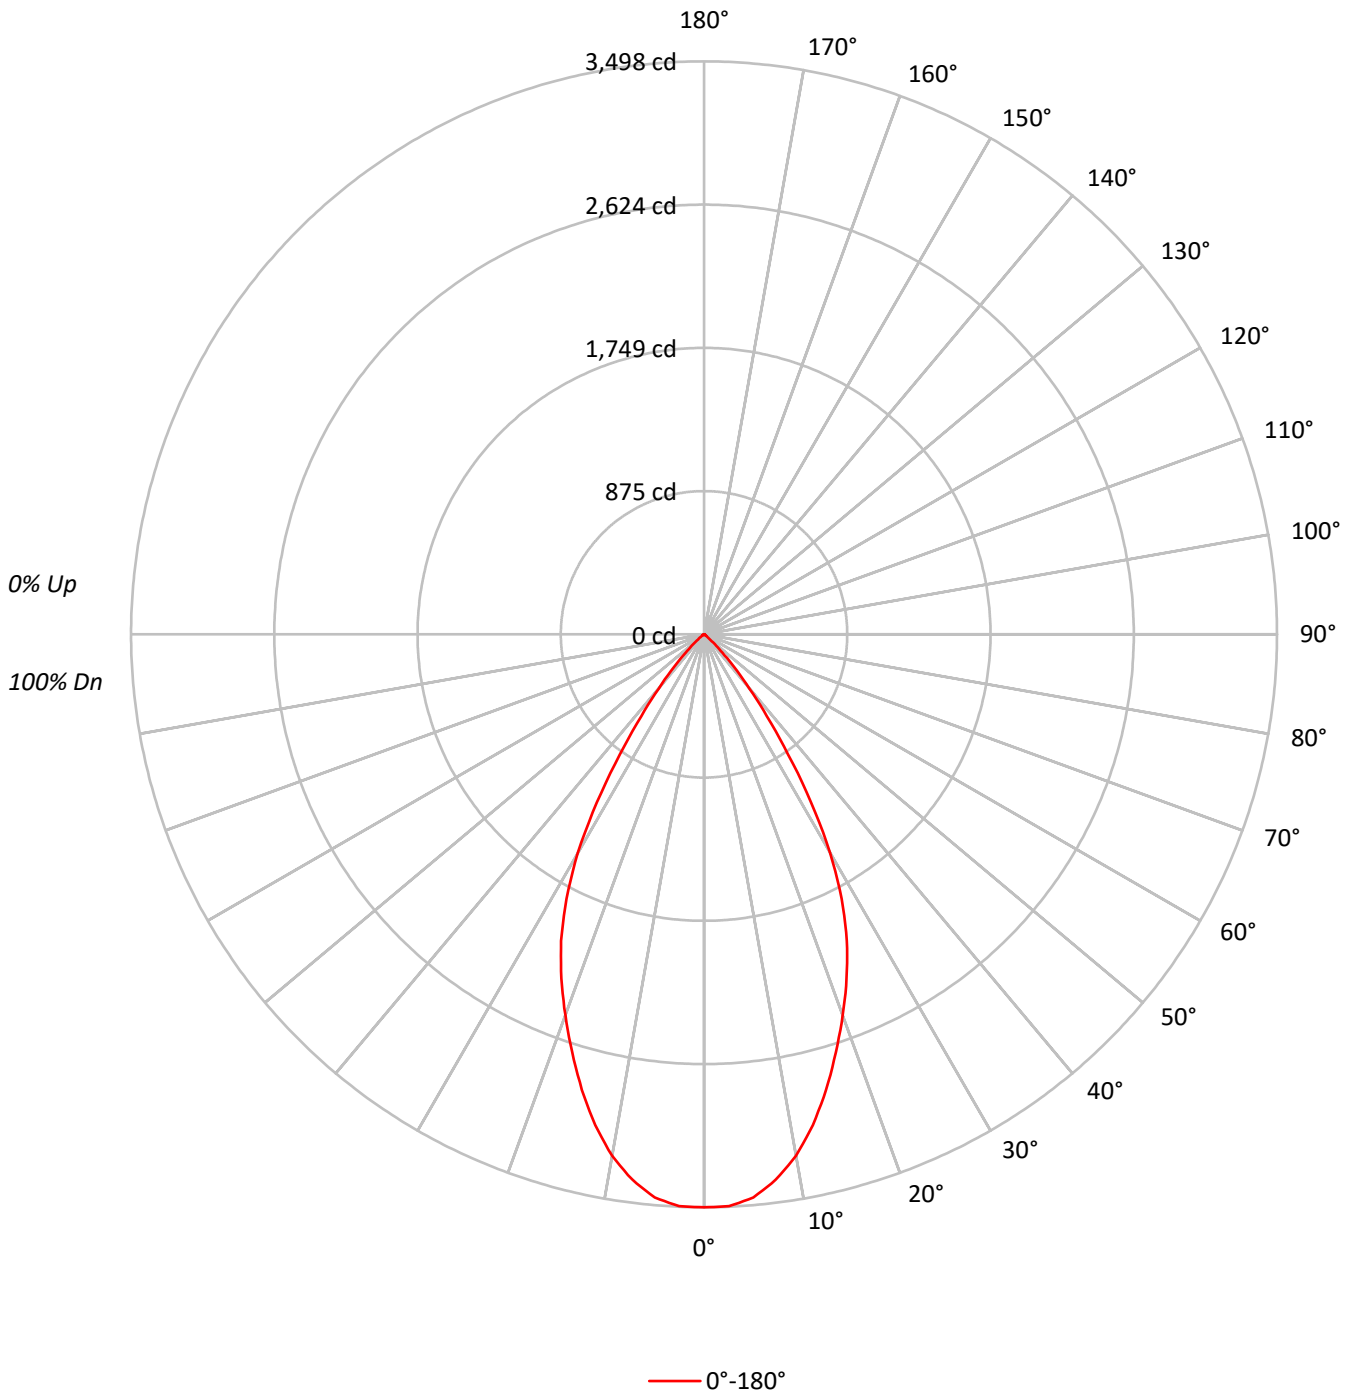



TEST NUMBER: P727144
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L935 F4LC-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94	94	94	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88	88	88	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82	82	82	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76	76	76	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71	71	71	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67	67	67	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63	63	63	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52	52	52	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	429717
5°	425624
10°	403325
15°	366185
20°	323576
25°	279742
30°	218676
35°	134094
40°	68832
45°	27347
50°	8887
55°	3063
60°	2629
65°	2093
70°	1293
75°	1709
80°	0
85°	0



TEST NUMBER: P727144
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L935 F4LC-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	322.2	11.5
10°-20°	802.2	28.7
20°-30°	932.6	33.4
30°-40°	571.1	20.4
40°-50°	141.8	5.1
50°-60°	16.6	0.6
60°-70°	6.2	0.2
70°-80°	2.4	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2057.0	73.6
0°-40°	2628.1	94.0
0°-60°	2786.5	99.7
0°-90°	2795.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2795.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3498	
5°	3451	322
15°	2879	802
25°	2064	933
35°	894	571
45°	157	142
55°	14	17
65°	7	6
75°	4	2
85°	0	0
90°	0	



TEST NUMBER: P727144
CATALOG NUMBER: MRI-DRV-FLD4C-30-L935 F4LC-M-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3497.8
2.5°	3494.2
5°	3451.3
7.5°	3358.3
10°	3233.1
12.5°	3068.6
15°	2879.1
17.5°	2675.2
20°	2475.0
22.5°	2274.6
25°	2063.7
27.5°	1820.5
30°	1541.5
32.5°	1216.0
35°	894.1
37.5°	629.4
40°	429.2
42.5°	268.2
45°	157.4
47.5°	89.4
50°	46.5
52.5°	21.5
55°	14.3
57.5°	10.7
60°	10.7
62.5°	7.2
65°	7.2
67.5°	3.6
70°	3.6
72.5°	3.6
75°	3.6
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)