

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727174

Luminaire Tested: **MRI-DRV-FLD4C-30-L940 F4LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727174
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-30-L940 F4LC-M-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2244.0 lumens
Efficiency: N/A
Efficacy: 71.0 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727174
CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-M-X-H

Luminous Intensity Polar Plot

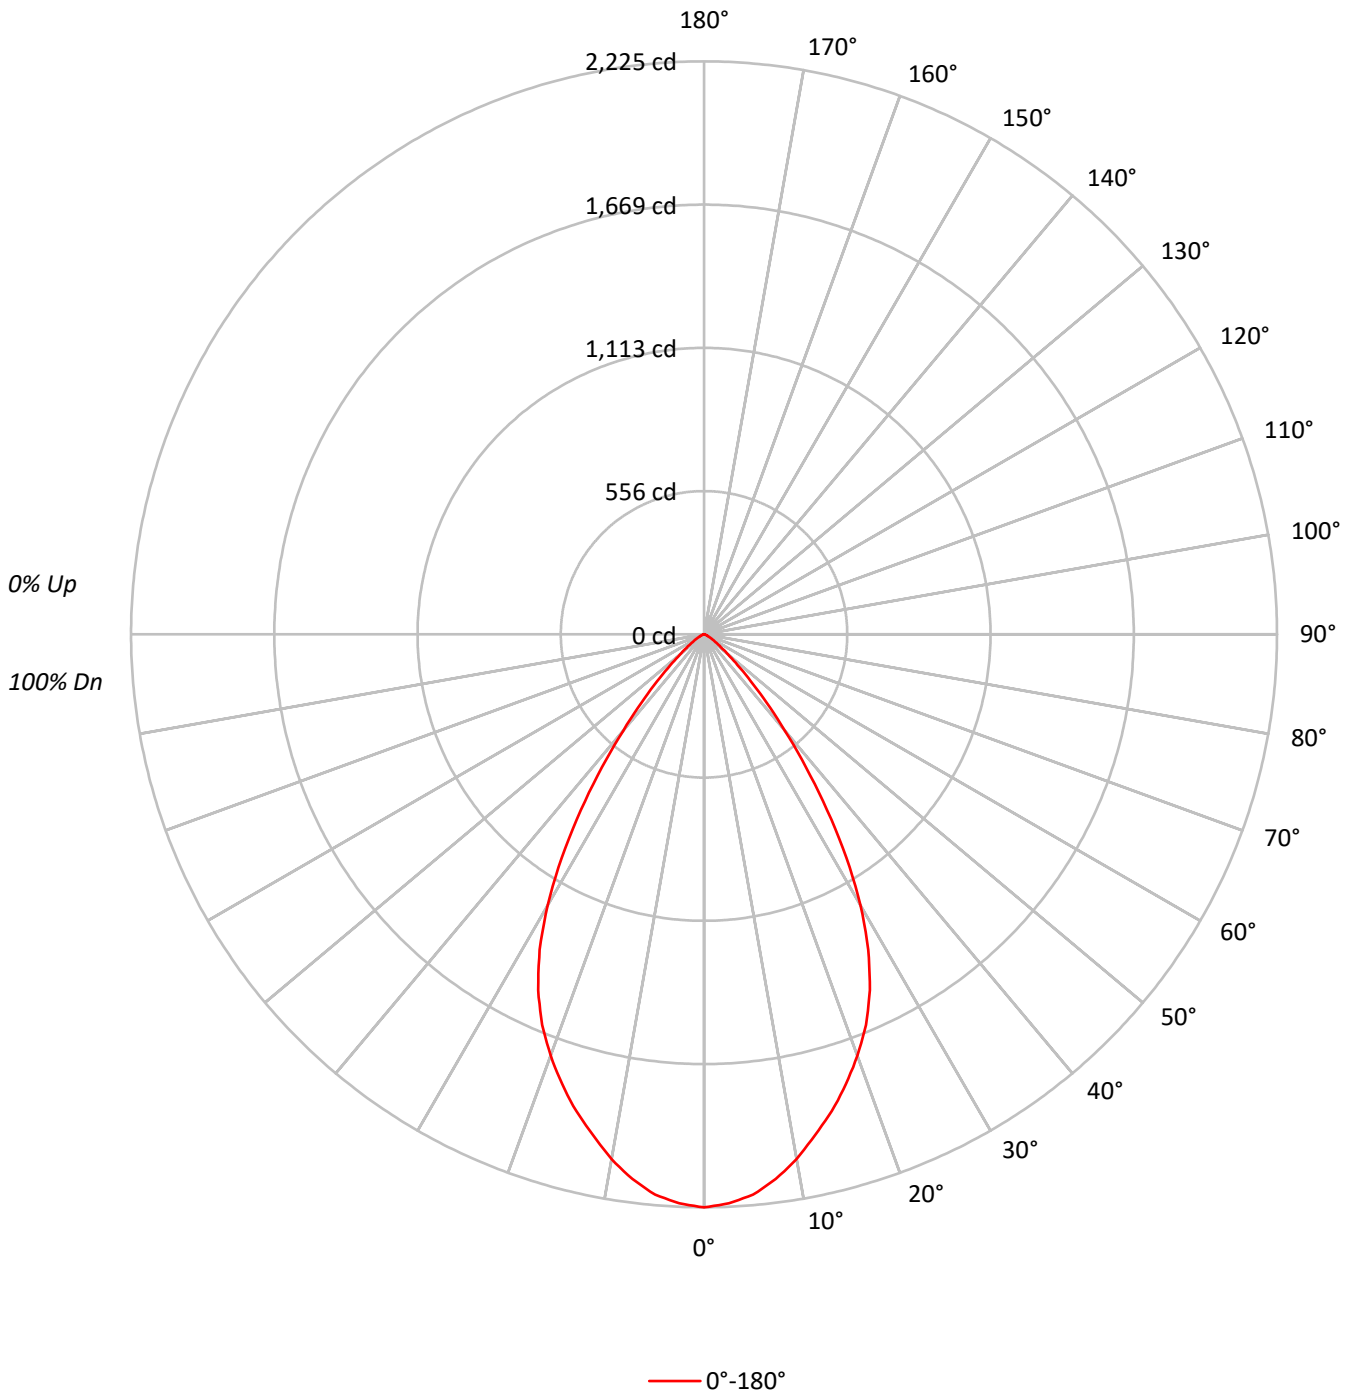



TEST NUMBER: P727174
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93		
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85		
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79		
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73		
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67		
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62		
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58		
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54		
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50		
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	273361
5°	269386
10°	258130
15°	243805
20°	227576
25°	206584
30°	172486
35°	124960
40°	78214
45°	44704
50°	23317
55°	13065
60°	8329
65°	4913
70°	3664
75°	1614
80°	2405
85°	0



TEST NUMBER: P727174
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	204.7	9.1
10°-20°	537.1	23.9
20°-30°	690.3	30.8
30°-40°	519.4	23.1
40°-50°	208.6	9.3
50°-60°	59.3	2.6
60°-70°	18.8	0.8
70°-80°	5.4	0.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1432.2	63.8
0°-40°	1951.5	87.0
0°-60°	2219.4	98.9
0°-90°	2244.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2244.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2225	
5°	2184	205
15°	1917	537
25°	1524	690
35°	833	519
45°	257	209
55°	61	59
65°	17	19
75°	3	5
85°	0	0
90°	0	



TEST NUMBER: P727174
CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2225.1
2.5°	2211.5
5°	2184.4
7.5°	2133.6
10°	2069.2
12.5°	1991.4
15°	1916.9
17.5°	1832.2
20°	1740.7
22.5°	1642.6
25°	1524.0
27.5°	1381.7
30°	1215.9
32.5°	1029.5
35°	833.2
37.5°	650.2
40°	487.7
42.5°	359.0
45°	257.3
47.5°	176.2
50°	122.0
52.5°	84.7
55°	61.0
57.5°	44.0
60°	33.9
62.5°	23.7
65°	16.9
67.5°	13.6
70°	10.2
72.5°	6.8
75°	3.4
77.5°	3.4
80°	3.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)