

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727204

Luminaire Tested: **MRI-DRV-FLD4C-30-L940 F4LC-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727204
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-30-L940 F4LC-W-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2954.0 lumens
Efficiency: N/A
Efficacy: 93.5 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727204
CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-W-X-LI

Luminous Intensity Polar Plot

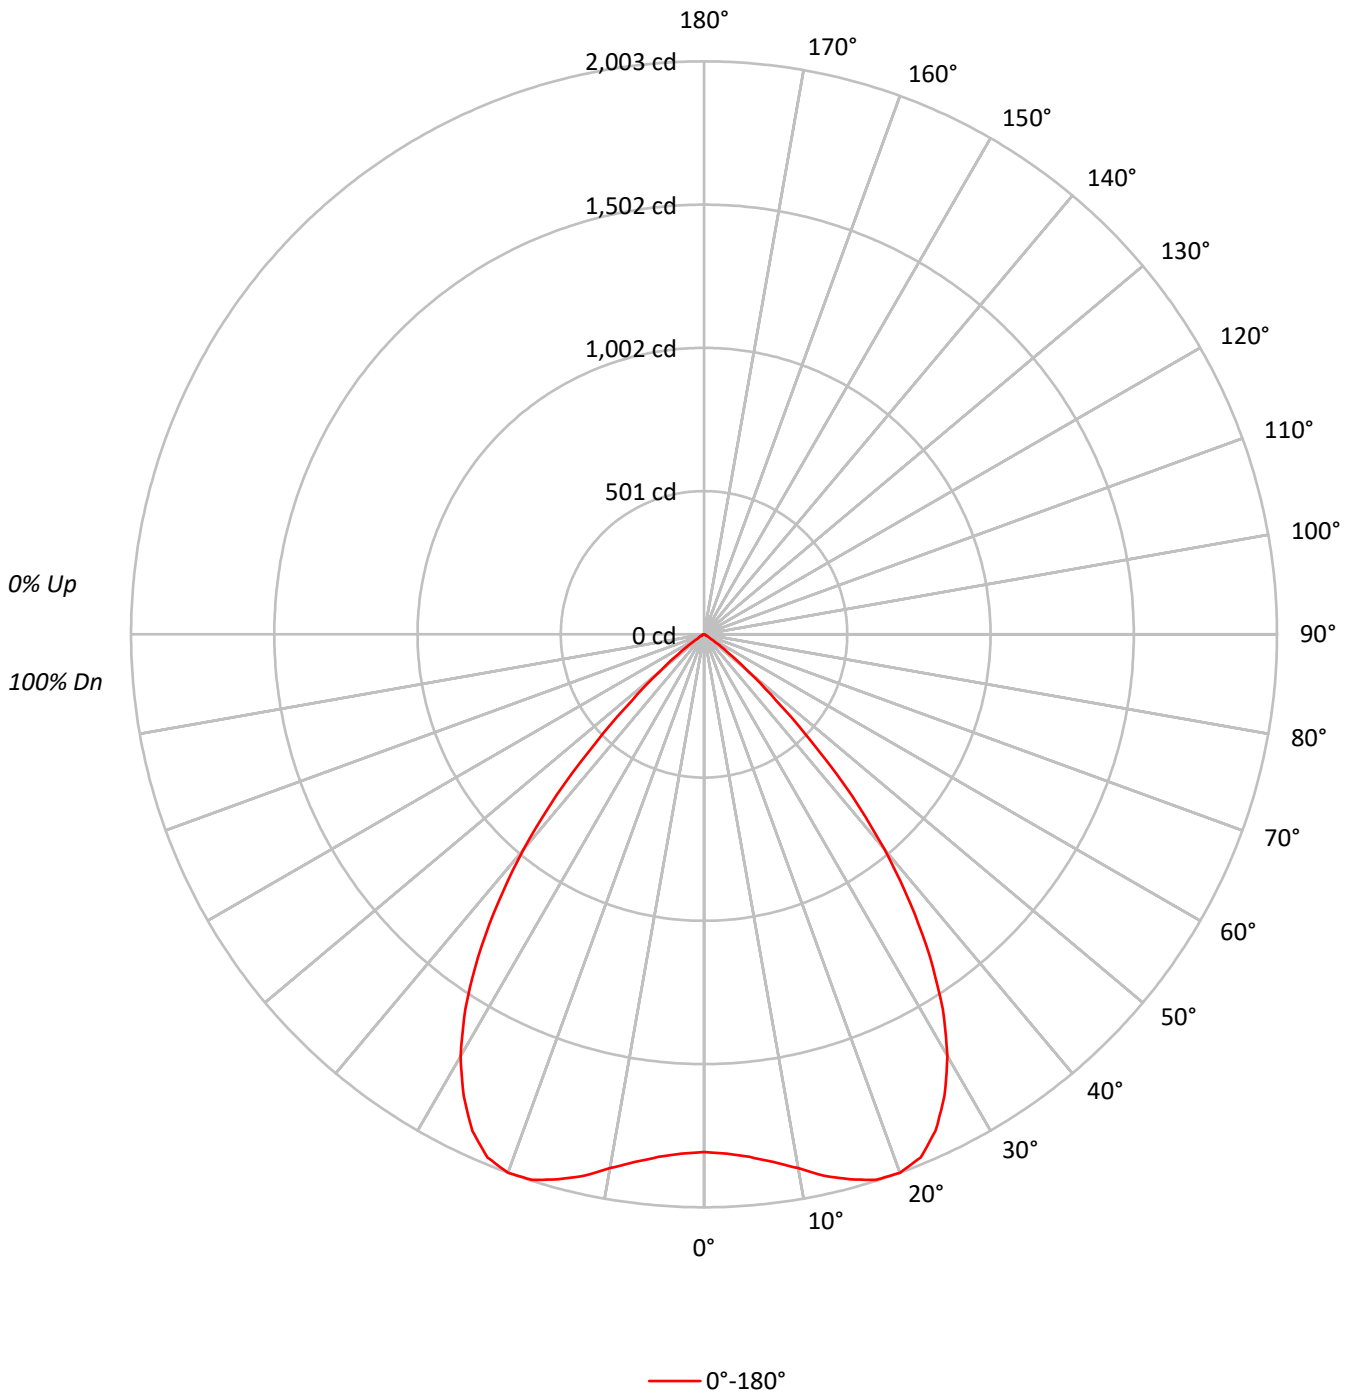



TEST NUMBER: P727204
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92
2	106	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84
3	100	93	87	83	98	92	86	82	89	85	81	86	83	80	84	81	78	77
4	94	86	79	75	92	84	79	74	82	77	73	80	76	72	78	75	72	70
5	88	79	72	68	87	78	72	67	76	71	67	74	70	66	73	69	65	64
6	83	73	66	62	82	72	66	61	71	65	61	69	64	60	68	63	60	58
7	78	68	61	56	77	67	61	56	66	60	56	64	59	55	63	59	55	54
8	74	63	56	52	72	62	56	51	61	55	51	60	55	51	59	54	51	49
9	69	59	52	48	68	58	52	47	57	51	47	56	51	47	55	50	47	45
10	66	55	48	44	65	54	48	44	53	48	44	53	47	44	52	47	43	42

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	222353
5°	226125
10°	236349
15°	250851
20°	261842
25°	259572
30°	241401
35°	206503
40°	157343
45°	92291
50°	39429
55°	11609
60°	3317
65°	1977
70°	1221
75°	1614
80°	0
85°	0



TEST NUMBER: P727204
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	177.0	6.0
10°-20°	558.6	18.9
20°-30°	871.4	29.5
30°-40°	847.8	28.7
40°-50°	423.5	14.3
50°-60°	65.5	2.2
60°-70°	7.9	0.3
70°-80°	2.2	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1607.0	54.4
0°-40°	2454.8	83.1
0°-60°	2943.8	99.7
0°-90°	2954.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2954.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1810	
5°	1834	177
15°	1972	559
25°	1915	871
35°	1377	848
45°	531	423
55°	54	66
65°	7	8
75°	3	2
85°	0	0
90°	0	



TEST NUMBER: P727204
CATALOG NUMBER: MRI-DRV-FLD4C-30-L940 F4LC-W-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1809.9
2.5°	1816.7
5°	1833.6
7.5°	1860.7
10°	1894.6
12.5°	1938.5
15°	1972.3
17.5°	1999.4
20°	2002.8
22.5°	1979.1
25°	1914.9
27.5°	1820.1
30°	1701.7
32.5°	1552.9
35°	1376.9
37.5°	1184.0
40°	981.1
42.5°	764.6
45°	531.2
47.5°	341.7
50°	206.3
52.5°	111.6
55°	54.2
57.5°	23.7
60°	13.5
62.5°	10.2
65°	6.8
67.5°	6.8
70°	3.4
72.5°	3.4
75°	3.4
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)