

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727210

Luminaire Tested: **MRI-DRV-FLD4C-30-L950 F4LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727210
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-30-L950 F4LC-M-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 5000K, 90 CRI
LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2290.0 lumens
Efficiency: N/A
Efficacy: 72.5 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727210
CATALOG NUMBER: MRI-DRV-FLD4C-30-L950 F4LC-M-X-H

Luminous Intensity Polar Plot

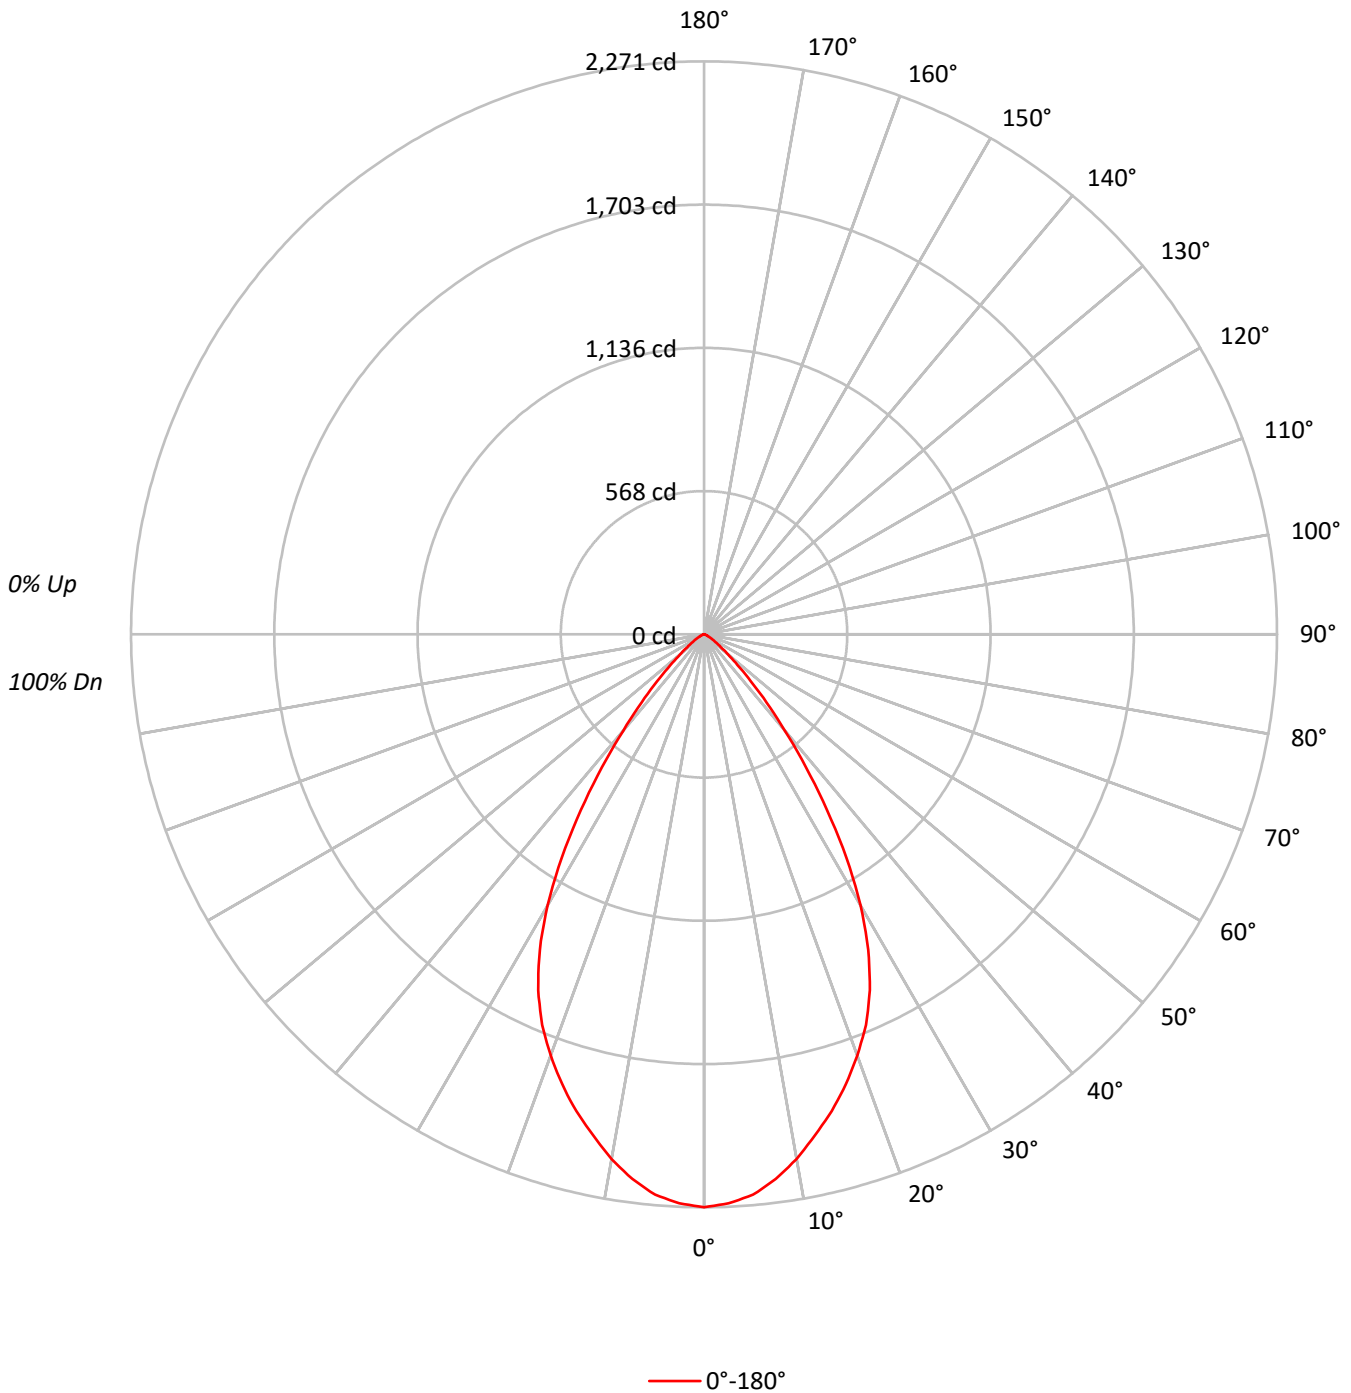



TEST NUMBER: P727210
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L950 F4LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85			85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79			79
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73			73
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67			67
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62			62
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58			58
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54			54
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50			50
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47			47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	278963
5°	274911
10°	263419
15°	248804
20°	232243
25°	210827
30°	176019
35°	127510
40°	79818
45°	45624
50°	23795
55°	13323
60°	8501
65°	5029
70°	3736
75°	1661
80°	2476
85°	0



TEST NUMBER: P727210
 CATALOG NUMBER: MRI-DRV-FLD4C-30-L950 F4LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	208.9	9.1
10°-20°	548.1	23.9
20°-30°	704.5	30.8
30°-40°	530.0	23.1
40°-50°	212.9	9.3
50°-60°	60.5	2.6
60°-70°	19.2	0.8
70°-80°	5.5	0.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1461.5	63.8
0°-40°	1991.5	87.0
0°-60°	2264.9	98.9
0°-90°	2290.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2290.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2271	
5°	2229	209
15°	1956	548
25°	1555	704
35°	850	530
45°	263	213
55°	62	60
65°	17	19
75°	4	5
85°	0	0
90°	0	



TEST NUMBER: P727210
CATALOG NUMBER: MRI-DRV-FLD4C-30-L950 F4LC-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2270.7
2.5°	2256.8
5°	2229.2
7.5°	2177.3
10°	2111.6
12.5°	2032.3
15°	1956.2
17.5°	1869.8
20°	1776.4
22.5°	1676.3
25°	1555.3
27.5°	1410.1
30°	1240.8
32.5°	1050.6
35°	850.2
37.5°	663.5
40°	497.7
42.5°	366.3
45°	262.6
47.5°	179.8
50°	124.5
52.5°	86.4
55°	62.2
57.5°	44.9
60°	34.6
62.5°	24.2
65°	17.3
67.5°	13.8
70°	10.4
72.5°	6.9
75°	3.5
77.5°	3.5
80°	3.5
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)