

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P203303

Luminaire Tested: **MRI-DRV-FLD6C-10-L927 F6LC-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P203303
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-10-L927 F6LC-W-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI
LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 876.9 lumens
Efficiency: N/A
Efficacy: 89.9 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 9.75
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P203303
CATALOG NUMBER: MRI-DRV-FLD6C-10-L927 F6LC-W-X-H

Luminous Intensity Polar Plot

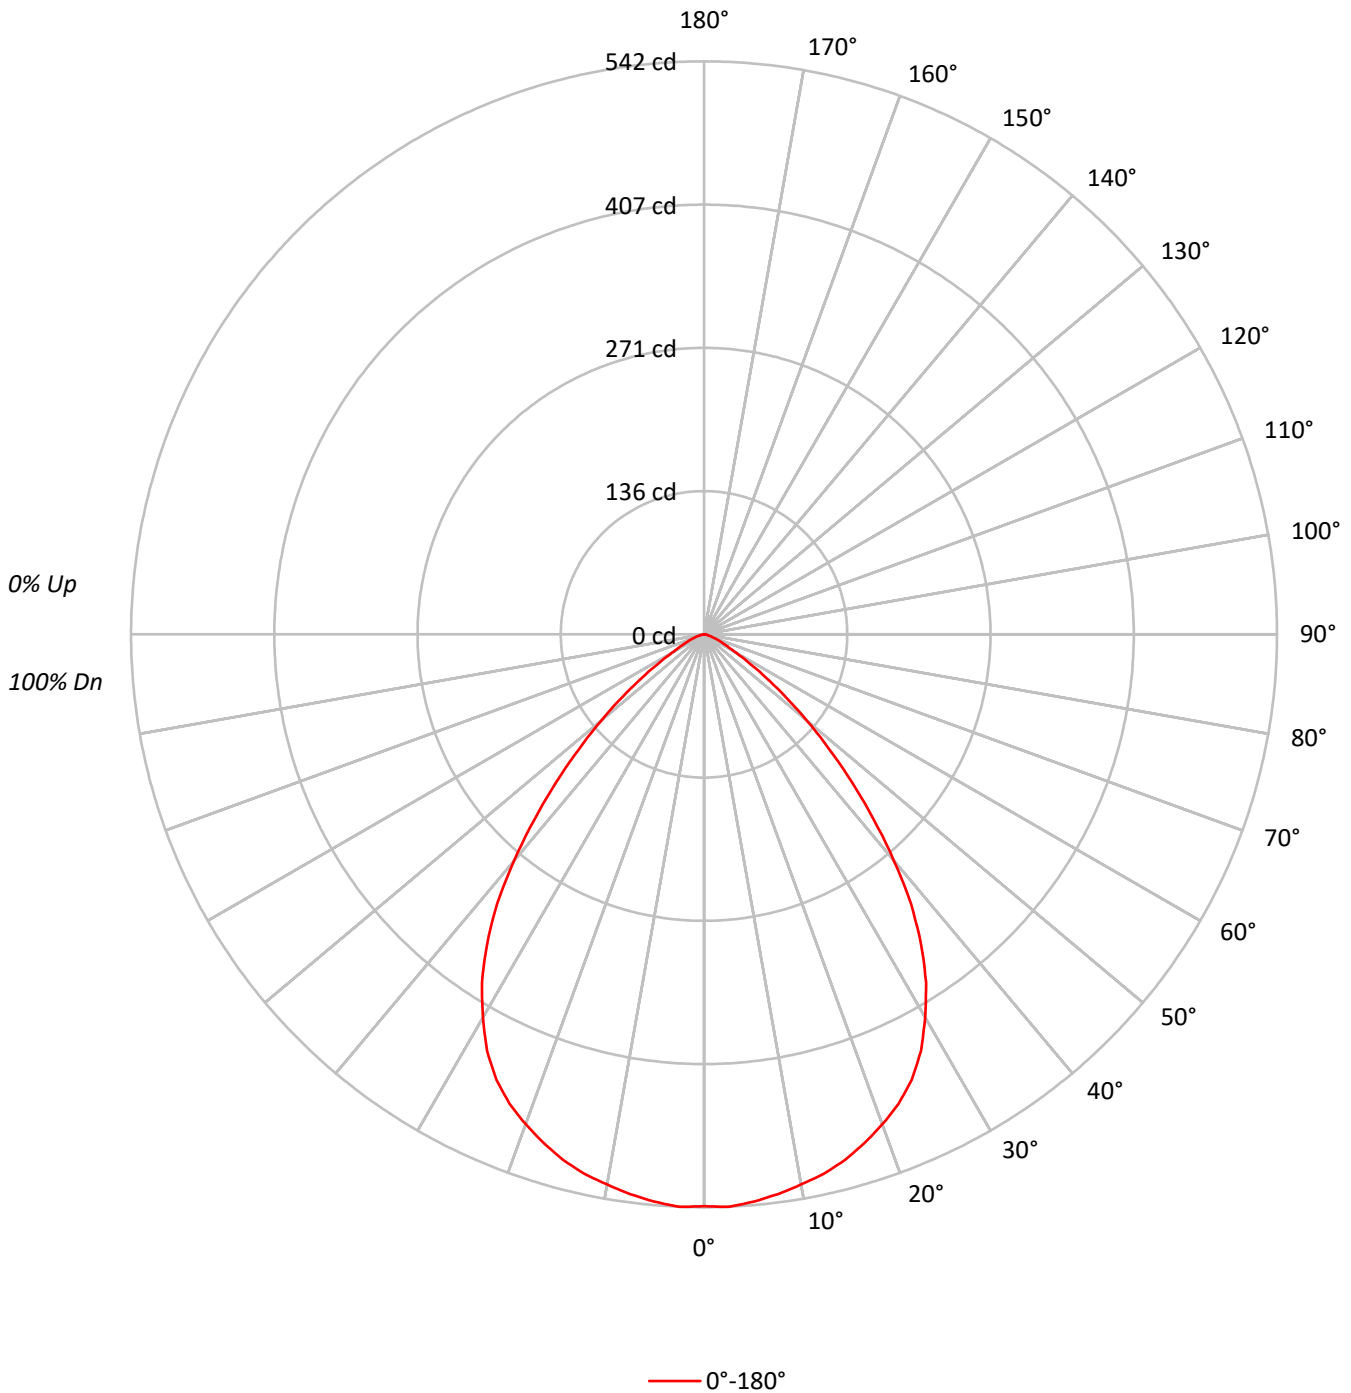



TEST NUMBER: P203303
 CATALOG NUMBER: MRI-DRV-FLD6C-10-L927 F6LC-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	29652
5°	29644
10°	29414
15°	29217
20°	28773
25°	28115
30°	26472
35°	23958
40°	20002
45°	15327
50°	10857
55°	6843
60°	3859
65°	2504
70°	1635
75°	1207
80°	726
85°	692



TEST NUMBER: P203303
 CATALOG NUMBER: MRI-DRV-FLD6C-10-L927 F6LC-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	51.1	5.8
10°-20°	145.0	16.5
20°-30°	212.6	24.2
30°-40°	221.2	25.2
40°-50°	153.0	17.5
50°-60°	66.6	7.6
60°-70°	20.4	2.3
70°-80°	6.1	0.7
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	408.6	46.6
0°-40°	629.8	71.8
0°-60°	849.5	96.9
0°-90°	876.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	876.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	541	
5°	539	51
15°	515	145
25°	465	213
35°	358	221
45°	198	153
55°	72	67
65°	19	20
75°	6	6
85°	1	1
90°	0	



TEST NUMBER: P203303
CATALOG NUMBER: MRI-DRV-FLD6C-10-L927 F6LC-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	540.9
2.5°	542.0
5°	538.7
7.5°	534.1
10°	528.4
12.5°	522.7
15°	514.8
17.5°	504.5
20°	493.2
22.5°	480.7
25°	464.8
27.5°	444.3
30°	418.2
32.5°	390.9
35°	358.0
37.5°	321.6
40°	279.5
42.5°	237.5
45°	197.7
47.5°	160.2
50°	127.3
52.5°	96.6
55°	71.6
57.5°	51.1
60°	35.2
62.5°	26.1
65°	19.3
67.5°	14.8
70°	10.2
72.5°	8.0
75°	5.7
77.5°	3.4
80°	2.3
82.5°	1.1
85°	1.1
87.5°	0.0
90°	0.0

(END OF REPORT)