

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P203423

Luminaire Tested: **MRI-DRV-FLD6C-10-L935 F6LC-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P203423
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-10-L935 F6LC-W-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 924.0 lumens
Efficiency: N/A
Efficacy: 94.8 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 9.75
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P203423
CATALOG NUMBER: MRI-DRV-FLD6C-10-L935 F6LC-W-X-H

Luminous Intensity Polar Plot

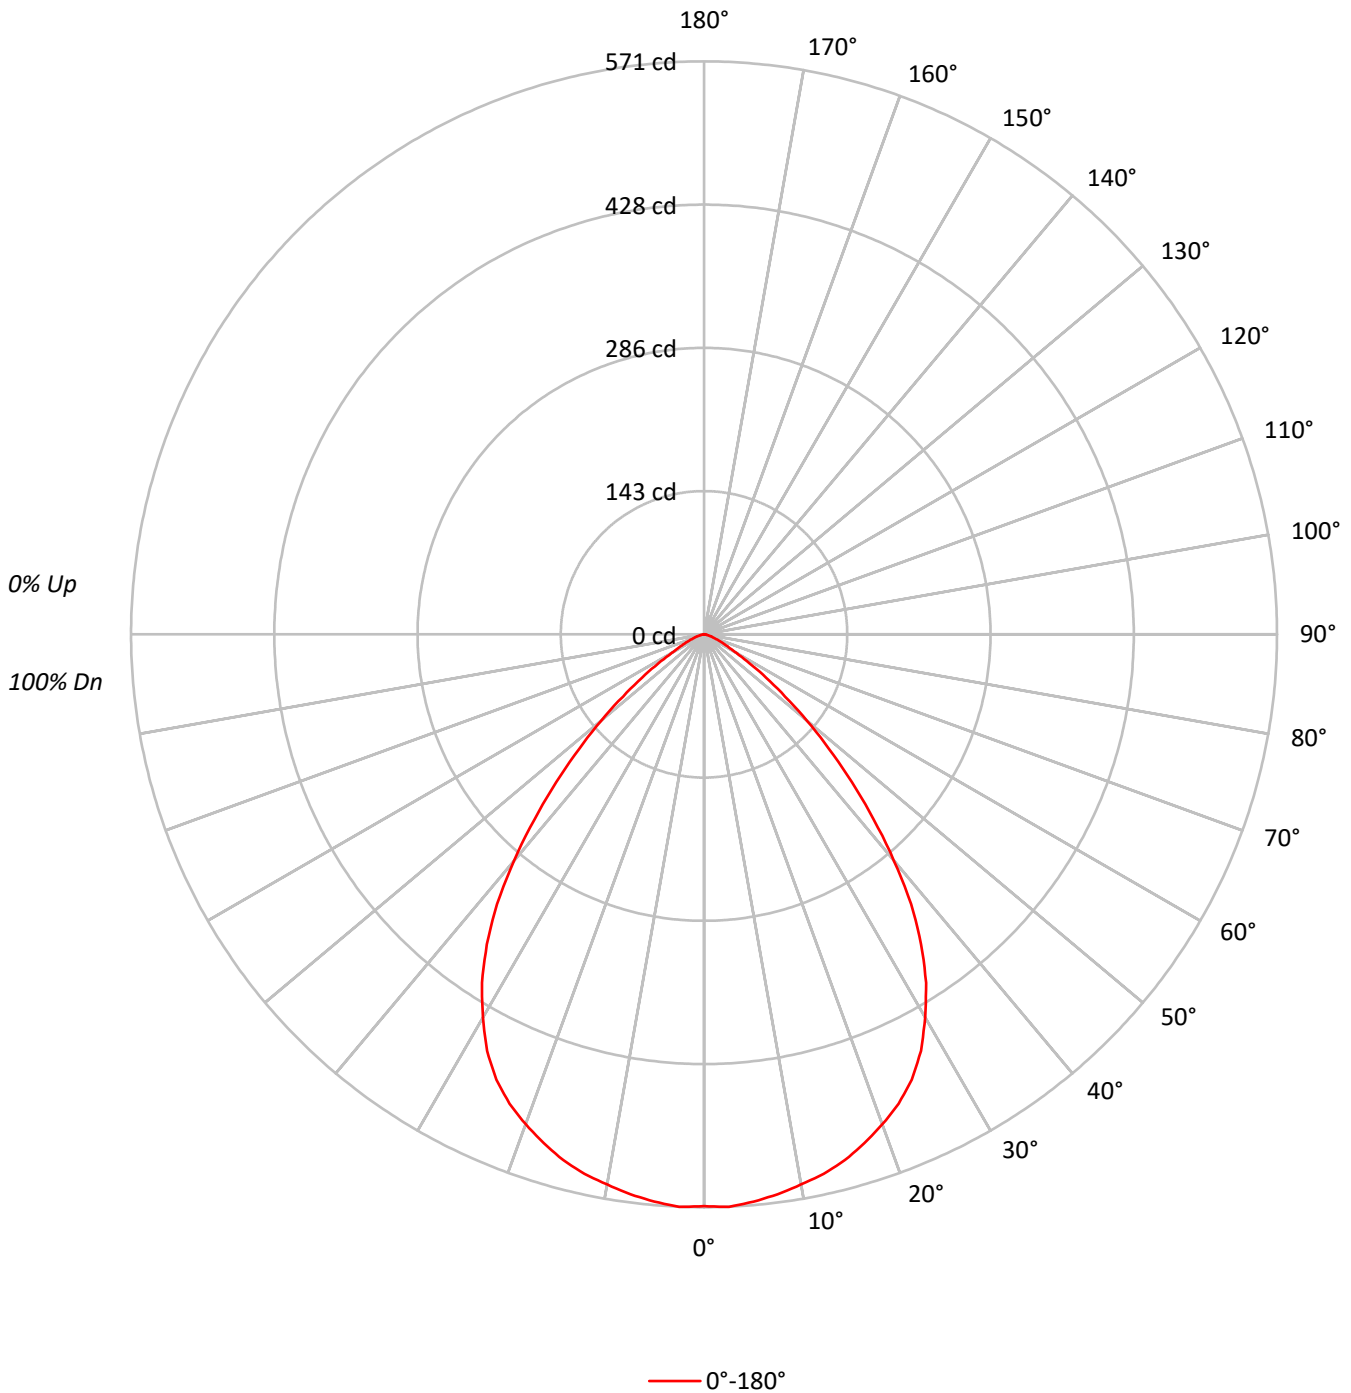



TEST NUMBER: P203423
 CATALOG NUMBER: MRI-DRV-FLD6C-10-L935 F6LC-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91			91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81			81
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73			73
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65			65
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59			59
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53			53
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49			49
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44			44
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41			41
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38			38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	31242
5°	31229
10°	30989
15°	30783
20°	30313
25°	29621
30°	27890
35°	25243
40°	21075
45°	16149
50°	11437
55°	7206
60°	4068
65°	2646
70°	1731
75°	1271
80°	758
85°	755



TEST NUMBER: P203423
 CATALOG NUMBER: MRI-DRV-FLD6C-10-L935 F6LC-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	53.8	5.8
10°-20°	152.7	16.5
20°-30°	223.9	24.2
30°-40°	233.1	25.2
40°-50°	161.2	17.5
50°-60°	70.2	7.6
60°-70°	21.5	2.3
70°-80°	6.5	0.7
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	430.5	46.6
0°-40°	663.6	71.8
0°-60°	895.0	96.9
0°-90°	924.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	924.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	570	
5°	568	54
15°	542	153
25°	490	224
35°	377	233
45°	208	161
55°	75	70
65°	20	22
75°	6	6
85°	1	1
90°	0	



TEST NUMBER: P203423
CATALOG NUMBER: MRI-DRV-FLD6C-10-L935 F6LC-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	569.9
2.5°	571.1
5°	567.5
7.5°	562.7
10°	556.7
12.5°	550.7
15°	542.4
17.5°	531.6
20°	519.6
22.5°	506.4
25°	489.7
27.5°	468.1
30°	440.6
32.5°	411.8
35°	377.2
37.5°	338.9
40°	294.5
42.5°	250.2
45°	208.3
47.5°	168.8
50°	134.1
52.5°	101.8
55°	75.4
57.5°	53.9
60°	37.1
62.5°	27.5
65°	20.4
67.5°	15.6
70°	10.8
72.5°	8.4
75°	6.0
77.5°	3.6
80°	2.4
82.5°	1.2
85°	1.2
87.5°	0.0
90°	0.0

(END OF REPORT)