

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P203583

Luminaire Tested: **MRI-DRV-FLD6C-15-L927 F6LC-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P203583
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-15-L927 F6LC-N-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI
LEDS, 6LBNH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 955.0 lumens
Efficiency: N/A
Efficacy: 60.4 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P203583
CATALOG NUMBER: MRI-DRV-FLD6C-15-L927 F6LC-N-X-H

Luminous Intensity Polar Plot

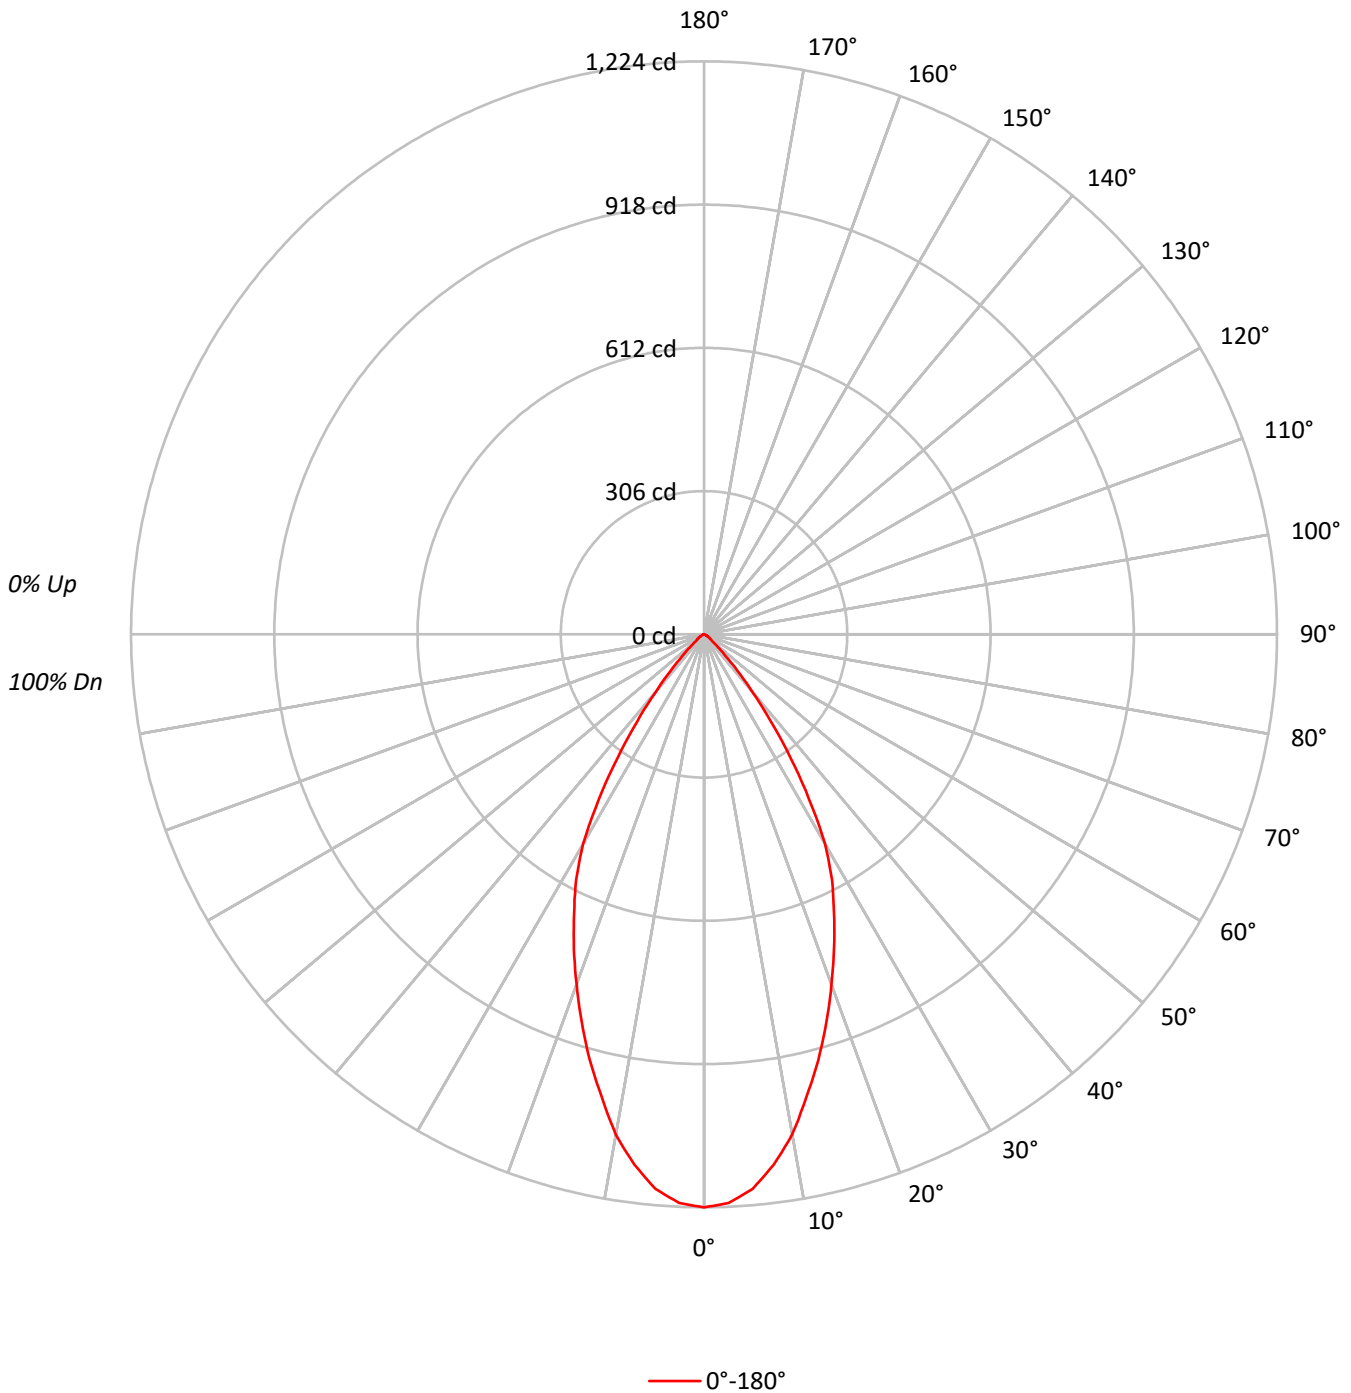



TEST NUMBER: P203583
 CATALOG NUMBER: MRI-DRV-FLD6C-15-L927 F6LC-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93	93	93	93
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87	87	87	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81	81	81	81
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75	75	75	75
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70	70	70	70
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65	65	65	65
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61	61	61	61
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58	58	58	58
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54	54	54	54
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51	51	51	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	67111
5°	65452
10°	60392
15°	53468
20°	46426
25°	39710
30°	32739
35°	21556
40°	11586
45°	5132
50°	2081
55°	1501
60°	954
65°	687
70°	561
75°	381
80°	568
85°	0



TEST NUMBER: P203583
 CATALOG NUMBER: MRI-DRV-FLD6C-15-L927 F6LC-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	110.1	11.5
10°-20°	262.5	27.5
20°-30°	300.8	31.5
30°-40°	202.1	21.2
40°-50°	57.7	6.0
50°-60°	14.1	1.5
60°-70°	5.4	0.6
70°-80°	2.1	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	673.4	70.5
0°-40°	875.4	91.7
0°-60°	947.3	99.2
0°-90°	955.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	955.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1224	
5°	1189	110
15°	942	263
25°	656	301
35°	322	202
45°	66	58
55°	16	14
65°	5	5
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P203583
CATALOG NUMBER: MRI-DRV-FLD6C-15-L927 F6LC-N-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1224.2
2.5°	1215.5
5°	1189.4
7.5°	1142.3
10°	1084.9
12.5°	1011.7
15°	942.1
17.5°	869.0
20°	795.8
22.5°	726.2
25°	656.5
27.5°	592.1
30°	517.2
32.5°	417.9
35°	322.1
37.5°	235.1
40°	161.9
42.5°	106.2
45°	66.2
47.5°	40.0
50°	24.4
52.5°	19.1
55°	15.7
57.5°	12.2
60°	8.7
62.5°	6.9
65°	5.3
67.5°	3.5
70°	3.5
72.5°	1.8
75°	1.8
77.5°	1.8
80°	1.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)