

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P203853

Luminaire Tested: **MRI-DRV-FLD6C-15-L950 F6LC-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P203853
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-15-L950 F6LC-W-X-LI
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 5000K, 90 CRI
LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1653.0 lumens
Efficiency: N/A
Efficacy: 104.6 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P203853
CATALOG NUMBER: MRI-DRV-FLD6C-15-L950 F6LC-W-X-LI

Luminous Intensity Polar Plot

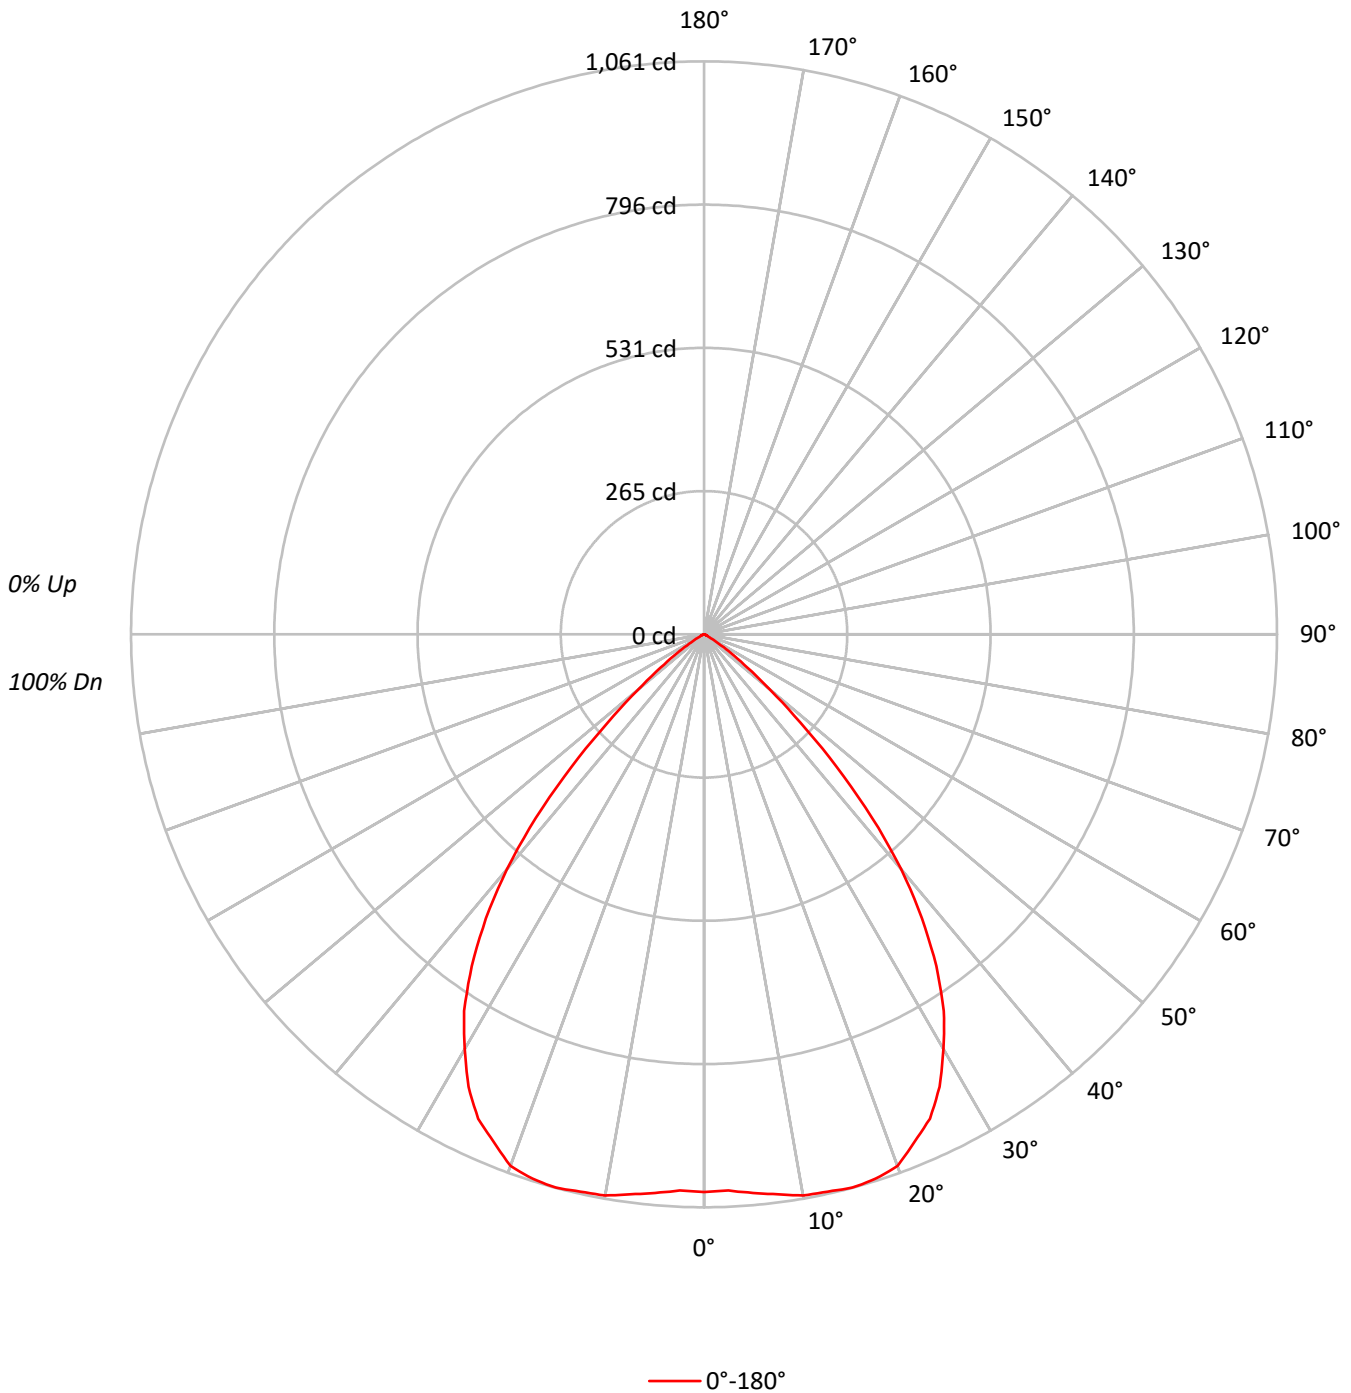



TEST NUMBER: P203853

CATALOG NUMBER: MRI-DRV-FLD6C-15-L950 F6LC-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83
3	100	92	87	82	97	91	86	81	88	84	80	86	82	79	83	80	77	76
4	93	85	78	73	92	84	78	73	81	76	72	79	75	71	77	74	70	69
5	88	78	71	66	86	77	71	66	75	70	65	73	69	65	72	68	64	63
6	82	72	65	60	81	71	65	60	70	64	59	68	63	59	67	62	59	57
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48
9	69	57	51	46	67	57	50	46	56	50	46	55	50	46	54	49	46	44
10	65	54	47	43	64	53	47	42	52	46	42	51	46	42	51	46	42	41

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	56613
5°	57137
10°	58733
15°	60205
20°	61115
25°	59852
30°	56116
35°	50172
40°	40640
45°	26879
50°	13586
55°	5735
60°	1842
65°	726
70°	609
75°	402
80°	0
85°	0



TEST NUMBER: P203853
 CATALOG NUMBER: MRI-DRV-FLD6C-15-L950 F6LC-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.6	6.0
10°-20°	299.4	18.1
20°-30°	451.4	27.3
30°-40°	462.0	27.9
40°-50°	269.1	16.3
50°-60°	61.8	3.7
60°-70°	7.6	0.5
70°-80°	2.0	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	850.4	51.4
0°-40°	1312.4	79.4
0°-60°	1643.4	99.4
0°-90°	1653.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1653.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1033	
5°	1038	100
15°	1061	299
25°	990	451
35°	750	462
45°	347	269
55°	60	62
65°	6	8
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P203853
CATALOG NUMBER: MRI-DRV-FLD6C-15-L950 F6LC-W-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1032.7
2.5°	1030.8
5°	1038.3
7.5°	1045.7
10°	1055.1
12.5°	1057.0
15°	1060.8
17.5°	1057.0
20°	1047.6
22.5°	1017.6
25°	989.5
27.5°	944.6
30°	886.5
32.5°	826.5
35°	749.7
37.5°	663.4
40°	567.9
42.5°	461.0
45°	346.7
47.5°	241.7
50°	159.3
52.5°	101.2
55°	60.0
57.5°	31.9
60°	16.8
62.5°	9.4
65°	5.6
67.5°	5.6
70°	3.8
72.5°	1.9
75°	1.9
77.5°	1.9
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)