

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204183

Luminaire Tested: **MRI-DRV-FLD6C-25-L927 F6LC-N-X-H**

Issue Date: 08/03/2023



**Test Information**


Test Method: LM-79-08  
Report Number: P204183  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 08/03/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: MRI-DRV-FLD6C-25-L927 F6LC-N-X-H  
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI  
LEDS, 6LBNH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1547.0 lumens  
Efficiency: N/A  
Efficacy: 49.1 lumens/watt  
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 31.5  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P204183  
CATALOG NUMBER: MRI-DRV-FLD6C-25-L927 F6LC-N-X-H

### Luminous Intensity Polar Plot

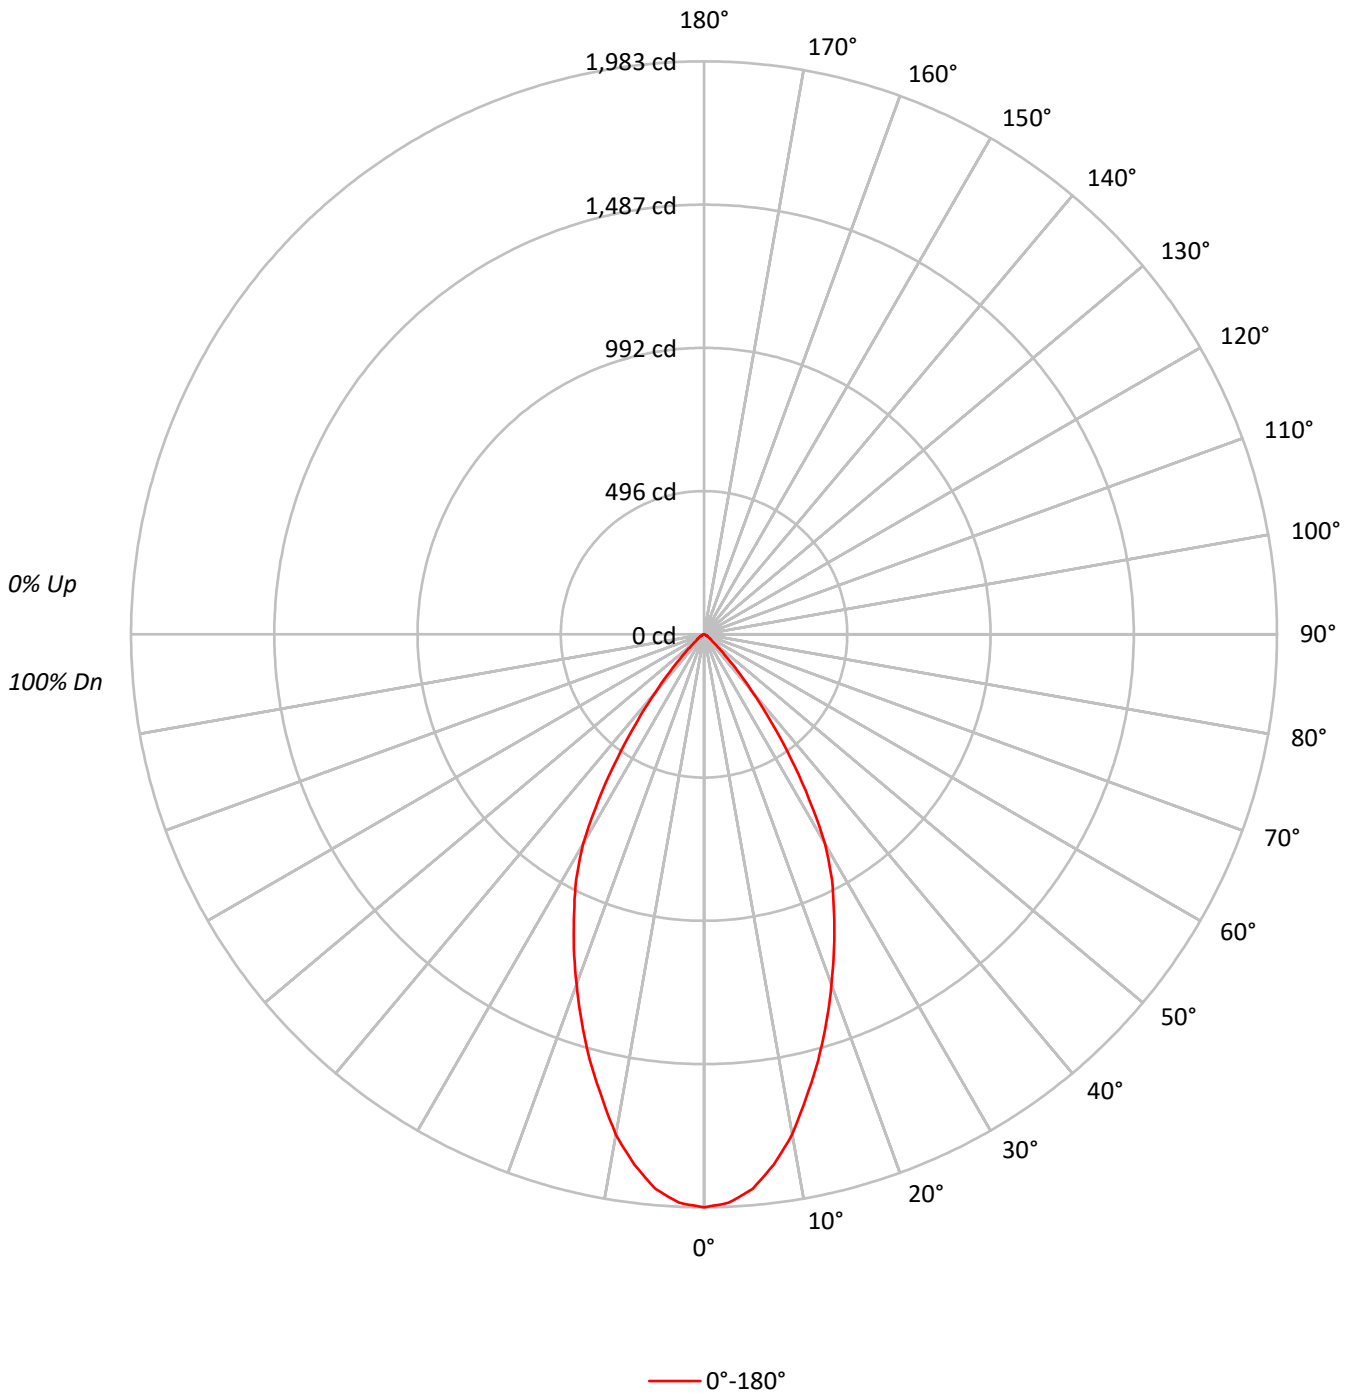



TEST NUMBER: P204183  
 CATALOG NUMBER: MRI-DRV-FLD6C-25-L927 F6LC-N-X-H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93			93
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87			87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			81
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75			75
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70			70
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65			65
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61			61
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58			58
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54			54
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51			51

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	108714
5°	106025
10°	97827
15°	86612
20°	75204
25°	64322
30°	53033
35°	34920
40°	18771
45°	8311
50°	3369
55°	2428
60°	1546
65°	1103
70°	914
75°	593
80°	884
85°	0



TEST NUMBER: P204183  
 CATALOG NUMBER: MRI-DRV-FLD6C-25-L927 F6LC-N-X-H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	178.3	11.5
10°-20°	425.3	27.5
20°-30°	487.2	31.5
30°-40°	327.3	21.2
40°-50°	93.5	6.0
50°-60°	22.9	1.5
60°-70°	8.7	0.6
70°-80°	3.3	0.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1090.8	70.5
0°-40°	1418.1	91.7
0°-60°	1534.6	99.2
0°-90°	1547.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1547.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1983	
5°	1927	178
15°	1526	425
25°	1063	487
35°	522	327
45°	107	94
55°	25	23
65°	8	9
75°	3	3
85°	0	0
90°	0	



TEST NUMBER: P204183  
CATALOG NUMBER: MRI-DRV-FLD6C-25-L927 F6LC-N-X-H

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1983.1
2.5°	1969.0
5°	1926.7
7.5°	1850.5
10°	1757.4
12.5°	1638.9
15°	1526.1
17.5°	1407.7
20°	1289.1
22.5°	1176.3
25°	1063.4
27.5°	959.1
30°	837.8
32.5°	677.0
35°	521.8
37.5°	380.8
40°	262.3
42.5°	172.1
45°	107.2
47.5°	64.9
50°	39.5
52.5°	31.0
55°	25.4
57.5°	19.8
60°	14.1
62.5°	11.2
65°	8.5
67.5°	5.7
70°	5.7
72.5°	2.8
75°	2.8
77.5°	2.8
80°	2.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)