

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204303

Luminaire Tested: **MRI-DRV-FLD6C-25-L935 F6LC-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204303
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-25-L935 F6LC-N-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 6LBNH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1631.0 lumens
Efficiency: N/A
Efficacy: 51.8 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204303
CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-H

Luminous Intensity Polar Plot

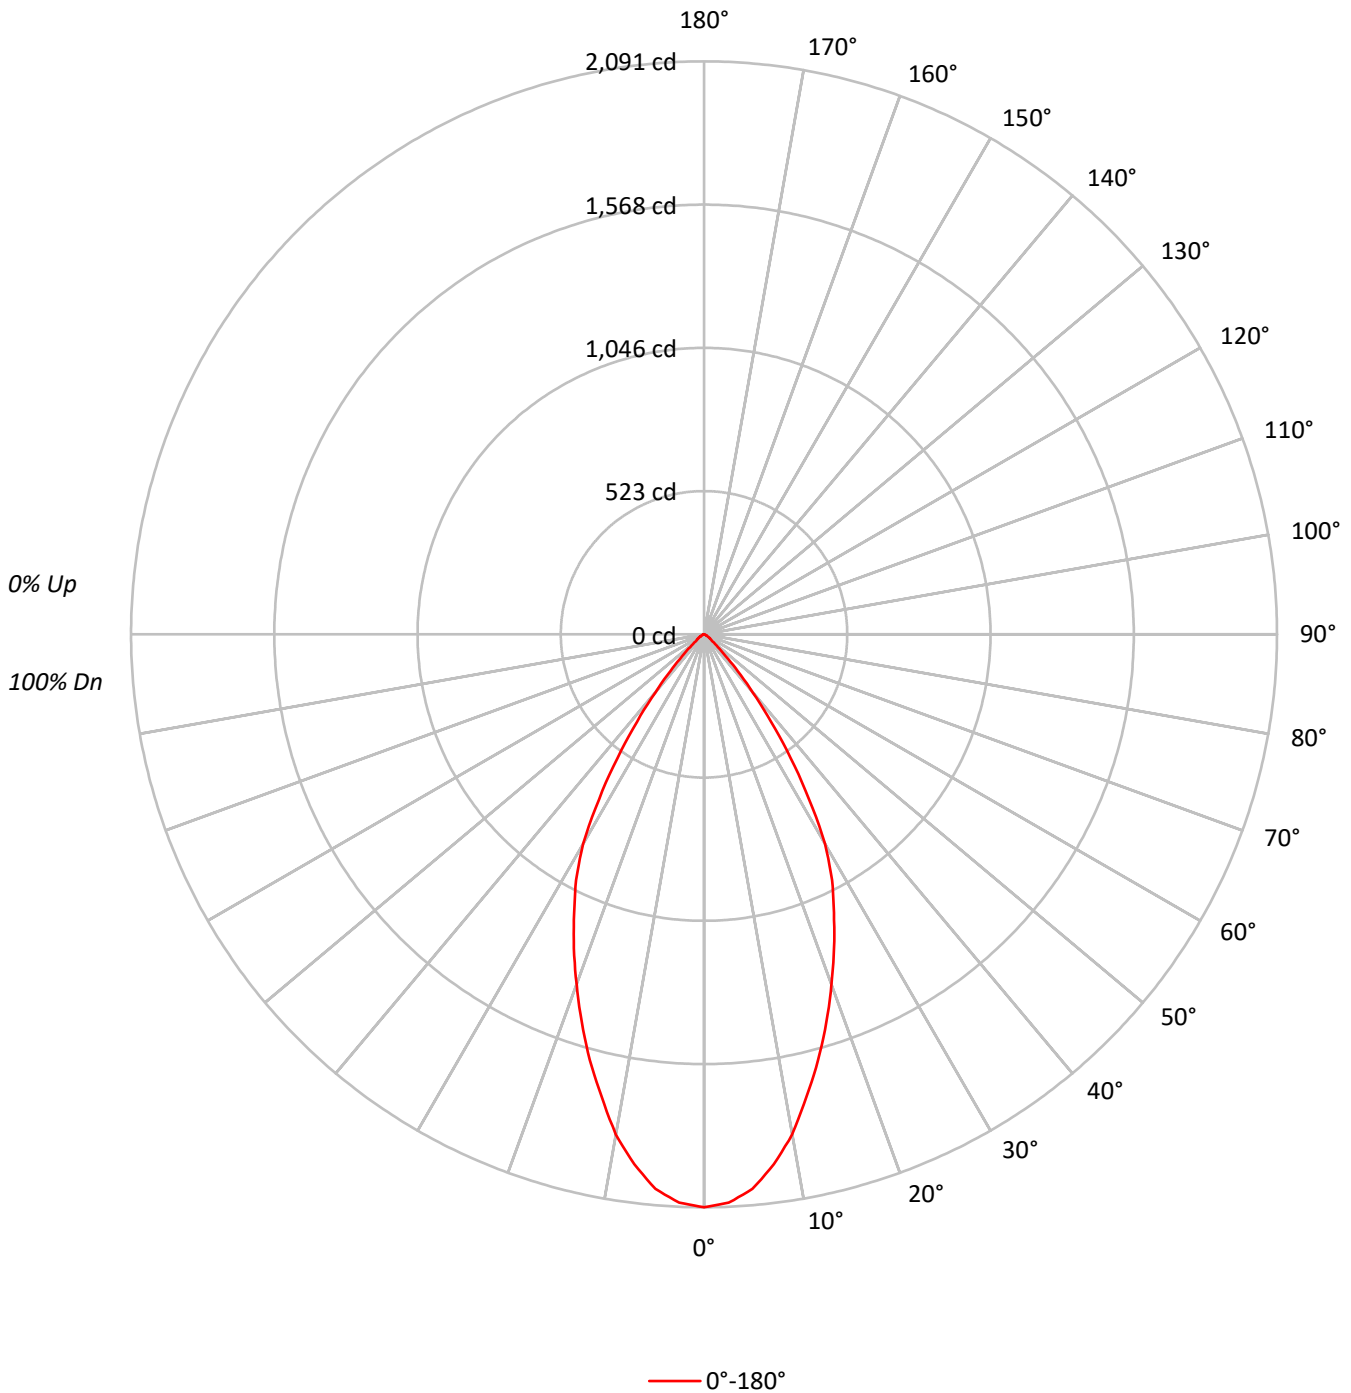



TEST NUMBER: P204303
 CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93			93
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87			87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			81
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75			75
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70			70
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65			65
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61			61
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58			58
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54			54
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51			51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	114618
5°	111782
10°	103143
15°	91317
20°	79288
25°	67818
30°	55914
35°	36821
40°	19794
45°	8761
50°	3556
55°	2561
60°	1623
65°	1167
70°	962
75°	635
80°	947
85°	0



TEST NUMBER: P204303
 CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	188.0	11.5
10°-20°	448.4	27.5
20°-30°	513.6	31.5
30°-40°	345.1	21.2
40°-50°	98.6	6.0
50°-60°	24.1	1.5
60°-70°	9.2	0.6
70°-80°	3.6	0.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1150.0	70.5
0°-40°	1495.1	91.7
0°-60°	1617.9	99.2
0°-90°	1631.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1631.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2091	
5°	2031	188
15°	1609	448
25°	1121	514
35°	550	345
45°	113	99
55°	27	24
65°	9	9
75°	3	4
85°	0	0
90°	0	



TEST NUMBER: P204303
CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2090.8
2.5°	2075.9
5°	2031.3
7.5°	1950.9
10°	1852.9
12.5°	1727.9
15°	1609.0
17.5°	1484.1
20°	1359.1
22.5°	1240.2
25°	1121.2
27.5°	1011.1
30°	883.3
32.5°	713.7
35°	550.2
37.5°	401.5
40°	276.6
42.5°	181.4
45°	113.0
47.5°	68.4
50°	41.7
52.5°	32.7
55°	26.8
57.5°	20.8
60°	14.8
62.5°	11.9
65°	9.0
67.5°	6.0
70°	6.0
72.5°	3.0
75°	3.0
77.5°	3.0
80°	3.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)