

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions  
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204403

Luminaire Tested: **MRI-DRV-FLD6C-25-L950 F6LC-M-X-H**

Issue Date: 08/03/2023



**Test Information**


Test Method: LM-79-08  
Report Number: P204403  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203254)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 08/03/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: MRI-DRV-FLD6C-25-L950 F6LC-M-X-H  
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 5000K, 90 CRI  
LEDS, 6LBMH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1938.0 lumens  
Efficiency: N/A  
Efficacy: 61.5 lumens/watt  
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 31.5  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P204403  
CATALOG NUMBER: MRI-DRV-FLD6C-25-L950 F6LC-M-X-H

### Luminous Intensity Polar Plot

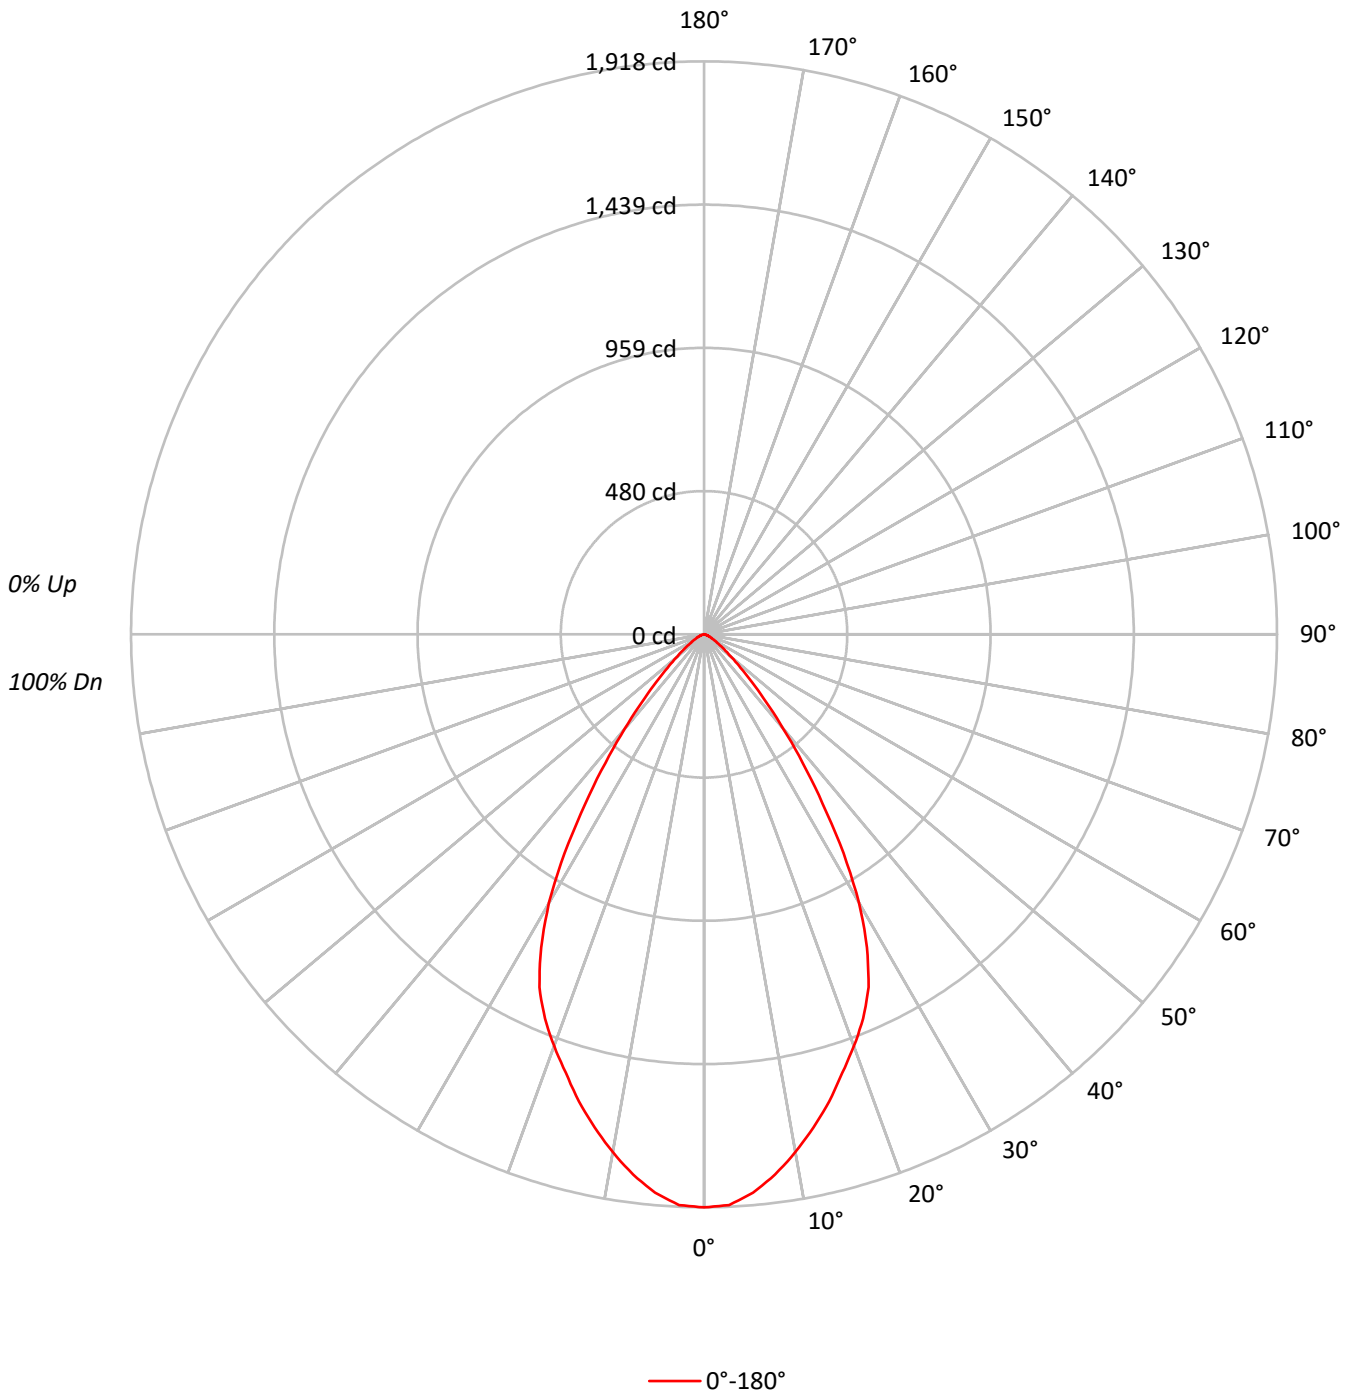



TEST NUMBER: P204403  
 CATALOG NUMBER: MRI-DRV-FLD6C-25-L950 F6LC-M-X-H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92				92
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85				85
3	101	94	88	84	99	92	88	84	90	86	82	87	84	81	85	82	80	78				78
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72				72
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66				66
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61				61
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57				57
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53				53
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49				49
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46				46

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	105145
5°	103257
10°	97983
15°	91885
20°	85571
25°	78845
30°	65694
35°	46304
40°	29512
45°	17599
50°	10388
55°	6604
60°	4550
65°	3230
70°	2228
75°	1758
80°	852
85°	0



TEST NUMBER: P204403  
 CATALOG NUMBER: MRI-DRV-FLD6C-25-L950 F6LC-M-X-H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	175.4	9.0
10°-20°	453.7	23.4
20°-30°	587.8	30.3
30°-40°	436.4	22.5
40°-50°	184.2	9.5
50°-60°	65.4	3.4
60°-70°	25.2	1.3
70°-80°	8.7	0.5
80°-90°	1.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1216.8	62.8
0°-40°	1653.3	85.3
0°-60°	1902.9	98.2
0°-90°	1938.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1938.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1918	
5°	1876	175
15°	1619	454
25°	1304	588
35°	692	436
45°	227	184
55°	69	65
65°	25	25
75°	8	9
85°	0	1
90°	0	



TEST NUMBER: P204403  
CATALOG NUMBER: MRI-DRV-FLD6C-25-L950 F6LC-M-X-H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1918.0
2.5°	1912.4
5°	1876.4
7.5°	1823.8
10°	1760.2
12.5°	1691.0
15°	1619.0
17.5°	1538.8
20°	1466.8
22.5°	1392.1
25°	1303.5
27.5°	1181.7
30°	1037.8
32.5°	869.0
35°	691.9
37.5°	542.5
40°	412.4
42.5°	307.2
45°	227.0
47.5°	166.0
50°	121.8
52.5°	91.3
55°	69.1
57.5°	52.5
60°	41.5
62.5°	30.5
65°	24.9
67.5°	19.3
70°	13.9
72.5°	11.0
75°	8.3
77.5°	5.6
80°	2.7
82.5°	2.7
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)