

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204623

Luminaire Tested: **MRI-DRV-FLD6C-30-L935 F6LC-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204623
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-30-L935 F6LC-W-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2694.0 lumens
Efficiency: N/A
Efficacy: 85.3 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204623
CATALOG NUMBER: MRI-DRV-FLD6C-30-L935 F6LC-W-X-H

Luminous Intensity Polar Plot

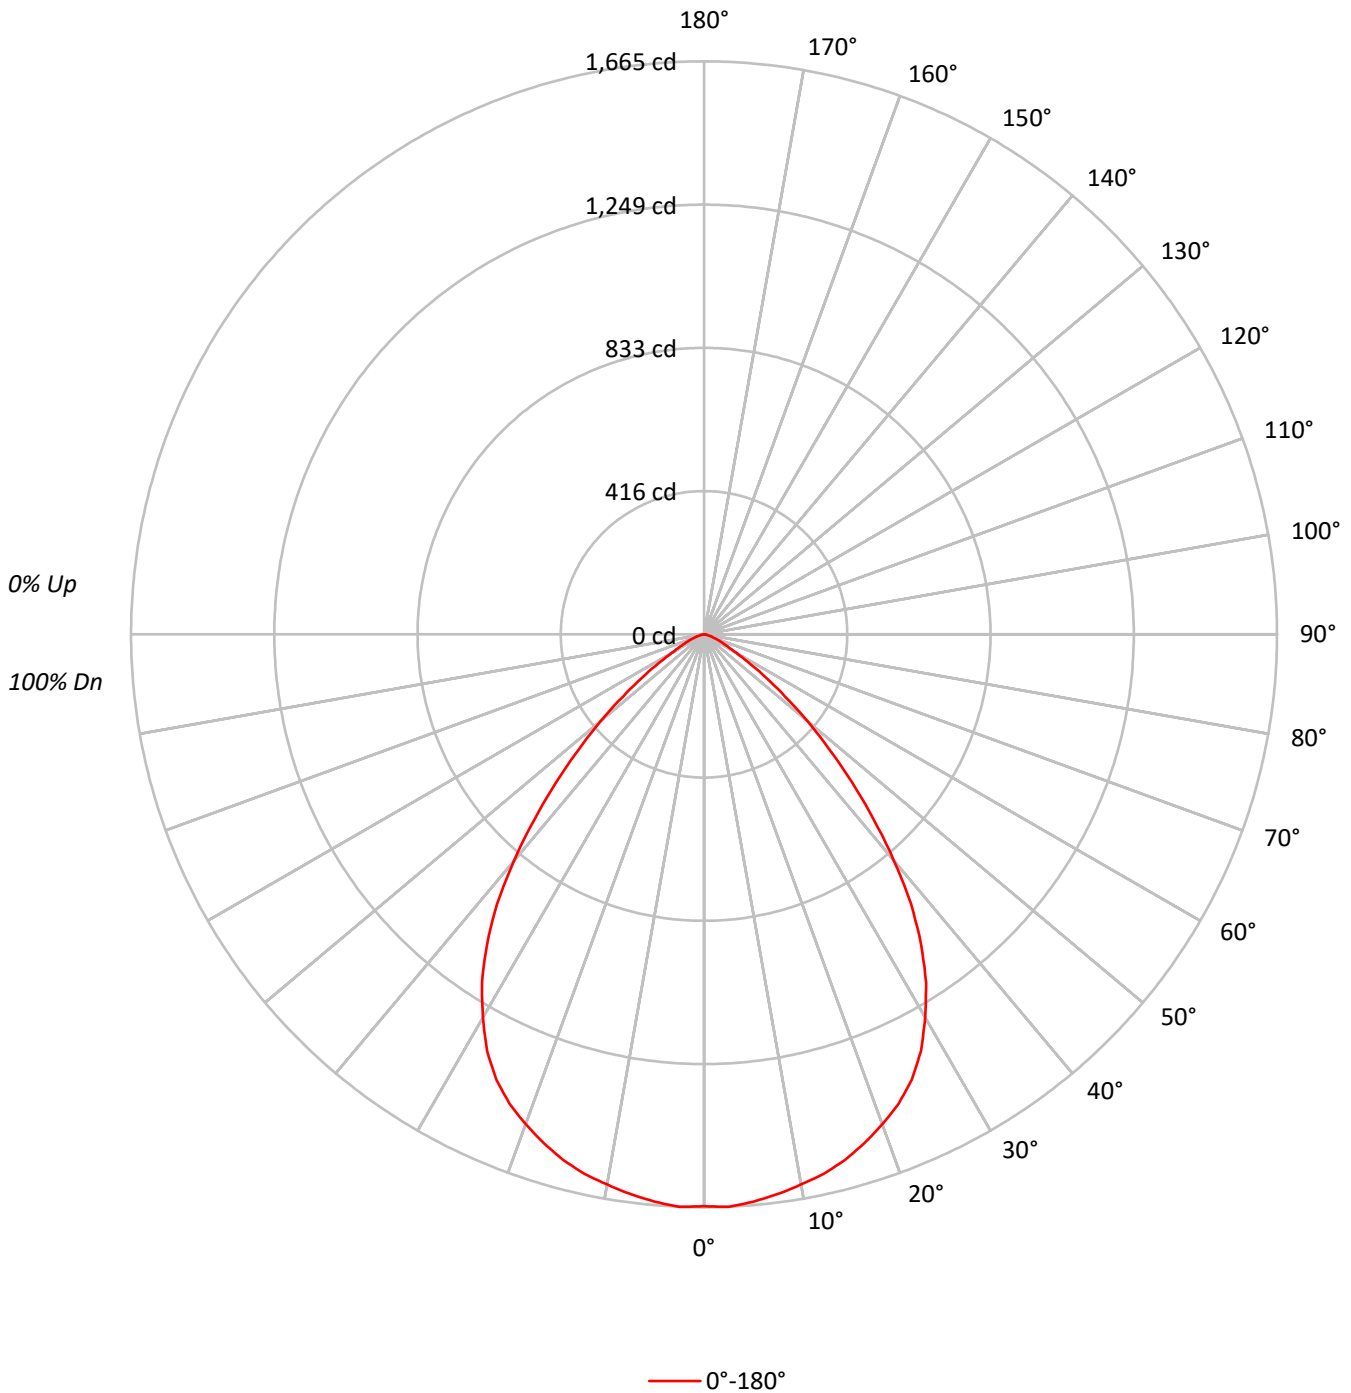



TEST NUMBER: P204623
 CATALOG NUMBER: MRI-DRV-FLD6C-30-L935 F6LC-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	91089
5°	91057
10°	90357
15°	89751
20°	88383
25°	86364
30°	81316
35°	73589
40°	61451
45°	47090
50°	33346
55°	21027
60°	11863
65°	7705
70°	5033
75°	3685
80°	2210
85°	2201



TEST NUMBER: P204623
 CATALOG NUMBER: MRI-DRV-FLD6C-30-L935 F6LC-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.9	5.8
10°-20°	445.3	16.5
20°-30°	652.9	24.2
30°-40°	679.5	25.2
40°-50°	470.2	17.5
50°-60°	204.7	7.6
60°-70°	62.8	2.3
70°-80°	18.8	0.7
80°-90°	2.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1255.2	46.6
0°-40°	1934.7	71.8
0°-60°	2609.6	96.9
0°-90°	2694.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2694.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1662	
5°	1655	157
15°	1581	445
25°	1428	653
35°	1100	680
45°	607	470
55°	220	205
65°	59	63
75°	17	19
85°	4	3
90°	0	



TEST NUMBER: P204623
CATALOG NUMBER: MRI-DRV-FLD6C-30-L935 F6LC-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1661.6
2.5°	1665.1
5°	1654.7
7.5°	1640.7
10°	1623.2
12.5°	1605.7
15°	1581.4
17.5°	1549.9
20°	1515.0
22.5°	1476.6
25°	1427.8
27.5°	1364.9
30°	1284.6
32.5°	1200.8
35°	1099.6
37.5°	988.0
40°	858.7
42.5°	729.6
45°	607.4
47.5°	492.2
50°	391.0
52.5°	296.8
55°	220.0
57.5°	157.1
60°	108.2
62.5°	80.3
65°	59.4
67.5°	45.4
70°	31.4
72.5°	24.5
75°	17.4
77.5°	10.4
80°	7.0
82.5°	3.5
85°	3.5
87.5°	0.0
90°	0.0

(END OF REPORT)