

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204743

Luminaire Tested: **MRI-DRV-FLD6C-30-L950 F6LC-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204743
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-30-L950 F6LC-W-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 5000K, 90 CRI
LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2753.0 lumens
Efficiency: N/A
Efficacy: 87.1 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204743
CATALOG NUMBER: MRI-DRV-FLD6C-30-L950 F6LC-W-X-H

Luminous Intensity Polar Plot

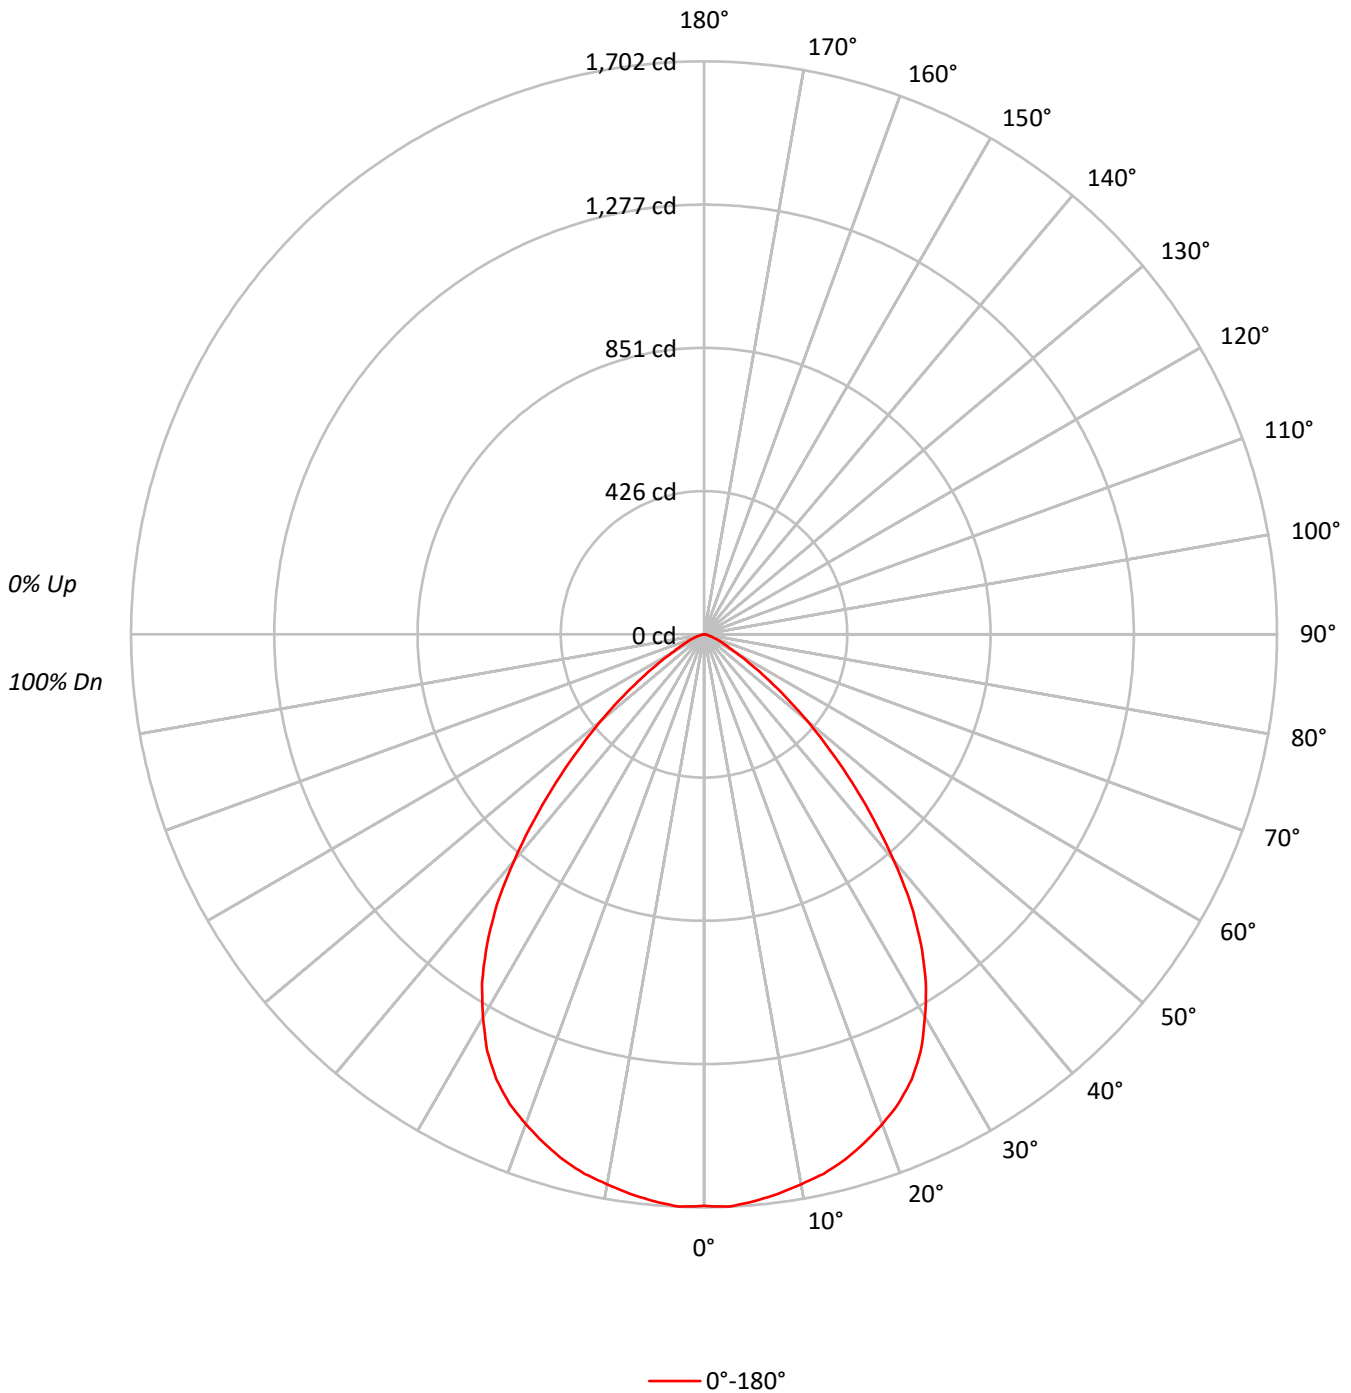



TEST NUMBER: P204743
 CATALOG NUMBER: MRI-DRV-FLD6C-30-L950 F6LC-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91			91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81			81
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73			73
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65			65
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59			59
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53			53
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49			49
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44			44
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41			41
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38			38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	93079
5°	93050
10°	92333
15°	91714
20°	90320
25°	88251
30°	83095
35°	75201
40°	62796
45°	48121
50°	34080
55°	21485
60°	12115
65°	7874
70°	5145
75°	3770
80°	2273
85°	2264



TEST NUMBER: P204743
 CATALOG NUMBER: MRI-DRV-FLD6C-30-L950 F6LC-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	160.4	5.8
10°-20°	455.1	16.5
20°-30°	667.2	24.2
30°-40°	694.4	25.2
40°-50°	480.4	17.5
50°-60°	209.2	7.6
60°-70°	64.2	2.3
70°-80°	19.2	0.7
80°-90°	2.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1282.6	46.6
0°-40°	1977.1	71.8
0°-60°	2666.7	96.9
0°-90°	2753.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2753.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1698	
5°	1691	160
15°	1616	455
25°	1459	667
35°	1124	694
45°	621	480
55°	225	209
65°	61	64
75°	18	19
85°	4	3
90°	0	



TEST NUMBER: P204743
CATALOG NUMBER: MRI-DRV-FLD6C-30-L950 F6LC-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1697.9
2.5°	1701.5
5°	1690.9
7.5°	1676.7
10°	1658.7
12.5°	1640.9
15°	1616.0
17.5°	1583.8
20°	1548.2
22.5°	1508.9
25°	1459.0
27.5°	1394.8
30°	1312.7
32.5°	1227.1
35°	1123.7
37.5°	1009.6
40°	877.5
42.5°	745.6
45°	620.7
47.5°	502.9
50°	399.6
52.5°	303.3
55°	224.8
57.5°	160.5
60°	110.5
62.5°	82.1
65°	60.7
67.5°	46.4
70°	32.1
72.5°	25.0
75°	17.8
77.5°	10.6
80°	7.2
82.5°	3.6
85°	3.6
87.5°	0.0
90°	0.0

(END OF REPORT)