

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions  
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204783

Luminaire Tested: **MRI-DRV-FLD6C-35-L927 F6LC-N-X-H**

Issue Date: 08/03/2023



**Test Information**


Test Method: LM-79-08  
Report Number: P204783  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 08/03/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: MRI-DRV-FLD6C-35-L927 F6LC-N-X-H  
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI  
LEDS, 6LBNH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2144.0 lumens  
Efficiency: N/A  
Efficacy: 53.1 lumens/watt  
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 40.4  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P204783  
CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-N-X-H

### Luminous Intensity Polar Plot

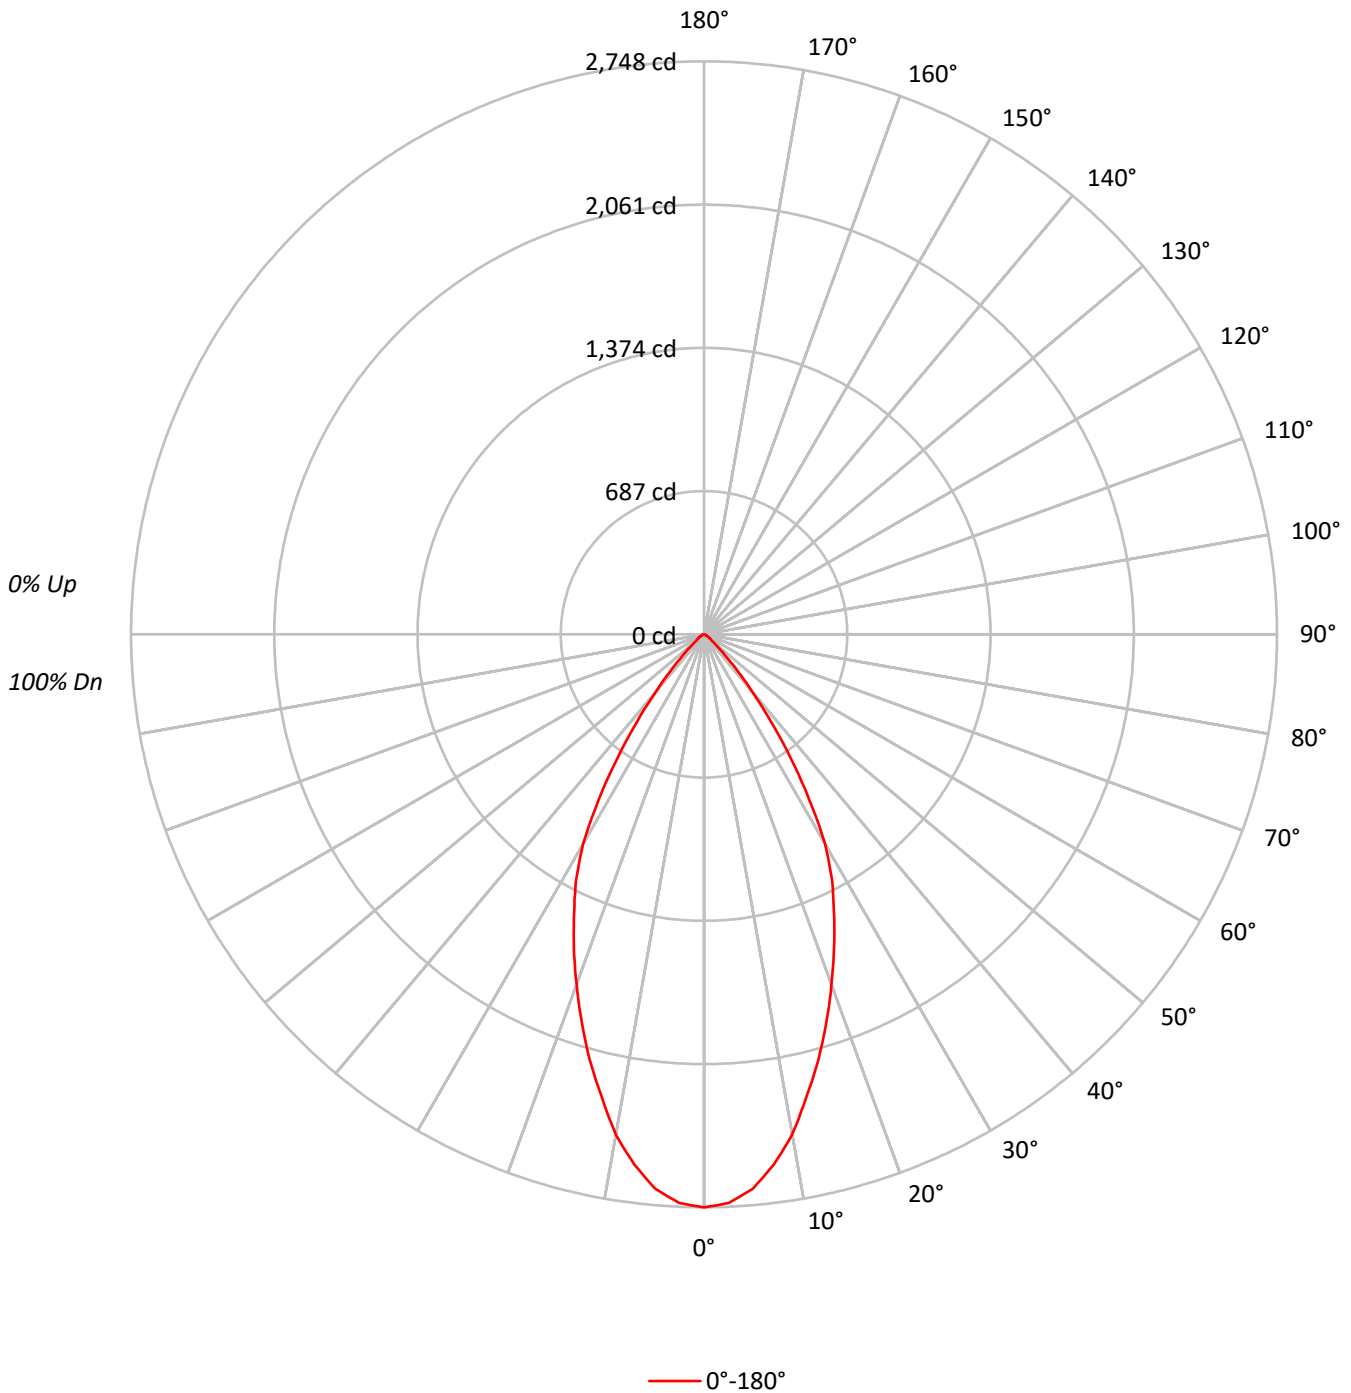



TEST NUMBER: P204783  
 CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-N-X-H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93	93	93	93
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87	87	87	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81	81	81	81
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75	75	75	75
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70	70	70	70
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65	65	65	65
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61	61	61	61
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58	58	58	58
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54	54	54	54
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51	51	51	51

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	150668
5°	146940
10°	135580
15°	120035
20°	104227
25°	89146
30°	73499
35°	48399
40°	26020
45°	11521
50°	4674
55°	3364
60°	2138
65°	1531
70°	1266
75°	826
80°	1231
85°	0



TEST NUMBER: P204783  
 CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-N-X-H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	247.2	11.5
10°-20°	589.4	27.5
20°-30°	675.2	31.5
30°-40°	453.6	21.2
40°-50°	129.6	6.0
50°-60°	31.7	1.5
60°-70°	12.1	0.6
70°-80°	4.6	0.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1511.7	70.5
0°-40°	1965.4	91.7
0°-60°	2126.7	99.2
0°-90°	2144.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2144.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2748	
5°	2670	247
15°	2115	589
25°	1474	675
35°	723	454
45°	149	130
55°	35	32
65°	12	12
75°	4	5
85°	0	1
90°	0	



TEST NUMBER: P204783  
CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-N-X-H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2748.4
2.5°	2728.9
5°	2670.2
7.5°	2564.6
10°	2435.6
12.5°	2271.3
15°	2115.0
17.5°	1950.9
20°	1786.6
22.5°	1630.3
25°	1473.8
27.5°	1329.2
30°	1161.1
32.5°	938.2
35°	723.2
37.5°	527.7
40°	363.6
42.5°	238.5
45°	148.6
47.5°	89.9
50°	54.8
52.5°	43.0
55°	35.2
57.5°	27.4
60°	19.5
62.5°	15.6
65°	11.8
67.5°	7.9
70°	7.9
72.5°	3.9
75°	3.9
77.5°	3.9
80°	3.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)