

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204853

Luminaire Tested: **MRI-DRV-FLD6C-35-L930 F6LC-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204853
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-35-L930 F6LC-N-X-LI
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3000K, 90 CRI
LEDS, 6LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2818.0 lumens
Efficiency: N/A
Efficacy: 69.8 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204853
CATALOG NUMBER: MRI-DRV-FLD6C-35-L930 F6LC-N-X-LI

Luminous Intensity Polar Plot

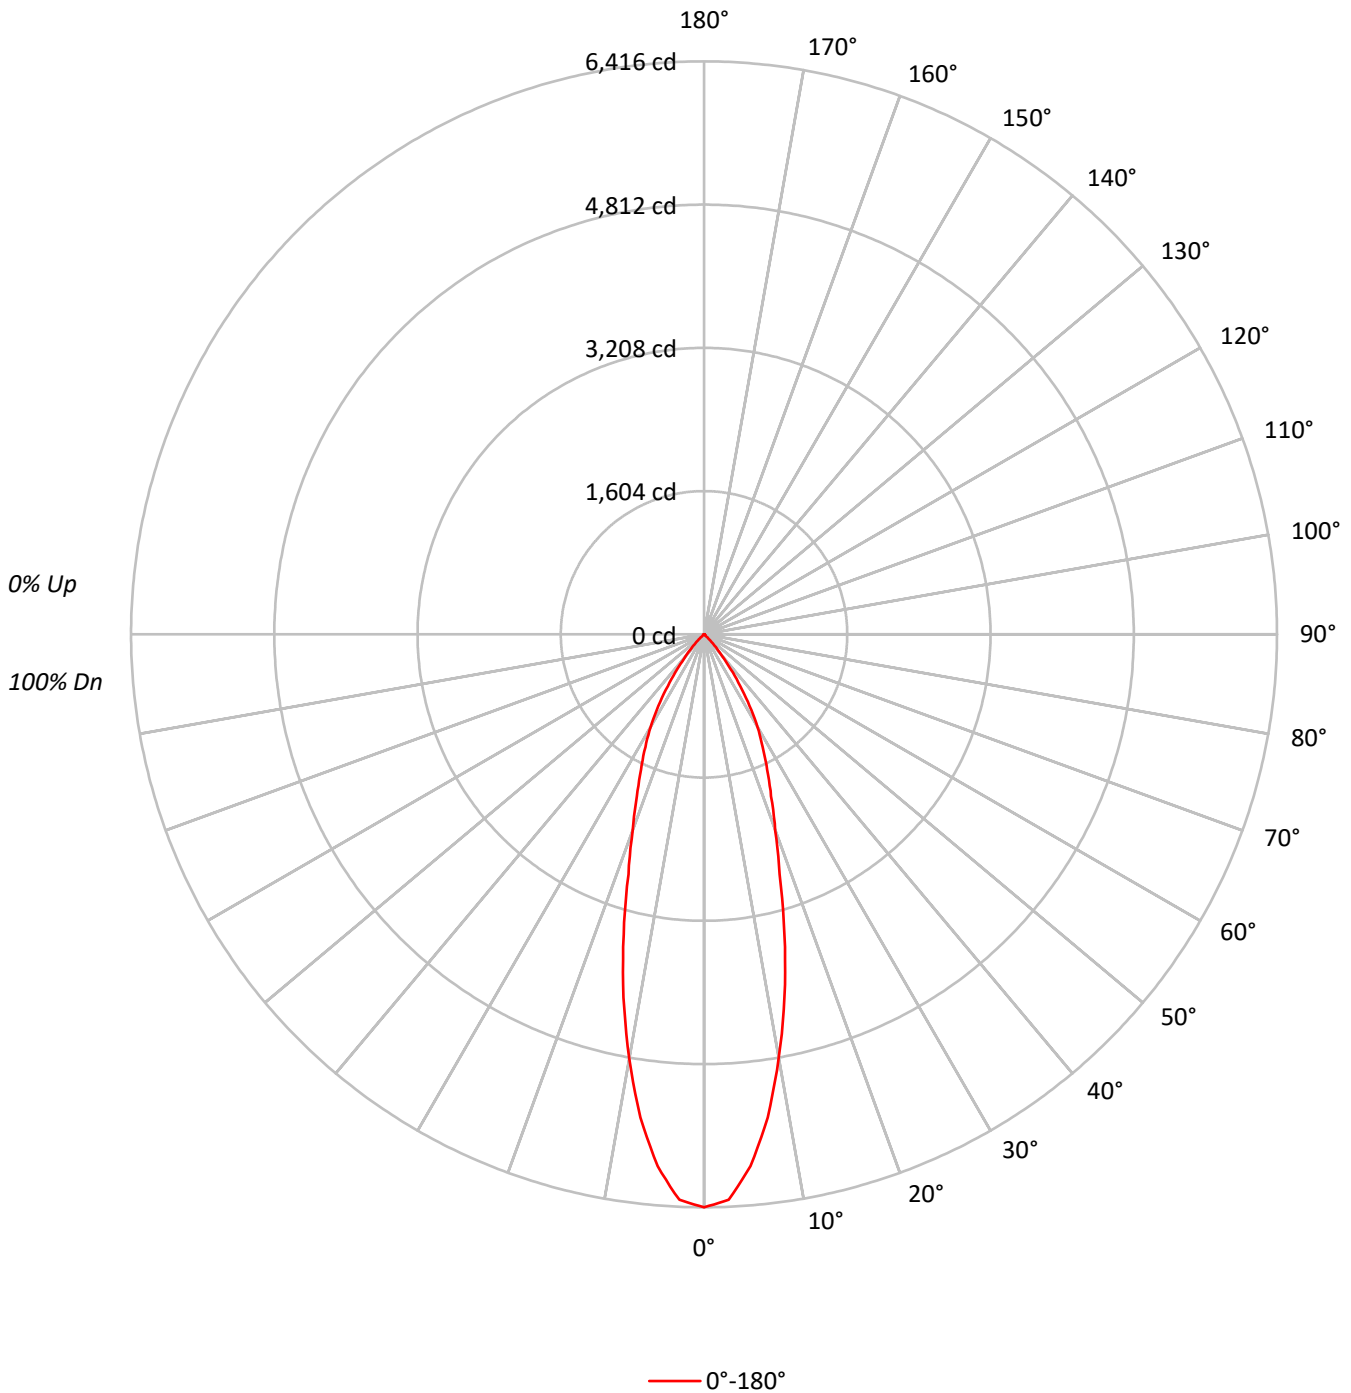



TEST NUMBER: P204853

CATALOG NUMBER: MRI-DRV-FLD6C-35-L930 F6LC-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	95	95	95	95
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	89	89	89	89
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	85	85	85	85
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	80	80	80	80
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	76	76	76	76
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	72	72	72	72
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	68	68	68	68
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	65	65	65	65
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	62	62	62	62
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	59	59	59	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	351721
5°	328917
10°	268259
15°	197402
20°	136063
25°	101014
30°	75872
35°	47315
40°	22964
45°	7877
50°	1032
55°	784
60°	450
65°	532
70°	657
75°	0
80°	0
85°	0



TEST NUMBER: P204853
 CATALOG NUMBER: MRI-DRV-FLD6C-35-L930 F6LC-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	533.4	18.9
10°-20°	957.5	34.0
20°-30°	774.1	27.5
30°-40°	445.9	15.8
40°-50°	94.3	3.3
50°-60°	8.1	0.3
60°-70°	4.1	0.1
70°-80°	0.5	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2265.0	80.4
0°-40°	2711.0	96.2
0°-60°	2813.4	99.8
0°-90°	2818.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2818.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6416	
5°	5977	533
15°	3478	957
25°	1670	774
35°	707	446
45°	102	94
55°	8	8
65°	4	4
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P204853
CATALOG NUMBER: MRI-DRV-FLD6C-35-L930 F6LC-N-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	6415.9
2.5°	6338.8
5°	5977.1
7.5°	5457.0
10°	4819.1
12.5°	4164.9
15°	3478.2
17.5°	2815.9
20°	2332.3
22.5°	1962.6
25°	1670.0
27.5°	1422.2
30°	1198.6
32.5°	950.9
35°	707.0
37.5°	491.6
40°	320.9
42.5°	195.1
45°	101.6
47.5°	40.6
50°	12.1
52.5°	12.1
55°	8.2
57.5°	8.2
60°	4.1
62.5°	4.1
65°	4.1
67.5°	4.1
70°	4.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)