

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P205163

Luminaire Tested: **MRI-DRV-FLD6C-40-L930 F6LC-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P205163
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-40-L930 F6LC-W-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3000K, 90 CRI
LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3639.0 lumens
Efficiency: N/A
Efficacy: 77.4 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P205163
CATALOG NUMBER: MRI-DRV-FLD6C-40-L930 F6LC-W-X-H

Luminous Intensity Polar Plot

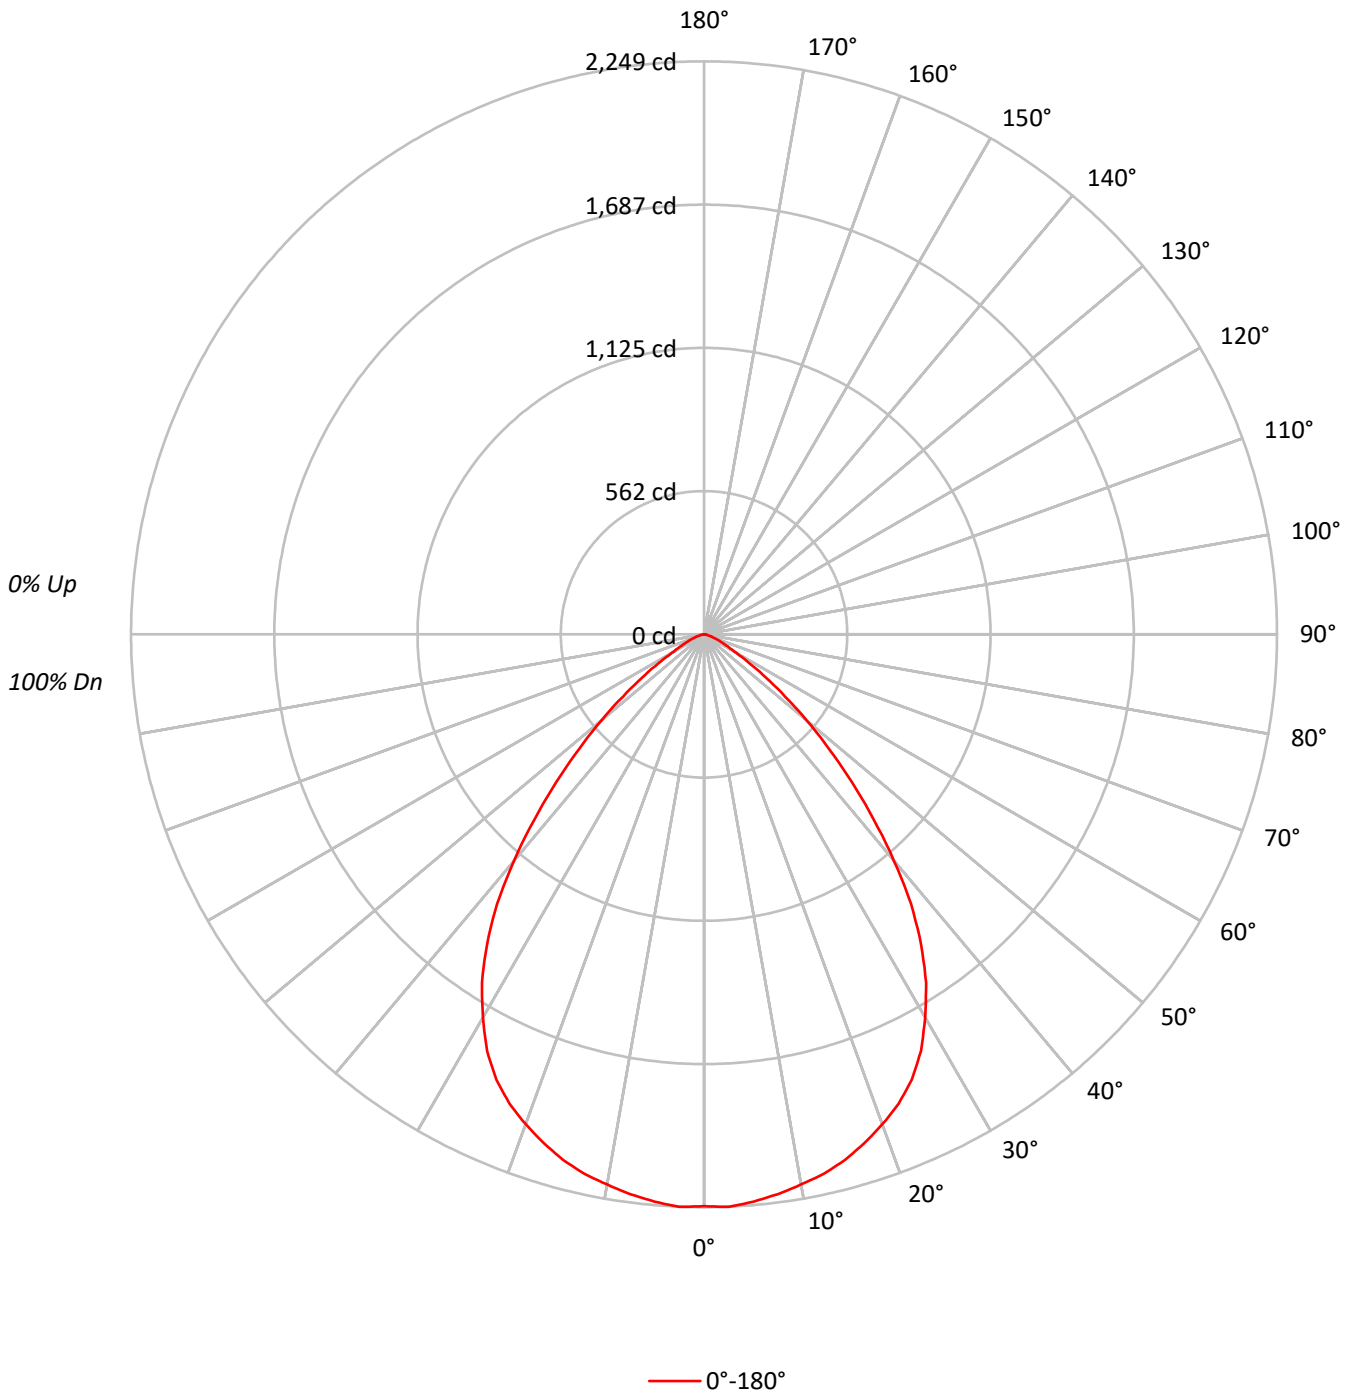



TEST NUMBER: P205163
 CATALOG NUMBER: MRI-DRV-FLD6C-40-L930 F6LC-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91	91	91	91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81	81	81	81
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73	73	73	73
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65	65	65	65
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59	59	59	59
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53	53	53	53
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49	49	49	49
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44	44	44	44
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41	41	41	41
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38	38	38	38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	123038
5°	122997
10°	122047
15°	121232
20°	119384
25°	116656
30°	109840
35°	99408
40°	83006
45°	63604
50°	45048
55°	28396
60°	16018
65°	10403
70°	6796
75°	4999
80°	2999
85°	2956



TEST NUMBER: P205163
 CATALOG NUMBER: MRI-DRV-FLD6C-40-L930 F6LC-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	212.0	5.8
10°-20°	601.5	16.5
20°-30°	882.0	24.2
30°-40°	917.9	25.2
40°-50°	635.1	17.5
50°-60°	276.5	7.6
60°-70°	84.8	2.3
70°-80°	25.5	0.7
80°-90°	3.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1695.5	46.6
0°-40°	2613.4	71.8
0°-60°	3524.9	96.9
0°-90°	3639.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3639.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2244	
5°	2235	212
15°	2136	602
25°	1929	882
35°	1485	918
45°	820	635
55°	297	277
65°	80	85
75°	24	25
85°	5	4
90°	0	



TEST NUMBER: P205163
CATALOG NUMBER: MRI-DRV-FLD6C-40-L930 F6LC-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	2244.4
2.5°	2249.1
5°	2235.1
7.5°	2216.3
10°	2192.5
12.5°	2169.0
15°	2136.1
17.5°	2093.5
20°	2046.4
22.5°	1994.6
25°	1928.6
27.5°	1843.7
30°	1735.2
32.5°	1622.0
35°	1485.4
37.5°	1334.5
40°	1159.9
42.5°	985.5
45°	820.4
47.5°	664.8
50°	528.2
52.5°	400.9
55°	297.1
57.5°	212.2
60°	146.1
62.5°	108.5
65°	80.2
67.5°	61.4
70°	42.4
72.5°	33.1
75°	23.6
77.5°	14.1
80°	9.5
82.5°	4.7
85°	4.7
87.5°	0.0
90°	0.0

(END OF REPORT)