

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P205203

Luminaire Tested: **MRI-DRV-FLD6C-40-L935 F6LC-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P205203
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-40-L935 F6LC-N-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 6LBNH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2623.0 lumens
Efficiency: N/A
Efficacy: 55.8 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P205203
CATALOG NUMBER: MRI-DRV-FLD6C-40-L935 F6LC-N-X-H

Luminous Intensity Polar Plot

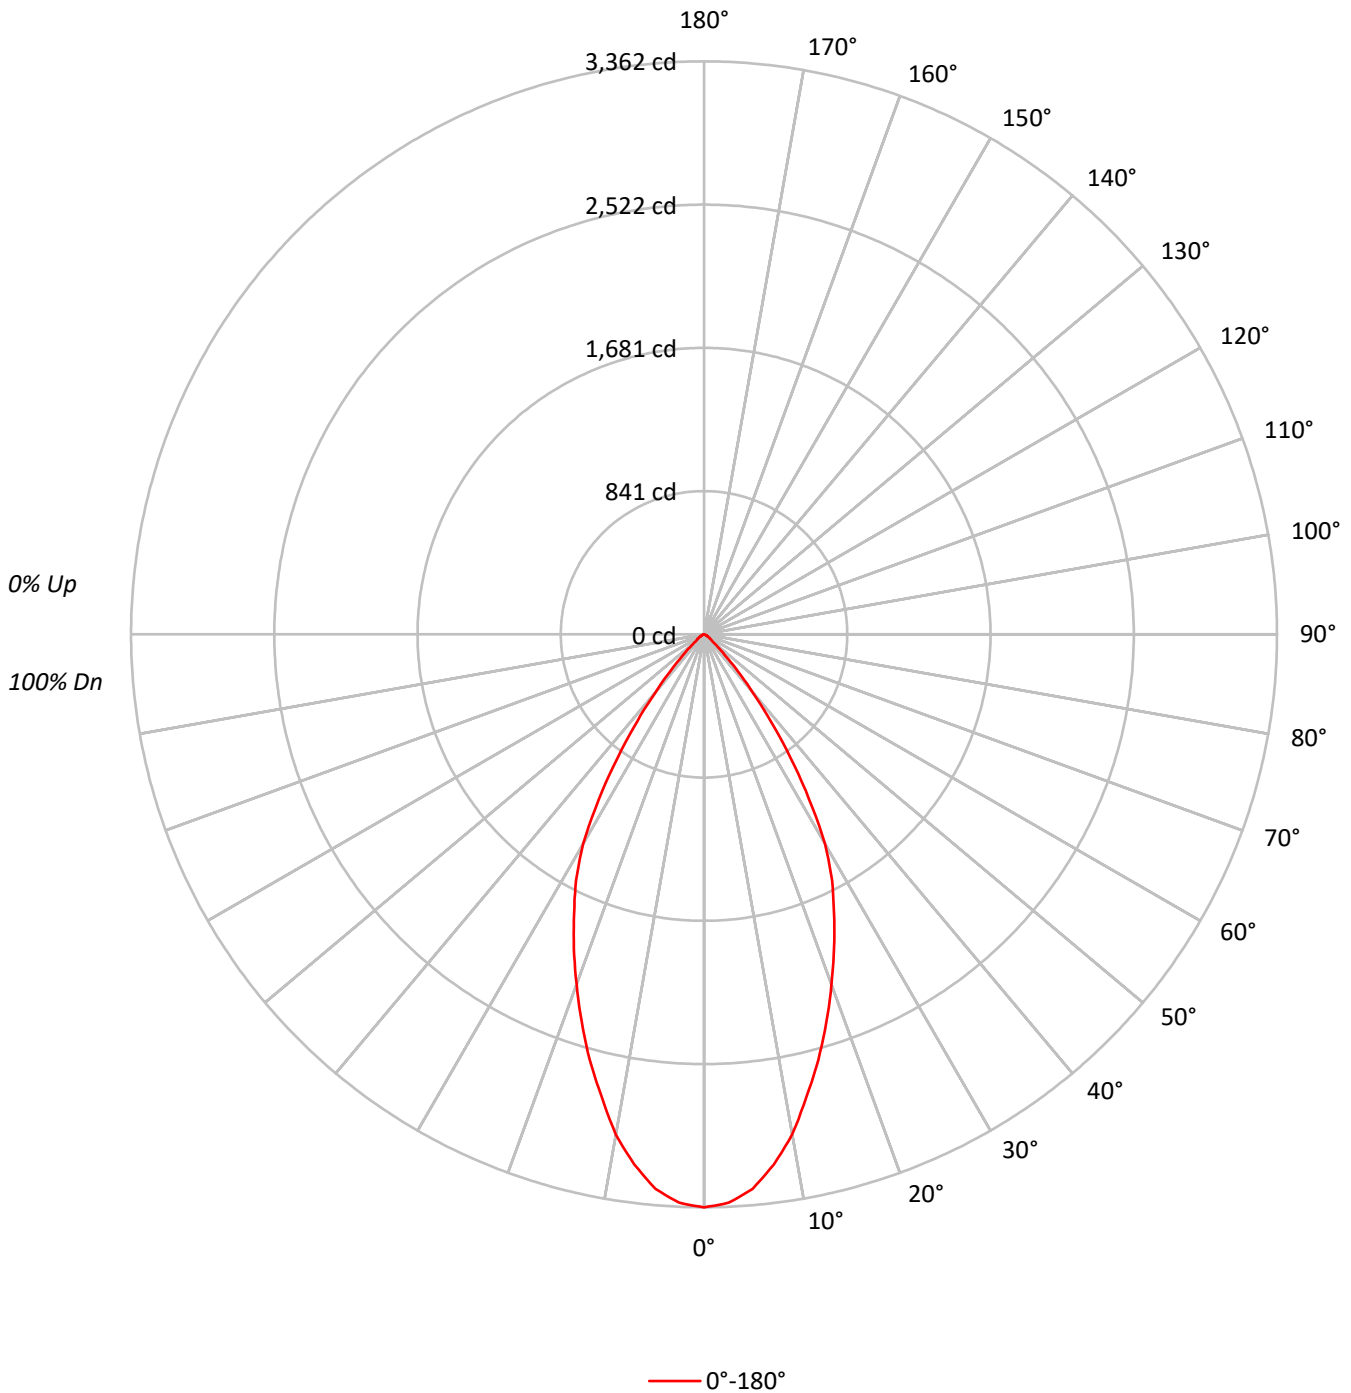



TEST NUMBER: P205203
 CATALOG NUMBER: MRI-DRV-FLD6C-40-L935 F6LC-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93	93	93	93
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87	87	87	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81	81	81	81
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75	75	75	75
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70	70	70	70
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65	65	65	65
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61	61	61	61
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58	58	58	58
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54	54	54	54
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51	51	51	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	184327
5°	179765
10°	165873
15°	146857
20°	127510
25°	109065
30°	89919
35°	59214
40°	31831
45°	14094
50°	5714
55°	4119
60°	2620
65°	1868
70°	1539
75°	1017
80°	1515
85°	0



TEST NUMBER: P205203
 CATALOG NUMBER: MRI-DRV-FLD6C-40-L935 F6LC-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	302.4	11.5
10°-20°	721.1	27.5
20°-30°	826.0	31.5
30°-40°	555.0	21.2
40°-50°	158.6	6.0
50°-60°	38.8	1.5
60°-70°	14.7	0.6
70°-80°	5.7	0.2
80°-90°	0.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1849.5	70.5
0°-40°	2404.5	91.7
0°-60°	2601.9	99.2
0°-90°	2623.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2623.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3362	
5°	3267	302
15°	2588	721
25°	1803	826
35°	885	555
45°	182	159
55°	43	39
65°	14	15
75°	5	6
85°	0	1
90°	0	



TEST NUMBER: P205203
CATALOG NUMBER: MRI-DRV-FLD6C-40-L935 F6LC-N-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	3362.4
2.5°	3338.5
5°	3266.7
7.5°	3137.5
10°	2979.8
12.5°	2778.8
15°	2587.6
17.5°	2386.7
20°	2185.7
22.5°	1994.5
25°	1803.1
27.5°	1626.1
30°	1420.5
32.5°	1147.8
35°	884.8
37.5°	645.6
40°	444.8
42.5°	291.7
45°	181.8
47.5°	110.0
50°	67.0
52.5°	52.6
55°	43.1
57.5°	33.5
60°	23.9
62.5°	19.1
65°	14.4
67.5°	9.6
70°	9.6
72.5°	4.8
75°	4.8
77.5°	4.8
80°	4.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)