

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P205243

Luminaire Tested: **MRI-DRV-FLD6C-40-L940 F6LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P205243
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203254)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-40-L940 F6LC-M-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 6LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3054.0 lumens
Efficiency: N/A
Efficacy: 65.0 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P205243
CATALOG NUMBER: MRI-DRV-FLD6C-40-L940 F6LC-M-X-H

Luminous Intensity Polar Plot

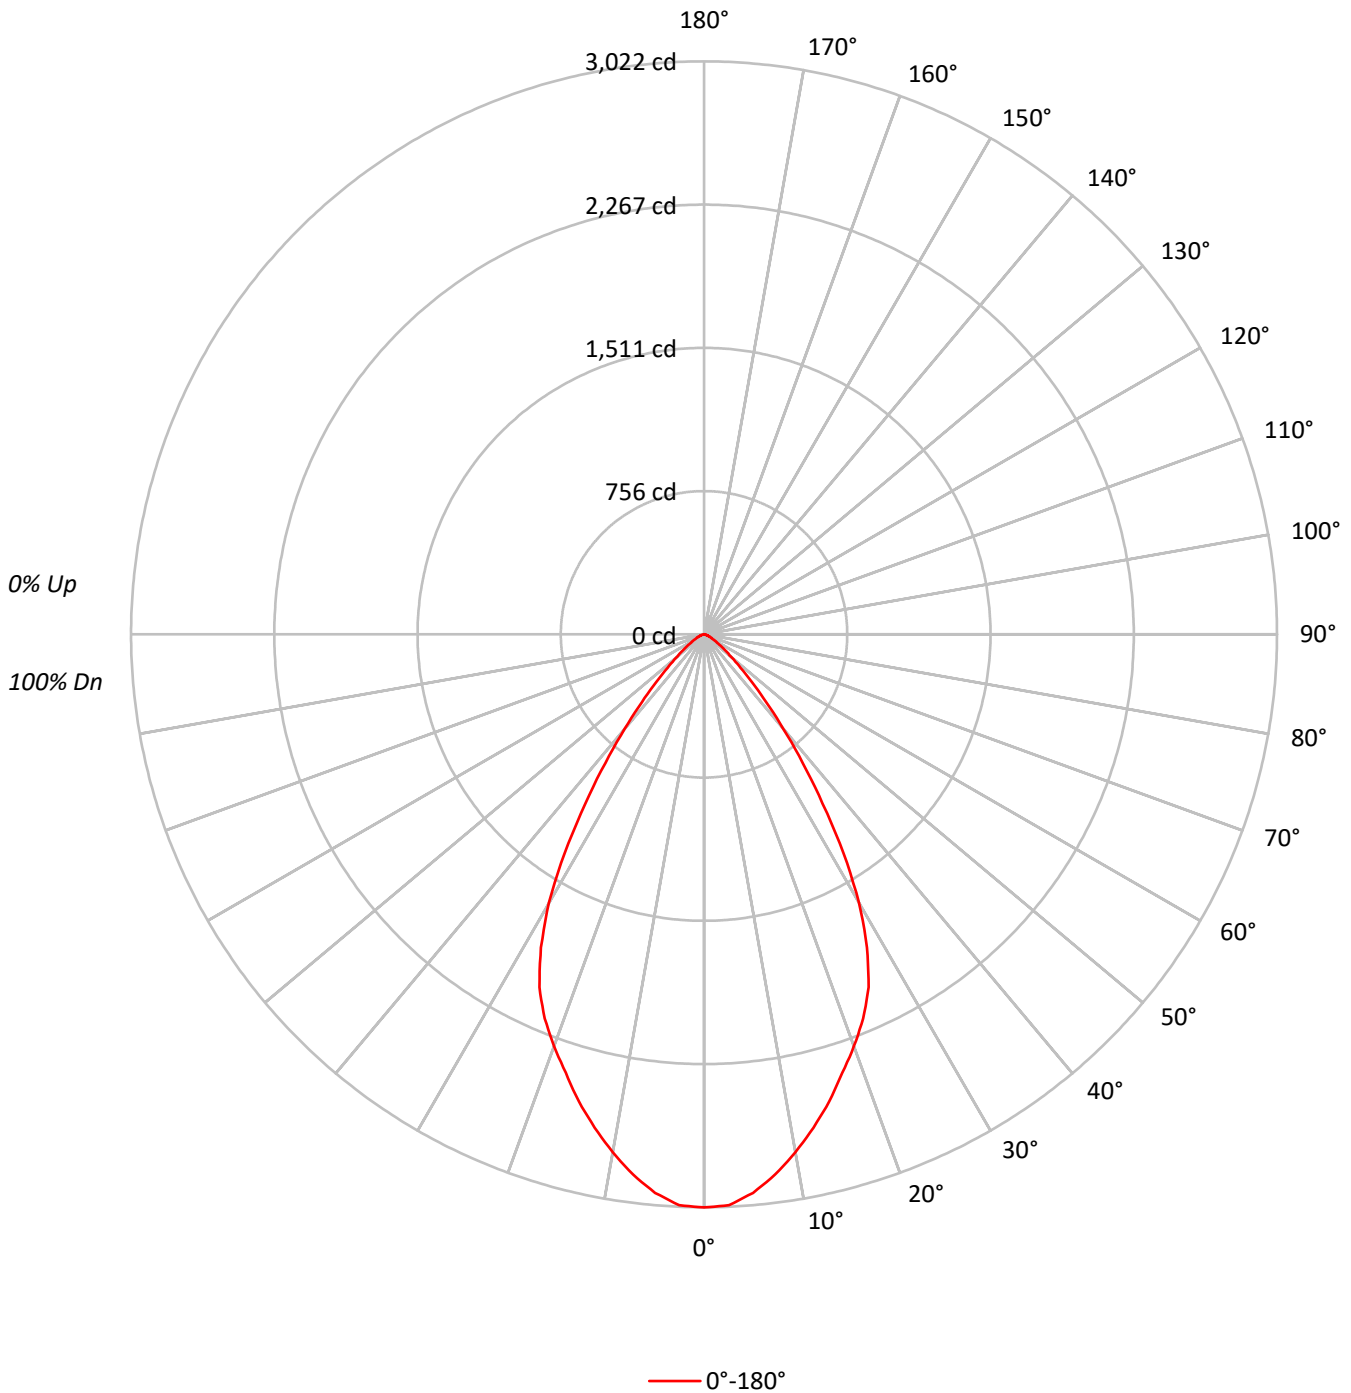



TEST NUMBER: P205243
 CATALOG NUMBER: MRI-DRV-FLD6C-40-L940 F6LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92			92
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	84	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72			72
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61			61
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			57
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53			53
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49			49
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46			46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	165688
5°	162722
10°	154406
15°	144797
20°	134849
25°	124247
30°	103529
35°	72966
40°	46501
45°	27732
50°	16366
55°	10418
60°	7170
65°	5085
70°	3510
75°	2775
80°	1357
85°	0



TEST NUMBER: P205243
 CATALOG NUMBER: MRI-DRV-FLD6C-40-L940 F6LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.3	9.0
10°-20°	714.9	23.4
20°-30°	926.3	30.3
30°-40°	687.7	22.5
40°-50°	290.3	9.5
50°-60°	103.1	3.4
60°-70°	39.8	1.3
70°-80°	13.8	0.5
80°-90°	1.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1917.6	62.8
0°-40°	2605.3	85.3
0°-60°	2998.7	98.2
0°-90°	3054.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3054.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3022	
5°	2957	276
15°	2551	715
25°	2054	926
35°	1090	688
45°	358	290
55°	109	103
65°	39	40
75°	13	14
85°	0	2
90°	0	



TEST NUMBER: P205243
CATALOG NUMBER: MRI-DRV-FLD6C-40-L940 F6LC-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	3022.4
2.5°	3013.6
5°	2957.0
7.5°	2874.0
10°	2773.8
12.5°	2664.7
15°	2551.3
17.5°	2424.9
20°	2311.5
22.5°	2193.7
25°	2054.1
27.5°	1862.2
30°	1635.5
32.5°	1369.4
35°	1090.3
37.5°	854.8
40°	649.8
42.5°	484.1
45°	357.7
47.5°	261.7
50°	191.9
52.5°	143.9
55°	109.0
57.5°	82.8
60°	65.4
62.5°	48.0
65°	39.2
67.5°	30.5
70°	21.9
72.5°	17.4
75°	13.1
77.5°	8.8
80°	4.3
82.5°	4.3
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)