

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P579889

Luminaire Tested: **HC415D010-HM40525840-41NDC**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P579889
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-1)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HC415D010-HM40525840-41NDC
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1518.2 lumens
Efficiency: N/A
Efficacy: 108.4 lumens/watt
Spacing Criteria (0/90/45): 0.84 / 0.84 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 14
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P579889

CATALOG NUMBER: HC415D010-HM40525840-41NDC

Luminous Intensity Polar Plot

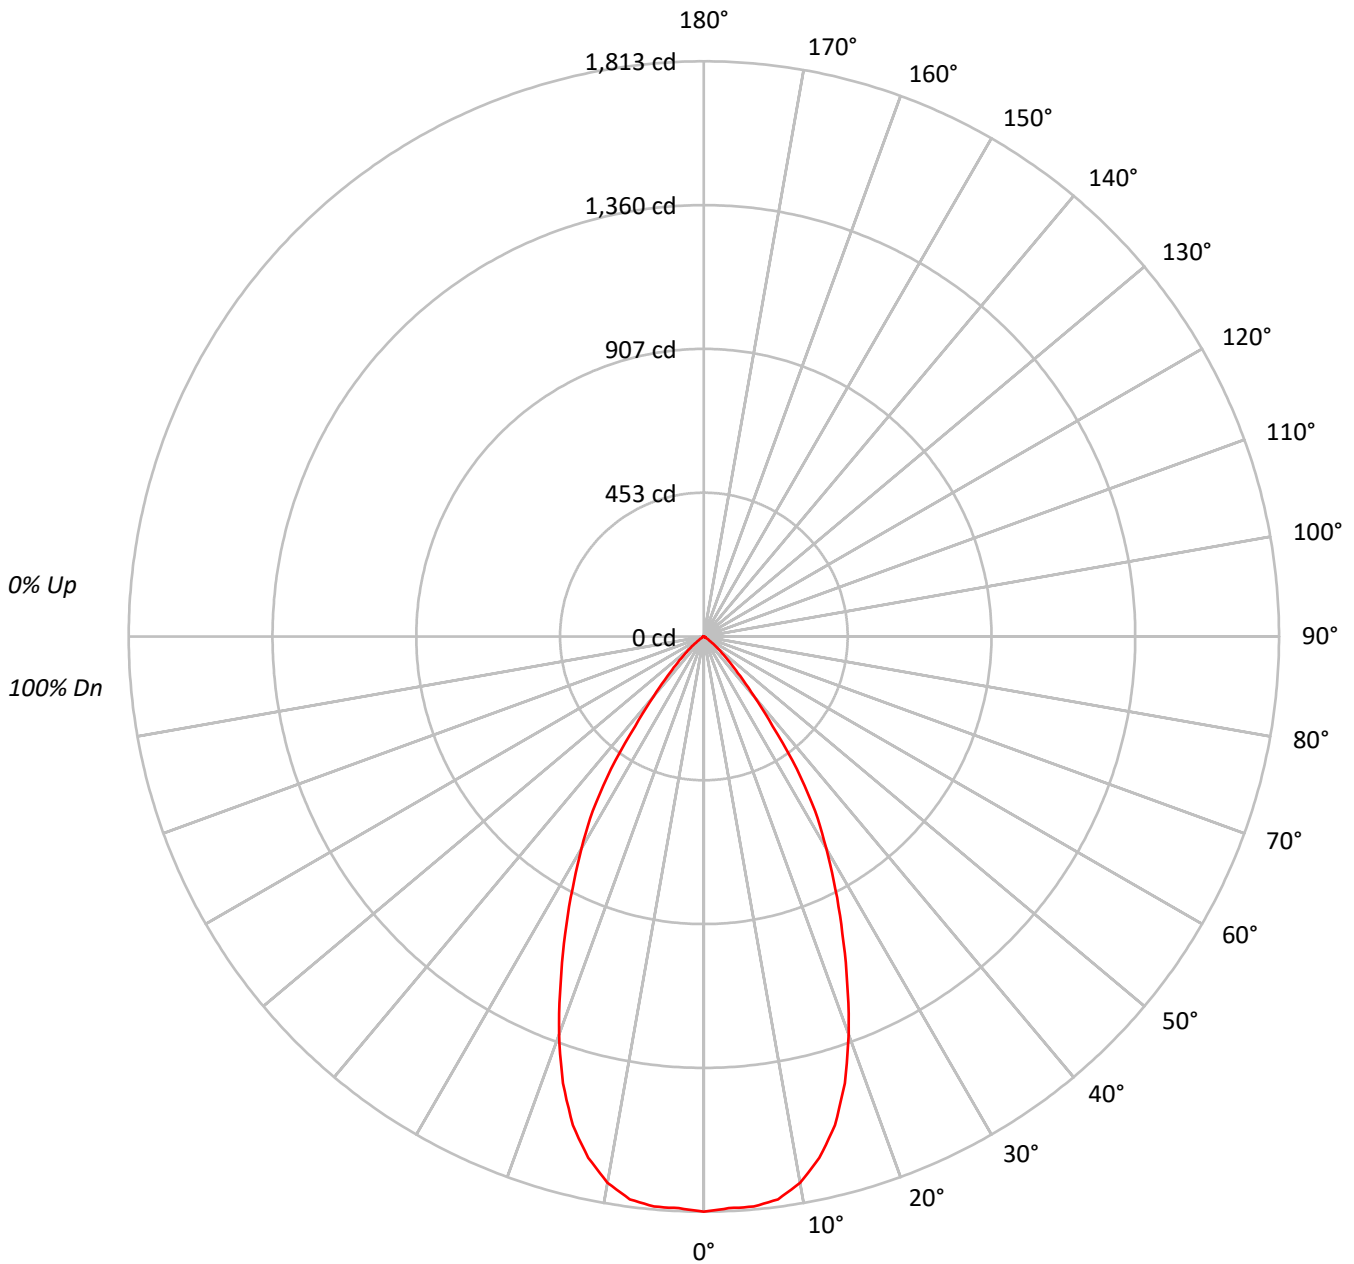



TEST NUMBER: P579889

CATALOG NUMBER: HC415D010-HM40525840-41NDC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 114 | 111 | 108 | 106 | 111 | 109 | 106 | 104 | 105 | 103 | 101 | 101 | 100 | 98 | 97 | 96 | 95 | 94 | | | |
| 2 | 108 | 103 | 99 | 96 | 106 | 101 | 98 | 95 | 98 | 95 | 93 | 95 | 93 | 91 | 93 | 91 | 89 | 87 | | | |
| 3 | 103 | 96 | 91 | 87 | 101 | 95 | 90 | 87 | 92 | 88 | 85 | 90 | 87 | 84 | 88 | 85 | 83 | 81 | | | |
| 4 | 97 | 90 | 85 | 80 | 96 | 89 | 84 | 80 | 87 | 82 | 79 | 85 | 81 | 78 | 83 | 80 | 77 | 76 | | | |
| 5 | 93 | 84 | 79 | 74 | 91 | 83 | 78 | 74 | 82 | 77 | 73 | 80 | 76 | 73 | 78 | 75 | 72 | 71 | | | |
| 6 | 88 | 79 | 73 | 69 | 87 | 78 | 73 | 69 | 77 | 72 | 68 | 76 | 71 | 68 | 74 | 70 | 67 | 66 | | | |
| 7 | 84 | 75 | 69 | 64 | 82 | 74 | 68 | 64 | 73 | 68 | 64 | 71 | 67 | 64 | 70 | 66 | 63 | 62 | | | |
| 8 | 80 | 70 | 64 | 60 | 78 | 70 | 64 | 60 | 69 | 64 | 60 | 68 | 63 | 60 | 67 | 62 | 59 | 58 | | | |
| 9 | 76 | 66 | 61 | 57 | 75 | 66 | 60 | 57 | 65 | 60 | 56 | 64 | 59 | 56 | 63 | 59 | 56 | 55 | | | |
| 10 | 72 | 63 | 57 | 53 | 71 | 62 | 57 | 53 | 62 | 57 | 53 | 61 | 56 | 53 | 60 | 56 | 53 | 52 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 223638 |
| 5° | 223328 |
| 10° | 218984 |
| 15° | 203625 |
| 20° | 175129 |
| 25° | 140670 |
| 30° | 109826 |
| 35° | 76885 |
| 40° | 39465 |
| 45° | 20025 |
| 50° | 10036 |
| 55° | 3742 |
| 60° | 1505 |
| 65° | 1197 |
| 70° | 721 |
| 75° | 477 |
| 80° | 710 |
| 85° | 0 |



TEST NUMBER: P579889

CATALOG NUMBER: HC415D010-HM40525840-41NDC

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 170.5 | 11.2 |
| 10°-20° | 440.2 | 29.0 |
| 20°-30° | 474.2 | 31.2 |
| 30°-40° | 311.5 | 20.5 |
| 40°-50° | 96.9 | 6.4 |
| 50°-60° | 19.0 | 1.3 |
| 60°-70° | 4.0 | 0.3 |
| 70°-80° | 1.4 | 0.1 |
| 80°-90° | 0.4 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1084.9 | 71.5 |
| 0°-40° | 1396.4 | 92.0 |
| 0°-60° | 1512.3 | 99.6 |
| 0°-90° | 1518.2 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1518.2 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1813 | |
| 5° | 1804 | 171 |
| 15° | 1595 | 440 |
| 25° | 1034 | 474 |
| 35° | 511 | 312 |
| 45° | 115 | 97 |
| 55° | 17 | 19 |
| 65° | 4 | 4 |
| 75° | 1 | 1 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P579889

CATALOG NUMBER: HC415D010-HM40525840-41NDC

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1813.1 |
| 2.5° | 1803.7 |
| 5° | 1803.7 |
| 7.5° | 1789.4 |
| 10° | 1748.4 |
| 12.5° | 1682.8 |
| 15° | 1594.6 |
| 17.5° | 1476.6 |
| 20° | 1334.2 |
| 22.5° | 1180.3 |
| 25° | 1033.6 |
| 27.5° | 897.3 |
| 30° | 771.1 |
| 32.5° | 652.2 |
| 35° | 510.6 |
| 37.5° | 355.9 |
| 40° | 245.1 |
| 42.5° | 169.2 |
| 45° | 114.8 |
| 47.5° | 77.9 |
| 50° | 52.3 |
| 52.5° | 32.9 |
| 55° | 17.4 |
| 57.5° | 7.2 |
| 60° | 6.1 |
| 62.5° | 5.1 |
| 65° | 4.1 |
| 67.5° | 3.1 |
| 70° | 2.0 |
| 72.5° | 2.0 |
| 75° | 1.0 |
| 77.5° | 1.0 |
| 80° | 1.0 |
| 82.5° | 1.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By 670245859 / DESKTOP-HRDQ47P





— 0°-180°







(END OF REPORT)