

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580602

Luminaire Tested: **HC4R40D010-HM43040840-42RMDC**

Issue Date: 9/23/2021

Test Information

Test Method: LM-41-14
Report Number: P580602
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-13)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/23/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HC4R40D010-HM43040840-42RMDC
Description: HALO COMMERCIAL 4" ROUND, RETROFIT FRAME, WITH 4" MEDIUM DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4423.7 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.02 / 1.02 / 0.96
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 41
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580602

CATALOG NUMBER: HC4R40D010-HM43040840-42RMDC

Luminous Intensity Polar Plot

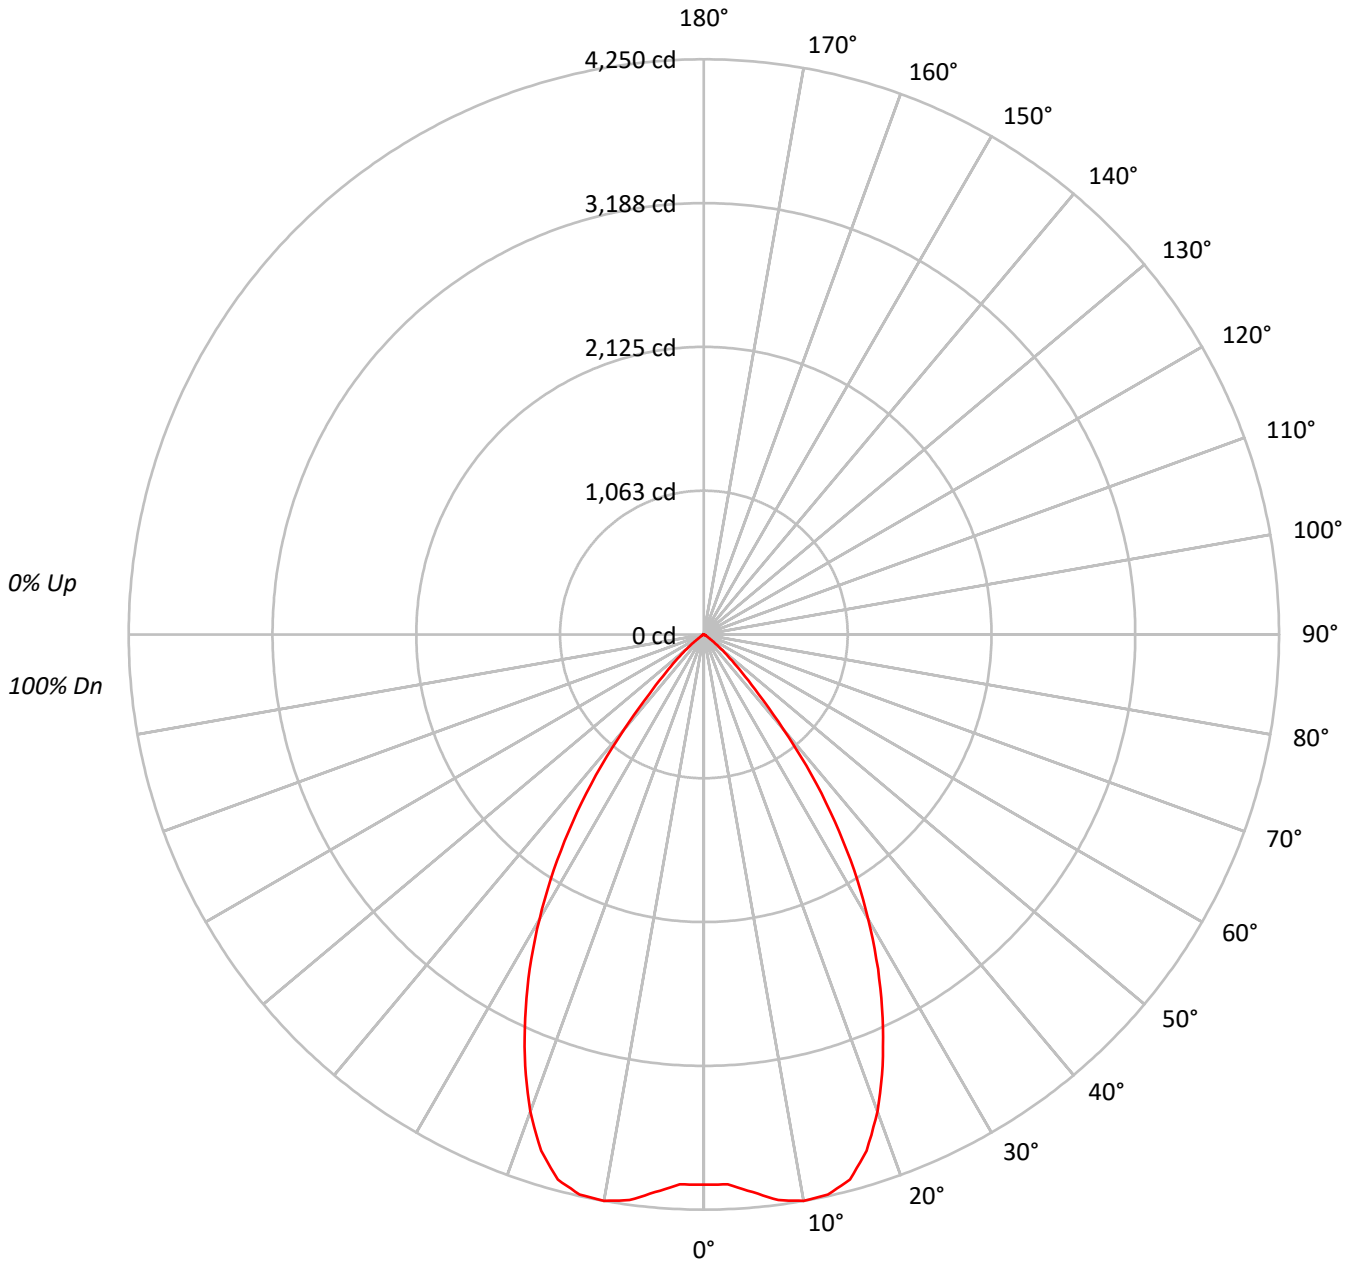



TEST NUMBER: P580602

CATALOG NUMBER: HC4R40D010-HM43040840-42RMDC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 113 | 111 | 108 | 106 | 111 | 108 | 106 | 104 | 104 | 103 | 101 | 101 | 99 | 98 | 97 | 96 | 95 | 93 | | | |
| 2 | 108 | 103 | 99 | 95 | 105 | 101 | 97 | 94 | 98 | 95 | 92 | 95 | 92 | 90 | 92 | 90 | 88 | 86 | | | |
| 3 | 102 | 95 | 90 | 86 | 100 | 94 | 89 | 86 | 91 | 87 | 84 | 89 | 86 | 83 | 87 | 84 | 82 | 80 | | | |
| 4 | 97 | 89 | 83 | 79 | 95 | 88 | 82 | 78 | 86 | 81 | 77 | 84 | 80 | 77 | 82 | 78 | 76 | 74 | | | |
| 5 | 92 | 83 | 77 | 73 | 90 | 82 | 76 | 72 | 80 | 75 | 72 | 78 | 74 | 71 | 77 | 73 | 70 | 69 | | | |
| 6 | 87 | 78 | 71 | 67 | 85 | 77 | 71 | 67 | 75 | 70 | 66 | 74 | 69 | 66 | 72 | 68 | 65 | 64 | | | |
| 7 | 82 | 73 | 66 | 62 | 81 | 72 | 66 | 62 | 71 | 65 | 62 | 69 | 65 | 61 | 68 | 64 | 61 | 60 | | | |
| 8 | 78 | 68 | 62 | 58 | 77 | 68 | 62 | 58 | 67 | 61 | 57 | 65 | 61 | 57 | 65 | 60 | 57 | 56 | | | |
| 9 | 74 | 64 | 58 | 54 | 73 | 64 | 58 | 54 | 63 | 57 | 54 | 62 | 57 | 54 | 61 | 57 | 53 | 52 | | | |
| 10 | 70 | 61 | 55 | 51 | 69 | 60 | 54 | 51 | 59 | 54 | 50 | 58 | 54 | 50 | 58 | 53 | 50 | 49 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 501314 |
| 5° | 512057 |
| 10° | 532256 |
| 15° | 532470 |
| 20° | 492297 |
| 25° | 425425 |
| 30° | 346098 |
| 35° | 254250 |
| 40° | 146960 |
| 45° | 68658 |
| 50° | 31758 |
| 55° | 11032 |
| 60° | 3503 |
| 65° | 2481 |
| 70° | 2056 |
| 75° | 1334 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P580602

CATALOG NUMBER: HC4R40D010-HM43040840-42RMDC

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 399.0 | 9.0 |
| 10°-20° | 1155.6 | 26.1 |
| 20°-30° | 1423.2 | 32.2 |
| 30°-40° | 1039.0 | 23.5 |
| 40°-50° | 338.6 | 7.7 |
| 50°-60° | 56.6 | 1.3 |
| 60°-70° | 8.8 | 0.2 |
| 70°-80° | 3.0 | 0.1 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 2977.8 | 67.3 |
| 0°-40° | 4016.8 | 90.8 |
| 0°-60° | 4412.0 | 99.7 |
| 0°-90° | 4423.7 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 4423.7 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 4064 | |
| 5° | 4136 | 399 |
| 15° | 4170 | 1156 |
| 25° | 3126 | 1423 |
| 35° | 1688 | 1039 |
| 45° | 394 | 339 |
| 55° | 51 | 57 |
| 65° | 8 | 9 |
| 75° | 3 | 3 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P580602

CATALOG NUMBER: HC4R40D010-HM43040840-42RMDC

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 4064.3 |
| 2.5° | 4067.1 |
| 5° | 4135.6 |
| 7.5° | 4215.4 |
| 10° | 4249.6 |
| 12.5° | 4238.3 |
| 15° | 4169.8 |
| 17.5° | 3998.7 |
| 20° | 3750.5 |
| 22.5° | 3451.1 |
| 25° | 3125.9 |
| 27.5° | 2786.5 |
| 30° | 2430.0 |
| 32.5° | 2064.9 |
| 35° | 1688.5 |
| 37.5° | 1309.1 |
| 40° | 912.7 |
| 42.5° | 596.0 |
| 45° | 393.6 |
| 47.5° | 259.5 |
| 50° | 165.5 |
| 52.5° | 97.0 |
| 55° | 51.3 |
| 57.5° | 20.0 |
| 60° | 14.2 |
| 62.5° | 11.4 |
| 65° | 8.5 |
| 67.5° | 5.7 |
| 70° | 5.7 |
| 72.5° | 2.8 |
| 75° | 2.8 |
| 77.5° | 2.8 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By 670245859 / DESKTOP-HRDQ47P





— 0°-180°







(END OF REPORT)