

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580618

Luminaire Tested: **HC440D010-HM43040927-41NDH**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P580618
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-2)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HC440D010-HM43040927-41NDH
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3013.5 lumens
Efficiency: N/A
Efficacy: 73.5 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.91
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 41
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580618

CATALOG NUMBER: HC440D010-HM43040927-41NDH

Luminous Intensity Polar Plot

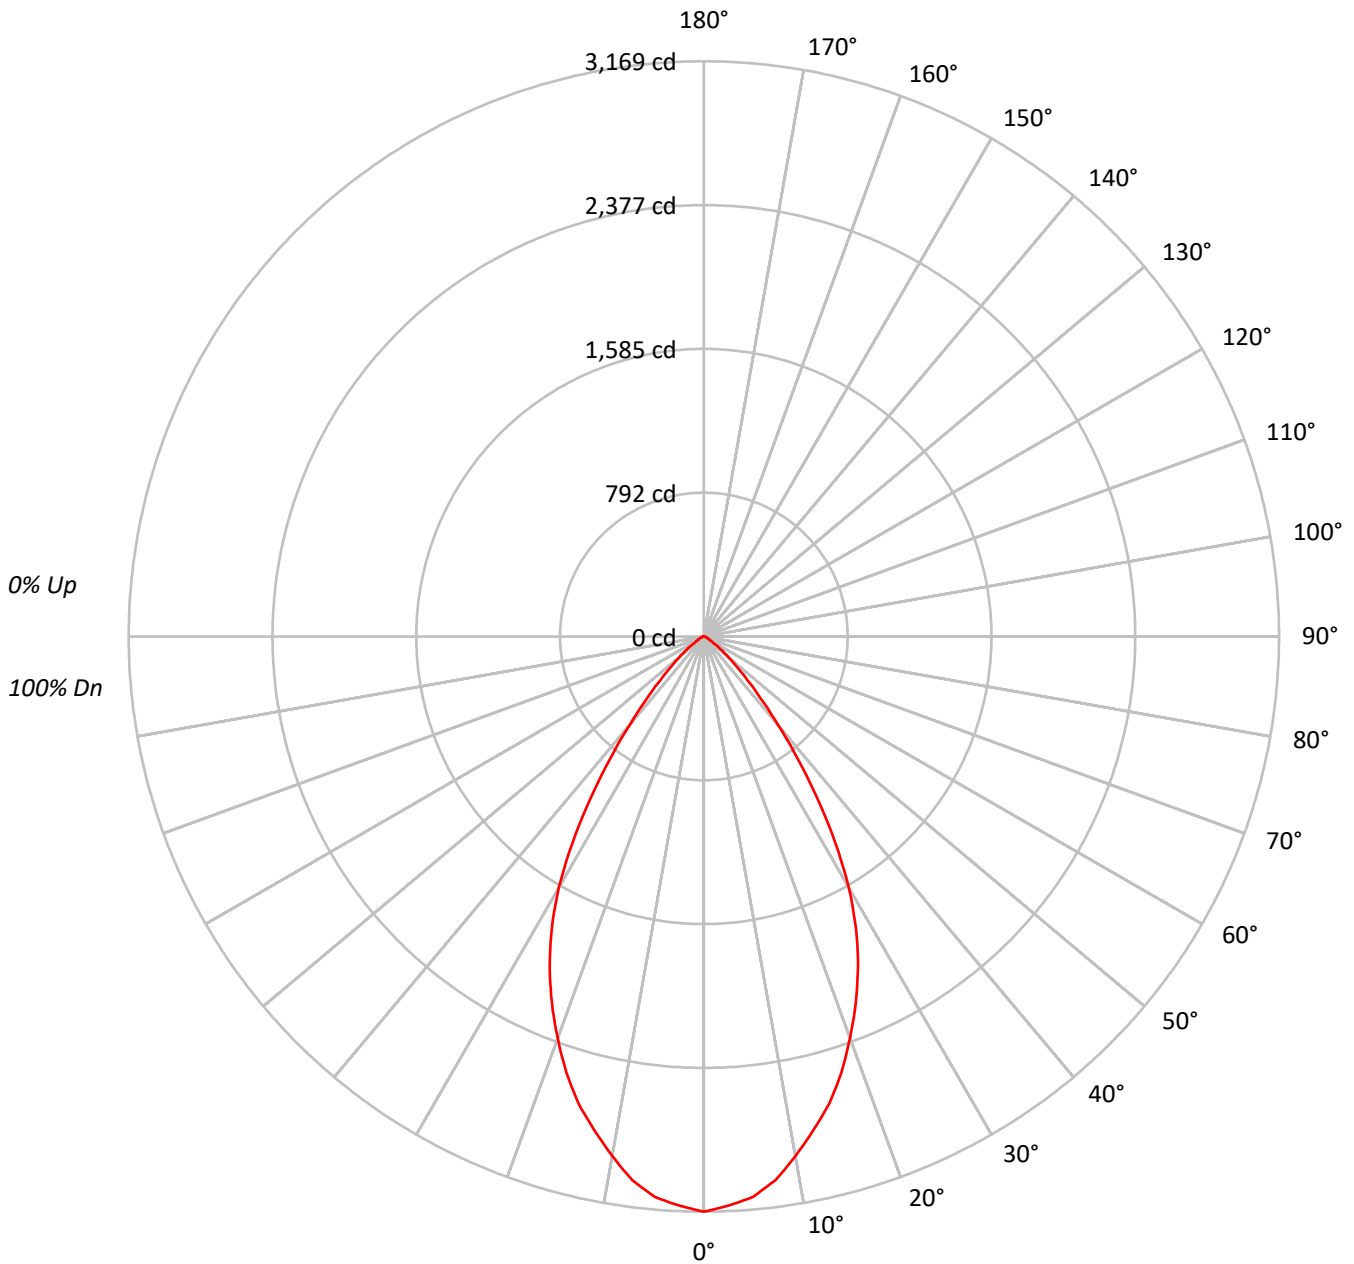



TEST NUMBER: P580618

CATALOG NUMBER: HC440D010-HM43040927-41NDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	86	86	86	86
3	101	95	89	85	99	93	88	84	91	86	83	88	85	82	86	83	81	79	79	79	79
4	96	88	82	78	94	87	81	77	85	80	76	82	79	75	81	77	74	73	73	73	73
5	91	82	76	71	89	81	75	71	79	74	70	77	73	70	76	72	69	67	67	67	67
6	86	76	70	66	84	76	70	65	74	69	65	73	68	64	71	67	64	63	63	63	63
7	81	72	65	61	80	71	65	61	70	64	60	68	64	60	67	63	60	58	58	58	58
8	77	67	61	57	76	67	61	56	65	60	56	64	59	56	63	59	56	54	54	54	54
9	73	63	57	53	72	63	57	53	62	56	52	61	56	52	60	55	52	51	51	51	51
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48	48	48	48

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	390858
5°	383745
10°	363997
15°	340350
20°	309108
25°	273527
30°	227513
35°	164069
40°	102390
45°	59047
50°	33312
55°	15870
60°	9103
65°	6975
70°	4688
75°	3098
80°	3125
85°	2972



TEST NUMBER: P580618

CATALOG NUMBER: HC440D010-HM43040927-41NDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	289.7	9.6
10°-20°	743.5	24.7
20°-30°	914.4	30.3
30°-40°	679.1	22.5
40°-50°	276.0	9.2
50°-60°	76.5	2.5
60°-70°	23.8	0.8
70°-80°	8.0	0.3
80°-90°	2.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1947.7	64.6
0°-40°	2626.8	87.2
0°-60°	2979.3	98.9
0°-90°	3013.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3013.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3169	
5°	3099	290
15°	2665	744
25°	2010	914
35°	1090	679
45°	338	276
55°	74	76
65°	24	24
75°	6	8
85°	2	2
90°	0	



TEST NUMBER: P580618

CATALOG NUMBER: HC440D010-HM43040927-41NDH

CANDELA DISTRIBUTION (FULL):

	0°
0°	3168.8
2.5°	3138.5
5°	3099.3
7.5°	3021.2
10°	2906.2
12.5°	2786.8
15°	2665.3
17.5°	2519.9
20°	2354.9
22.5°	2187.7
25°	2009.8
27.5°	1816.7
30°	1597.4
32.5°	1347.9
35°	1089.6
37.5°	846.5
40°	635.9
42.5°	464.4
45°	338.5
47.5°	243.0
50°	173.6
52.5°	119.4
55°	73.8
57.5°	47.8
60°	36.9
62.5°	30.4
65°	23.9
67.5°	17.4
70°	13.0
72.5°	10.9
75°	6.5
77.5°	4.4
80°	4.4
82.5°	2.1
85°	2.1
87.5°	2.1
90°	0.0



Report Generated By 670245859 / DESKTOP-HRDQ47P





— 0°-180°







(END OF REPORT)