

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581050

Luminaire Tested: **HC405D010-HM40525927-41NDH**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581050
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-2)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HC405D010-HM40525927-41NDH
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 474.0 lumens
Efficiency: N/A
Efficacy: 79.0 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.91
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581050

CATALOG NUMBER: HC405D010-HM40525927-41NDH

Luminous Intensity Polar Plot

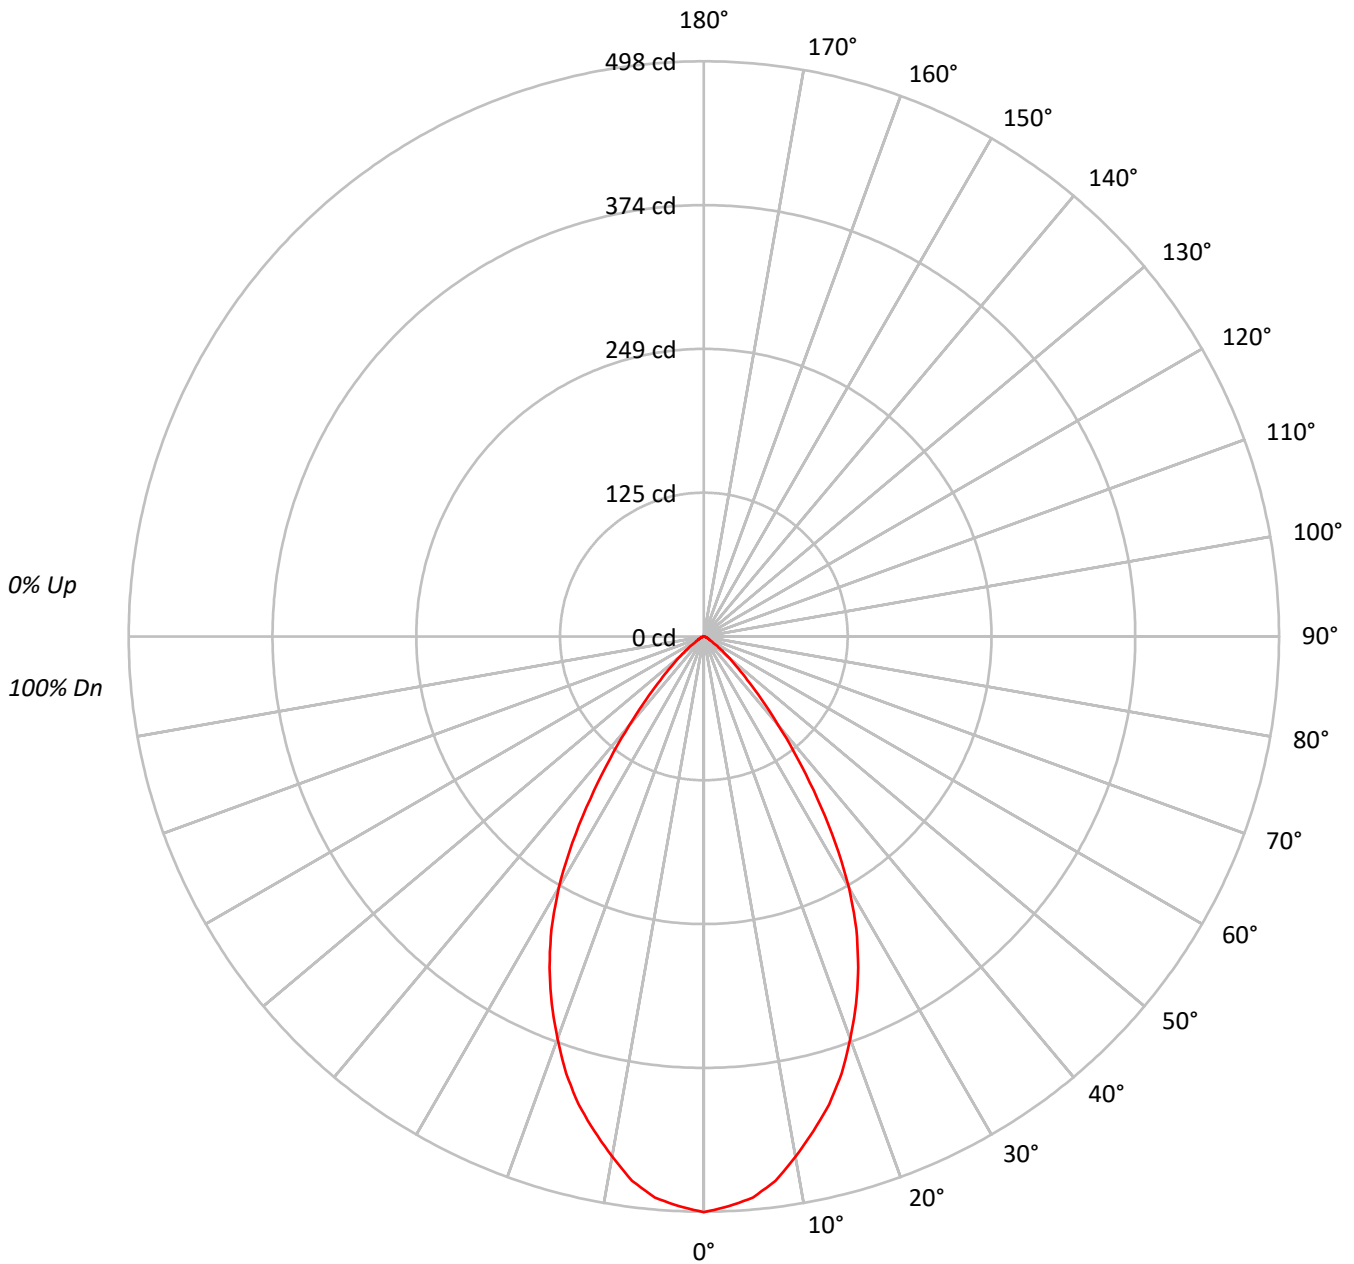



TEST NUMBER: P581050

CATALOG NUMBER: HC405D010-HM40525927-41NDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | 100 |
| 1 | 113 | 110 | 108 | 105 | 111 | 108 | 106 | 104 | 104 | 102 | 100 | 100 | 99 | 97 | 97 | 96 | 95 | 93 | | | 93 |
| 2 | 107 | 102 | 98 | 94 | 105 | 100 | 96 | 93 | 97 | 94 | 91 | 94 | 91 | 89 | 91 | 89 | 87 | 86 | | | 86 |
| 3 | 101 | 95 | 89 | 85 | 99 | 93 | 88 | 84 | 91 | 86 | 83 | 88 | 85 | 82 | 86 | 83 | 81 | 79 | | | 79 |
| 4 | 96 | 88 | 82 | 78 | 94 | 87 | 81 | 77 | 85 | 80 | 76 | 83 | 79 | 75 | 81 | 77 | 74 | 73 | | | 73 |
| 5 | 91 | 82 | 76 | 71 | 89 | 81 | 75 | 71 | 79 | 74 | 70 | 77 | 73 | 70 | 76 | 72 | 69 | 67 | | | 67 |
| 6 | 86 | 76 | 70 | 66 | 84 | 76 | 70 | 65 | 74 | 69 | 65 | 73 | 68 | 64 | 71 | 67 | 64 | 63 | | | 63 |
| 7 | 81 | 72 | 65 | 61 | 80 | 71 | 65 | 61 | 70 | 64 | 60 | 68 | 64 | 60 | 67 | 63 | 60 | 58 | | | 58 |
| 8 | 77 | 67 | 61 | 57 | 76 | 67 | 61 | 56 | 65 | 60 | 56 | 64 | 59 | 56 | 63 | 59 | 56 | 54 | | | 54 |
| 9 | 73 | 63 | 57 | 53 | 72 | 63 | 57 | 53 | 62 | 56 | 52 | 61 | 56 | 52 | 60 | 55 | 52 | 51 | | | 51 |
| 10 | 70 | 59 | 53 | 49 | 69 | 59 | 53 | 49 | 58 | 53 | 49 | 57 | 53 | 49 | 57 | 52 | 49 | 48 | | | 48 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 61488 |
| 5° | 60373 |
| 10° | 57264 |
| 15° | 53543 |
| 20° | 48632 |
| 25° | 43034 |
| 30° | 35792 |
| 35° | 25809 |
| 40° | 16102 |
| 45° | 9280 |
| 50° | 5258 |
| 55° | 2495 |
| 60° | 1431 |
| 65° | 1080 |
| 70° | 721 |
| 75° | 477 |
| 80° | 497 |
| 85° | 425 |



TEST NUMBER: P581050

CATALOG NUMBER: HC405D010-HM40525927-41NDH

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 45.6 | 9.6 |
| 10°-20° | 117.0 | 24.7 |
| 20°-30° | 143.9 | 30.4 |
| 30°-40° | 106.8 | 22.5 |
| 40°-50° | 43.4 | 9.2 |
| 50°-60° | 12.0 | 2.5 |
| 60°-70° | 3.7 | 0.8 |
| 70°-80° | 1.3 | 0.3 |
| 80°-90° | 0.3 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 306.4 | 64.6 |
| 0°-40° | 413.2 | 87.2 |
| 0°-60° | 468.7 | 98.9 |
| 0°-90° | 474.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 474.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-----|------|
| 0° | 498 | |
| 5° | 488 | 46 |
| 15° | 419 | 117 |
| 25° | 316 | 144 |
| 35° | 171 | 107 |
| 45° | 53 | 43 |
| 55° | 12 | 12 |
| 65° | 4 | 4 |
| 75° | 1 | 1 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P581050

CATALOG NUMBER: HC405D010-HM40525927-41NDH

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|-------|
| 0° | 498.5 |
| 2.5° | 493.7 |
| 5° | 487.6 |
| 7.5° | 475.3 |
| 10° | 457.2 |
| 12.5° | 438.5 |
| 15° | 419.3 |
| 17.5° | 396.5 |
| 20° | 370.5 |
| 22.5° | 344.1 |
| 25° | 316.2 |
| 27.5° | 285.8 |
| 30° | 251.3 |
| 32.5° | 212.0 |
| 35° | 171.4 |
| 37.5° | 133.1 |
| 40° | 100.0 |
| 42.5° | 73.1 |
| 45° | 53.2 |
| 47.5° | 38.2 |
| 50° | 27.4 |
| 52.5° | 18.7 |
| 55° | 11.6 |
| 57.5° | 7.5 |
| 60° | 5.8 |
| 62.5° | 4.8 |
| 65° | 3.7 |
| 67.5° | 2.7 |
| 70° | 2.0 |
| 72.5° | 1.7 |
| 75° | 1.0 |
| 77.5° | 0.7 |
| 80° | 0.7 |
| 82.5° | 0.3 |
| 85° | 0.3 |
| 87.5° | 0.3 |
| 90° | 0.0 |



Report Generated By 670245859 / DESKTOP-HRDQ47P





— 0°-180°







(END OF REPORT)