

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P583631

Luminaire Tested: **HC807D010-HM80520927-81NDH**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P583631
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-2)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HC807D010-HM80520927-81NDH
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" NARROW DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 688.0 lumens
Efficiency: N/A
Efficacy: 86.0 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.57
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P583631

CATALOG NUMBER: HC807D010-HM80520927-81NDH

Luminous Intensity Polar Plot

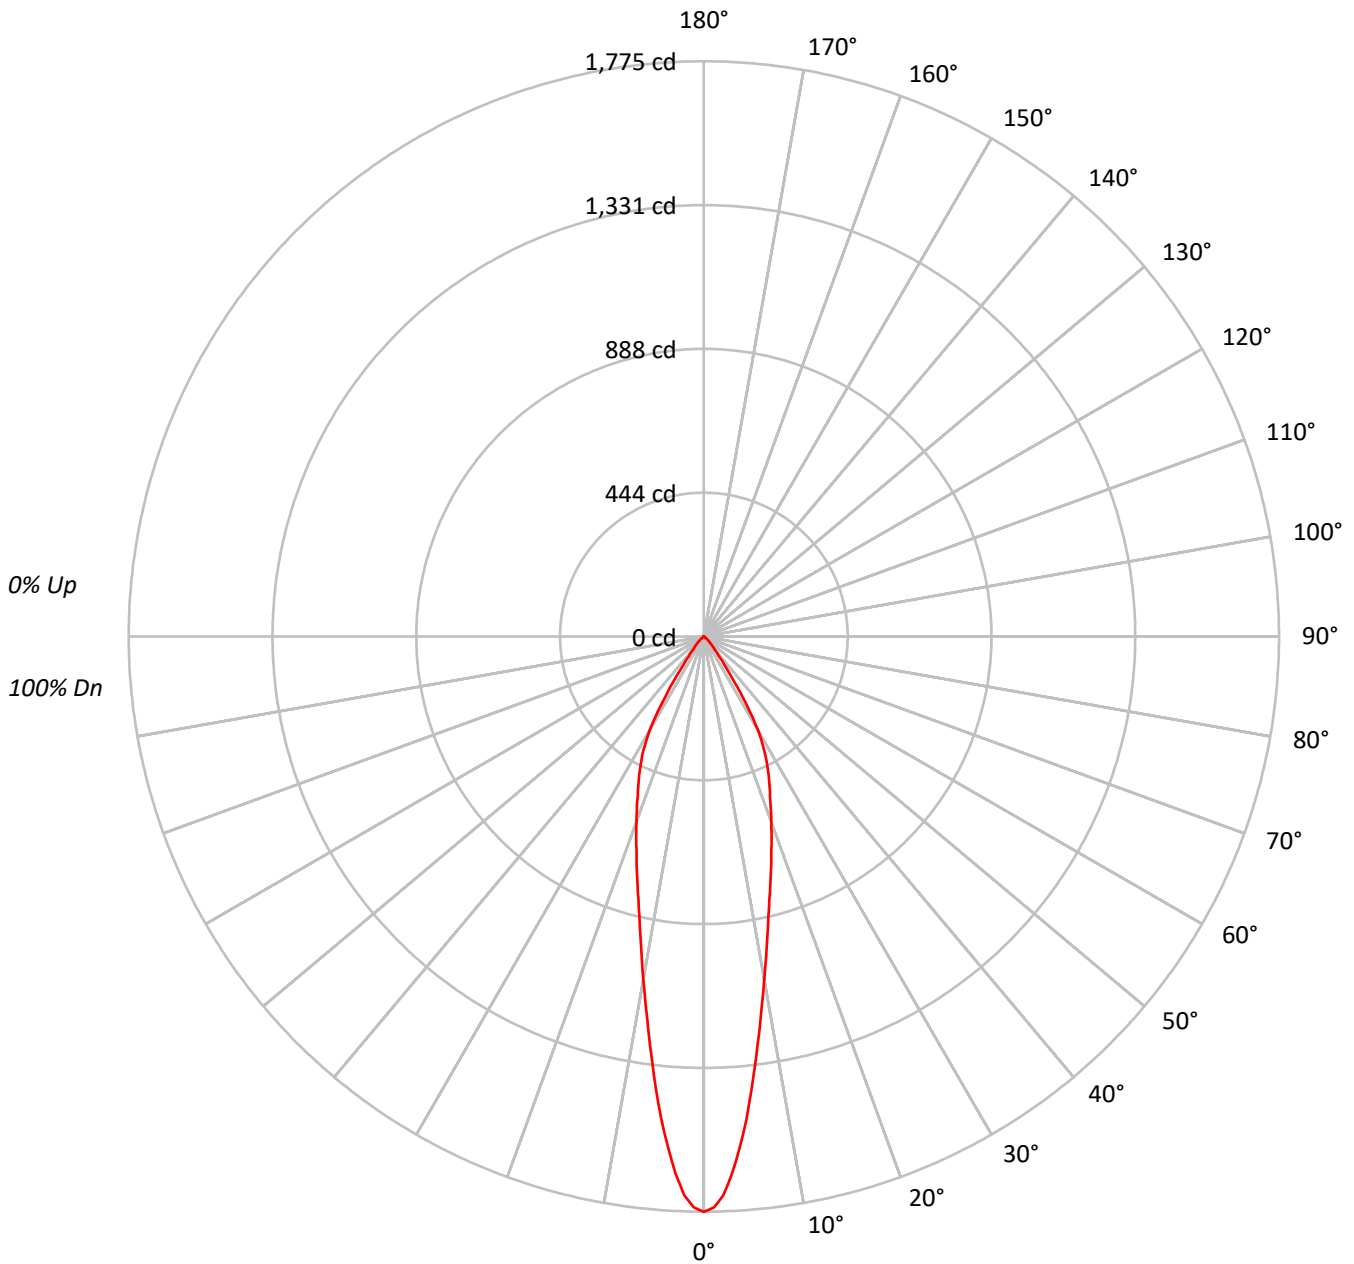



TEST NUMBER: P583631

CATALOG NUMBER: HC807D010-HM80520927-81NDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	109	107	112	109	107	106	105	104	102	102	100	99	98	97	96	95	95	95	95
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	92	91	89	89	89	89
3	104	99	94	91	102	97	93	90	95	91	88	92	90	87	90	88	86	84	84	84	84
4	100	93	88	84	98	92	87	84	90	86	83	88	85	82	86	83	81	80	80	80	80
5	96	88	83	79	94	87	82	79	86	81	78	84	80	77	82	79	77	75	75	75	75
6	92	84	78	75	90	83	78	74	81	77	74	80	76	73	79	76	73	72	72	72	72
7	88	80	74	70	87	79	74	70	78	73	70	77	73	70	76	72	69	68	68	68	68
8	84	76	71	67	83	75	70	67	74	70	66	73	69	66	72	69	66	65	65	65	65
9	81	72	67	64	80	72	67	63	71	66	63	70	66	63	69	66	63	62	62	62	62
10	78	69	64	61	77	69	64	61	68	63	60	67	63	60	67	63	60	59	59	59	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	54747
5°	46382
10°	33654
15°	25274
20°	19942
25°	16083
30°	11918
35°	4826
40°	2033
45°	1095
50°	494
55°	242
60°	154
65°	117
70°	99
75°	60
80°	89
85°	177



TEST NUMBER: P583631

CATALOG NUMBER: HC807D010-HM80520927-81NDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	128.7	18.7
10°-20°	222.3	32.3
20°-30°	215.0	31.2
30°-40°	94.4	13.7
40°-50°	20.4	3.0
50°-60°	4.6	0.7
60°-70°	1.6	0.2
70°-80°	0.6	0.1
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	566.0	82.3
0°-40°	660.3	96.0
0°-60°	685.3	99.6
0°-90°	688.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	688.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1775	
5°	1498	129
15°	792	222
25°	473	215
35°	128	94
45°	25	20
55°	4	5
65°	2	2
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P583631

CATALOG NUMBER: HC807D010-HM80520927-81NDH

CANDELA DISTRIBUTION (FULL):

	0°
0°	1775.4
1°	1762.1
2°	1725.8
3°	1660.5
4°	1582.2
5°	1498.4
6°	1407.0
7°	1315.0
8°	1228.6
9°	1148.4
10°	1074.8
11°	1005.2
12°	942.9
13°	886.2
14°	836.1
15°	791.7
17.5°	692.0
20°	607.7
22.5°	533.6
25°	472.7
27.5°	410.8
30°	334.7
32.5°	227.4
35°	128.2
37.5°	75.6
40°	50.5
42.5°	35.7
45°	25.1
47.5°	16.4
50°	10.3
52.5°	6.1
55°	4.5
57.5°	3.6
60°	2.5
62.5°	2.0
65°	1.6
67.5°	1.1
70°	1.1
72.5°	0.5
75°	0.5
77.5°	0.5
80°	0.5
82.5°	0.5



TEST NUMBER: P583631

CATALOG NUMBER: HC807D010-HM80520927-81NDH

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By 670245859 / DESKTOP-HRDQ47P





— 0°-180°







85°		0.5
87.5°		0.5



(END OF REPORT)