

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P579717

Luminaire Tested: **HCC4W10D010BZ-HM40525830-41WWBB**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P579717  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-17)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W10D010BZ-HM40525830-41WWBB  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE BAFFLE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 859.9 lumens  
Efficiency: N/A  
Efficacy: 86.9 lumens/watt  
Spacing Criteria (0/90/45): 1.11 / 1.04 / 1.12  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P579717  
CATALOG NUMBER: HCC4W10D010BZ-HM40525830-41WWBB

### Luminous Intensity Polar Plot

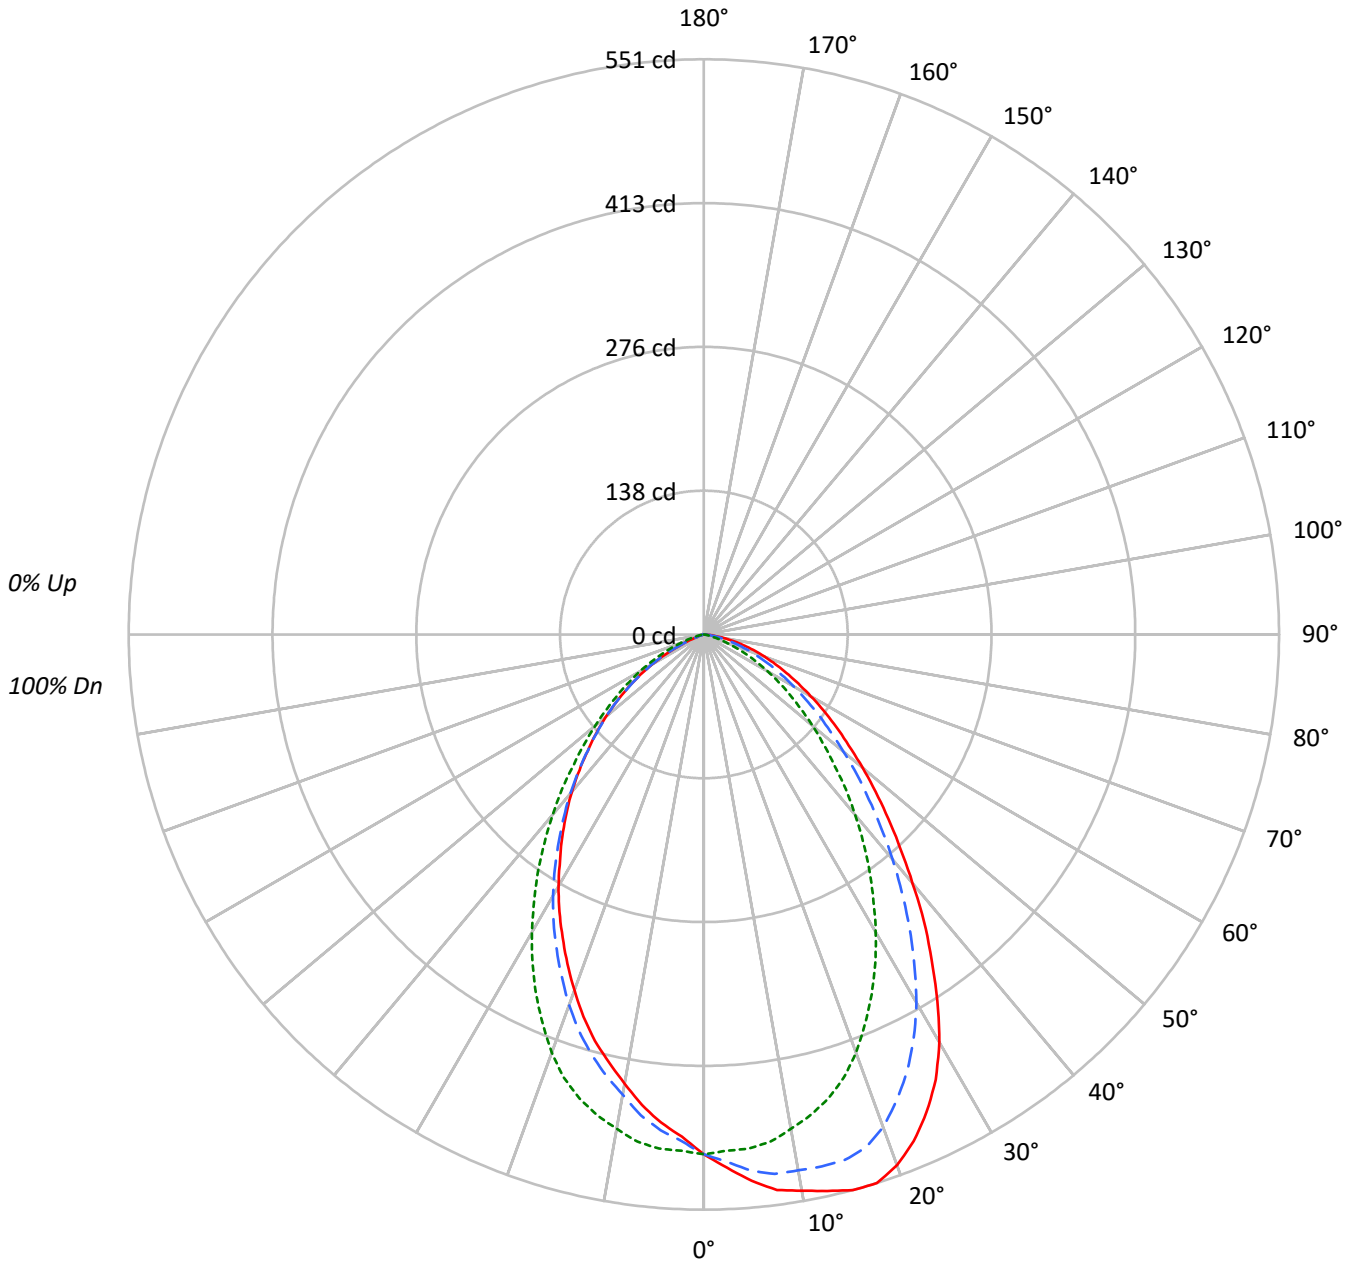

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P579717

CATALOG NUMBER: HCC4W10D010BZ-HM40525830-41WWBB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89					89			
2	103	97	91	87	101	95	90	86	92	87	84	88	85	82	85	83	80	78					78			
3	96	87	80	75	94	86	79	74	83	78	73	80	76	72	78	74	71	69					69			
4	89	79	72	66	87	78	71	65	75	69	65	73	68	64	71	67	63	61					61			
5	83	72	64	58	81	71	64	58	69	62	58	67	61	57	65	60	56	55					55			
6	77	66	58	52	75	65	57	52	63	57	52	61	56	51	60	55	51	49					49			
7	72	60	53	47	71	59	52	47	58	51	47	57	51	46	55	50	46	44					44			
8	68	56	48	43	66	55	48	43	54	47	42	53	47	42	51	46	42	40					40			
9	64	52	44	39	62	51	44	39	50	43	39	49	43	39	48	43	39	37					37			
10	60	48	41	36	59	47	41	36	46	40	36	46	40	36	45	39	36	34					34			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	61414	61414	61414
5°	65053	61203	58132
10°	67759	60219	54734
15°	70361	58779	51462
20°	71013	55957	47595
25°	68715	51758	43565
30°	64249	46901	39652
35°	57265	41695	35612
40°	50060	36261	31704
45°	43609	30771	27439
50°	38033	26097	23526
55°	33354	21634	19032
60°	29159	17466	13987
65°	25421	13017	7851
70°	22215	8403	2561
75°	18205	4384	667
80°	13567	1989	497
85°	8067	991	991



TEST NUMBER: P579717

CATALOG NUMBER: HCC4W10D010BZ-HM40525830-41WWBB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	47.0	5.5
10°-20°	131.5	15.3
20°-30°	181.8	21.1
30°-40°	182.8	21.3
40°-50°	147.5	17.2
50°-60°	99.8	11.6
60°-70°	50.8	5.9
70°-80°	16.3	1.9
80°-90°	2.5	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	360.3	41.9
0°-40°	543.1	63.2
0°-60°	790.4	91.9
0°-90°	859.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	859.9	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	498	498	498	498	498	
5°	525	516	494	477	470	51
15°	551	521	460	416	403	155
25°	505	461	380	334	320	231
35°	380	343	277	242	236	238
45°	250	224	176	157	157	194
55°	155	134	101	88	88	139
65°	87	71	45	29	27	87
75°	38	27	9	2	1	41
85°	6	3	1	1	1	8
90°	0	0	0	0	0	



TEST NUMBER: P579717

CATALOG NUMBER: HCC4W10D010BZ-HM40525830-41WWBB

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	497.9	497.9	497.9	497.9	497.9	497.9	497.9	497.9	497.9
2.5°	511.3	508.5	505.6	500.7	495.0	489.3	485.8	483.0	481.6
5°	525.4	521.9	515.5	504.9	494.3	484.4	476.6	471.7	469.5
7.5°	536.8	531.9	521.2	506.3	490.0	474.4	464.5	457.5	454.6
10°	541.0	535.4	521.2	501.4	480.8	461.7	447.6	440.5	437.0
12.5°	546.0	539.6	521.9	497.2	471.7	448.9	432.7	423.4	419.9
15°	551.0	542.5	521.2	490.8	460.3	434.1	416.4	407.2	403.0
17.5°	551.0	541.0	515.5	480.1	445.4	417.9	398.0	387.4	383.8
20°	541.0	529.7	502.1	463.2	426.3	396.6	377.5	366.9	362.6
22.5°	525.4	512.7	483.0	442.6	403.6	374.6	355.5	345.6	341.4
25°	504.9	492.2	461.0	419.2	380.3	351.3	333.5	324.3	320.1
27.5°	480.8	466.7	435.5	393.7	355.5	327.9	311.6	303.0	299.5
30°	451.1	437.7	407.2	366.1	329.3	303.8	288.9	281.2	278.4
32.5°	416.4	405.1	375.3	337.1	302.4	279.0	265.6	259.2	256.4
35°	380.3	369.6	343.4	308.1	276.9	254.9	242.2	238.0	236.5
37.5°	346.3	337.1	311.6	279.0	250.7	231.6	220.2	217.4	216.0
40°	310.9	304.5	281.2	251.4	225.2	208.3	199.0	196.9	196.9
42.5°	279.0	272.0	251.4	224.5	201.1	184.1	177.8	175.6	176.4
45°	250.0	243.0	223.7	199.0	176.4	162.2	157.3	157.3	157.3
47.5°	223.0	216.7	199.0	173.5	155.1	143.7	138.8	138.8	139.5
50°	198.2	194.0	174.2	152.3	136.0	125.3	121.8	121.1	122.6
52.5°	174.9	170.0	152.3	132.5	116.9	108.3	104.8	104.1	104.8
55°	155.1	149.4	133.8	114.7	100.6	92.1	87.9	87.1	88.5
57.5°	136.0	131.7	115.4	98.4	85.0	76.5	72.9	71.6	72.3
60°	118.2	114.0	99.1	82.8	70.8	62.4	57.4	56.0	56.7
62.5°	102.0	98.4	84.3	68.7	56.7	48.8	43.9	40.4	41.8
65°	87.1	83.5	70.8	55.2	44.6	36.1	29.0	26.2	26.9
67.5°	74.3	70.1	58.0	43.9	33.2	24.1	16.3	14.9	14.9
70°	61.6	57.4	46.8	34.0	23.3	12.7	7.1	7.1	7.1
72.5°	49.6	46.0	36.1	25.5	14.9	5.7	2.8	2.8	2.8
75°	38.2	35.4	26.9	17.8	9.2	2.8	2.2	1.4	1.4
77.5°	28.3	25.5	19.1	12.1	5.7	1.4	1.4	1.4	1.4
80°	19.1	17.0	12.7	7.1	2.8	0.7	0.7	0.7	0.7
82.5°	11.4	9.9	7.1	3.5	1.4	0.7	0.7	0.7	0.7
85°	5.7	4.2	2.8	1.4	0.7	0.7	0.7	0.7	0.7
87.5°	1.4	0.7	0.7	0.7	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)