

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P579946

Luminaire Tested: **HCC4W15D010MW-HM40525935-41NDW**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P579946  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-3)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W15D010MW-HM40525935-41NDW  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1226.7 lumens  
Efficiency: N/A  
Efficacy: 87.6 lumens/watt  
Spacing Criteria (0/90/45): 1.03 / 1.03 / 1.01  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 14  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P579946  
CATALOG NUMBER: HCC4W15D010MW-HM40525935-41NDW

### Luminous Intensity Polar Plot

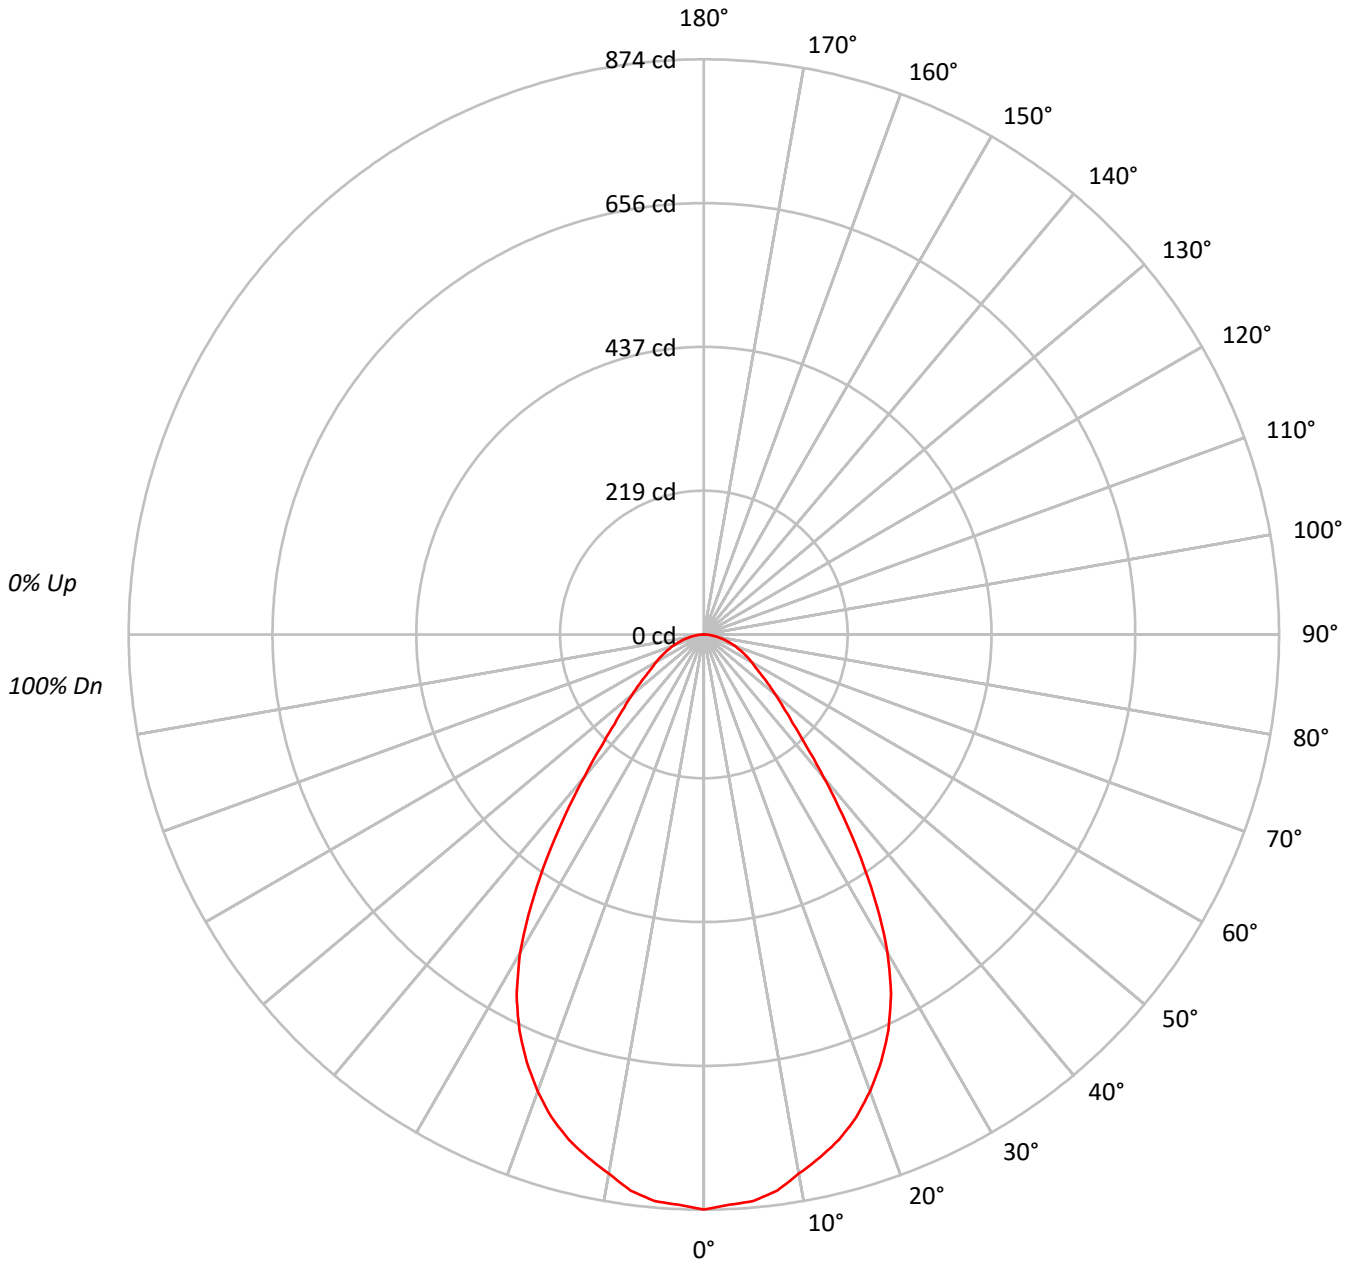



TEST NUMBER: P579946  
 CATALOG NUMBER: HCC4W15D010MW-HM40525935-41NDW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100	
1	111	108	104	101	109	105	102	100	101	99	97	98	96	94	94	92	91	89			89	
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79			79	
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71			71	
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64			64	
5	85	74	67	61	83	73	66	61	71	65	60	69	64	60	68	63	59	58			58	
6	79	68	61	56	78	67	60	55	66	60	55	64	59	55	63	58	54	52			52	
7	75	63	56	51	73	62	56	51	61	55	50	60	54	50	59	53	50	48			48	
8	70	59	52	47	69	58	51	46	57	51	46	56	50	46	55	50	46	44			44	
9	66	55	48	43	65	54	47	43	53	47	43	52	47	43	51	46	42	41			41	
10	63	51	44	40	62	51	44	40	50	44	40	49	43	39	48	43	39	38			38	

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	107779
5°	106978
10°	104182
15°	101442
20°	96910
25°	90273
30°	79503
35°	62700
40°	45519
45°	33440
50°	27210
55°	22816
60°	20673
65°	18971
70°	17671
75°	16156
80°	14562
85°	12596



TEST NUMBER: P579946  
 CATALOG NUMBER: HCC4W15D010MW-HM40525935-41NDW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	81.5	6.6
10°-20°	222.8	18.2
20°-30°	302.1	24.6
30°-40°	259.2	21.1
40°-50°	153.1	12.5
50°-60°	97.0	7.9
60°-70°	65.1	5.3
70°-80°	36.0	2.9
80°-90°	10.0	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	606.3	49.4
0°-40°	865.6	70.6
0°-60°	1115.6	90.9
0°-90°	1226.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1226.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	874	
5°	864	81
15°	794	223
25°	663	302
35°	416	259
45°	192	153
55°	106	97
65°	65	65
75°	34	36
85°	9	10
90°	0	



TEST NUMBER: P579946

CATALOG NUMBER: HCC4W15D010MW-HM40525935-41NDW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	873.8
2.5°	867.5
5°	864.0
7.5°	852.4
10°	831.8
12.5°	814.1
15°	794.4
17.5°	769.5
20°	738.3
22.5°	703.5
25°	663.3
27.5°	616.1
30°	558.2
32.5°	489.5
35°	416.4
37.5°	346.0
40°	282.7
42.5°	230.0
45°	191.7
47.5°	164.1
50°	141.8
52.5°	123.0
55°	106.1
57.5°	92.8
60°	83.8
62.5°	74.9
65°	65.0
67.5°	57.1
70°	49.0
72.5°	41.0
75°	33.9
77.5°	26.7
80°	20.5
82.5°	14.2
85°	8.9
87.5°	3.5
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)