

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580002

Luminaire Tested: **HCC4S20D010MW-HM40525830-41WDW**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P580002
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4S20D010MW-HM40525830-41WDW
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WIDE DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1951.8 lumens
Efficiency: N/A
Efficacy: 97.6 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.07 / 1.04
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 20
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580002
CATALOG NUMBER: HCC4S20D010MW-HM40525830-41WDW

Luminous Intensity Polar Plot

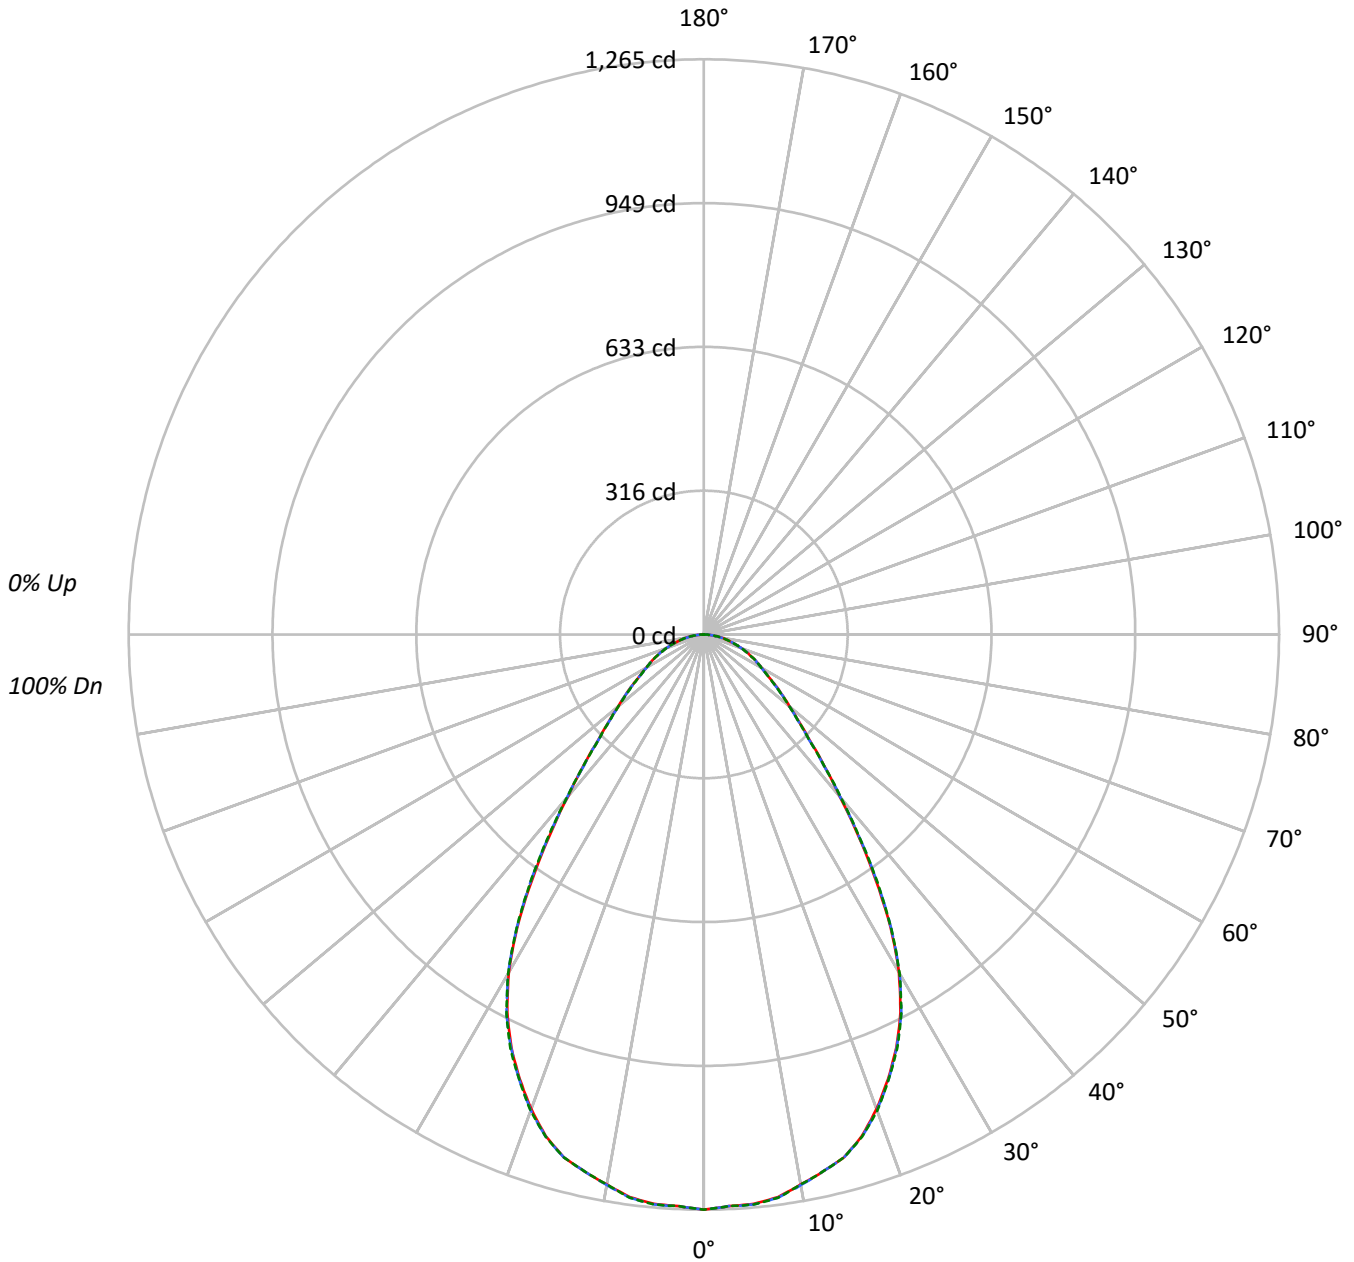



TEST NUMBER: P580002

CATALOG NUMBER: HCC4S20D010MW-HM40525830-41WDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20										
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89								
2	103	97	91	87	101	95	90	86	91	87	84	88	85	82	85	83	80	78								
3	96	87	81	76	94	86	80	75	83	78	74	81	76	72	78	74	71	69								
4	90	80	72	67	87	78	72	66	76	70	66	74	69	65	72	68	64	62								
5	84	73	65	60	82	72	65	59	70	64	59	68	63	58	66	62	58	56								
6	78	67	59	54	77	66	59	54	64	58	53	63	57	53	61	56	53	51								
7	73	62	54	49	72	61	54	49	60	53	49	58	53	48	57	52	48	46								
8	69	57	50	45	68	57	50	45	55	49	45	54	49	44	53	48	44	42								
9	65	53	46	41	64	53	46	41	52	45	41	51	45	41	50	45	41	39								
10	61	50	43	38	60	49	43	38	48	42	38	48	42	38	47	42	38	36								

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	156032	156032	156032
5°	155650	155823	155823
10°	153843	154018	153843
15°	152010	152010	152010
20°	145766	146120	146278
25°	136342	136519	136873
30°	122160	122544	122544
35°	99185	99968	100179
40°	74856	75275	75484
45°	57337	57111	57111
50°	47225	46994	46994
55°	40558	40278	40278
60°	36190	35844	35844
65°	34002	34002	34002
70°	31628	31628	31628
75°	28690	29357	28690
80°	26992	26069	26992
85°	22219	22219	22219



TEST NUMBER: P580002

CATALOG NUMBER: HCC4S20D010MW-HM40525830-41WDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.2	6.1
10°-20°	333.5	17.1
20°-30°	458.3	23.5
30°-40°	412.1	21.1
40°-50°	260.4	13.3
50°-60°	170.0	8.7
60°-70°	115.2	5.9
70°-80°	64.8	3.3
80°-90°	18.2	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	911.1	46.7
0°-40°	1323.2	67.8
0°-60°	1753.6	89.8
0°-90°	1951.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1951.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1265	1265	1265	1265	1265	
5°	1257	1257	1258	1258	1258	119
15°	1190	1190	1190	1190	1190	333
25°	1002	1003	1003	1006	1006	457
35°	659	661	664	666	665	410
45°	329	327	327	327	327	261
55°	189	189	187	189	187	171
65°	116	116	116	116	116	115
75°	60	62	62	62	60	65
85°	16	16	16	16	16	18
90°	0	0	0	0	0	



TEST NUMBER: P580002

CATALOG NUMBER: HCC4S20D010MW-HM40525830-41WDW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1265.0	1265.0	1265.0	1265.0	1265.0
2.5°	1258.5	1258.5	1258.5	1258.5	1258.5
5°	1257.1	1257.1	1258.5	1258.5	1258.5
7.5°	1247.9	1249.3	1249.3	1249.3	1249.3
10°	1228.3	1228.3	1229.7	1229.7	1228.3
12.5°	1210.0	1210.0	1210.0	1211.3	1210.0
15°	1190.4	1190.4	1190.4	1190.4	1190.4
17.5°	1156.3	1157.7	1157.7	1157.7	1157.7
20°	1110.5	1113.2	1113.2	1114.4	1114.4
22.5°	1058.1	1059.4	1060.7	1062.0	1060.7
25°	1001.8	1003.1	1003.1	1005.7	1005.7
27.5°	936.3	937.7	940.2	940.2	940.2
30°	857.7	859.1	860.4	860.4	860.4
32.5°	764.8	764.8	767.3	768.7	767.3
35°	658.7	661.4	663.9	666.5	665.3
37.5°	557.9	560.5	561.8	561.8	563.1
40°	464.9	467.5	467.5	470.2	468.8
42.5°	391.6	390.2	390.2	392.8	391.6
45°	328.7	327.4	327.4	327.4	327.4
47.5°	282.9	281.6	281.6	281.6	281.6
50°	246.1	244.9	244.9	244.9	244.9
52.5°	216.1	214.7	214.7	214.7	213.5
55°	188.6	188.6	187.3	188.6	187.3
57.5°	163.7	163.7	163.7	163.7	163.7
60°	146.7	145.3	145.3	145.3	145.3
62.5°	131.0	131.0	131.0	131.0	131.0
65°	116.5	116.5	116.5	116.5	116.5
67.5°	102.2	100.8	102.2	102.2	100.8
70°	87.7	86.5	87.7	87.7	87.7
72.5°	73.3	73.3	73.3	74.7	73.3
75°	60.2	61.6	61.6	61.6	60.2
77.5°	48.4	49.8	48.4	48.4	48.4
80°	38.0	36.7	36.7	36.7	38.0
82.5°	26.2	26.2	26.2	26.2	26.2
85°	15.7	15.7	15.7	15.7	15.7
87.5°	6.5	6.5	6.5	6.5	6.5
90°	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)