

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580017

Luminaire Tested: **HCC4S20D010SL-HM40525835-41RWWH**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580017  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-15)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4S20D010SL-HM40525835-41RWWH  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2082.9 lumens  
Efficiency: N/A  
Efficacy: 104.1 lumens/watt  
Spacing Criteria (0/90/45): 1.14 / 1.08 / 1.16  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 20  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580017  
CATALOG NUMBER: HCC4S20D010SL-HM40525835-41RWWH

### Luminous Intensity Polar Plot

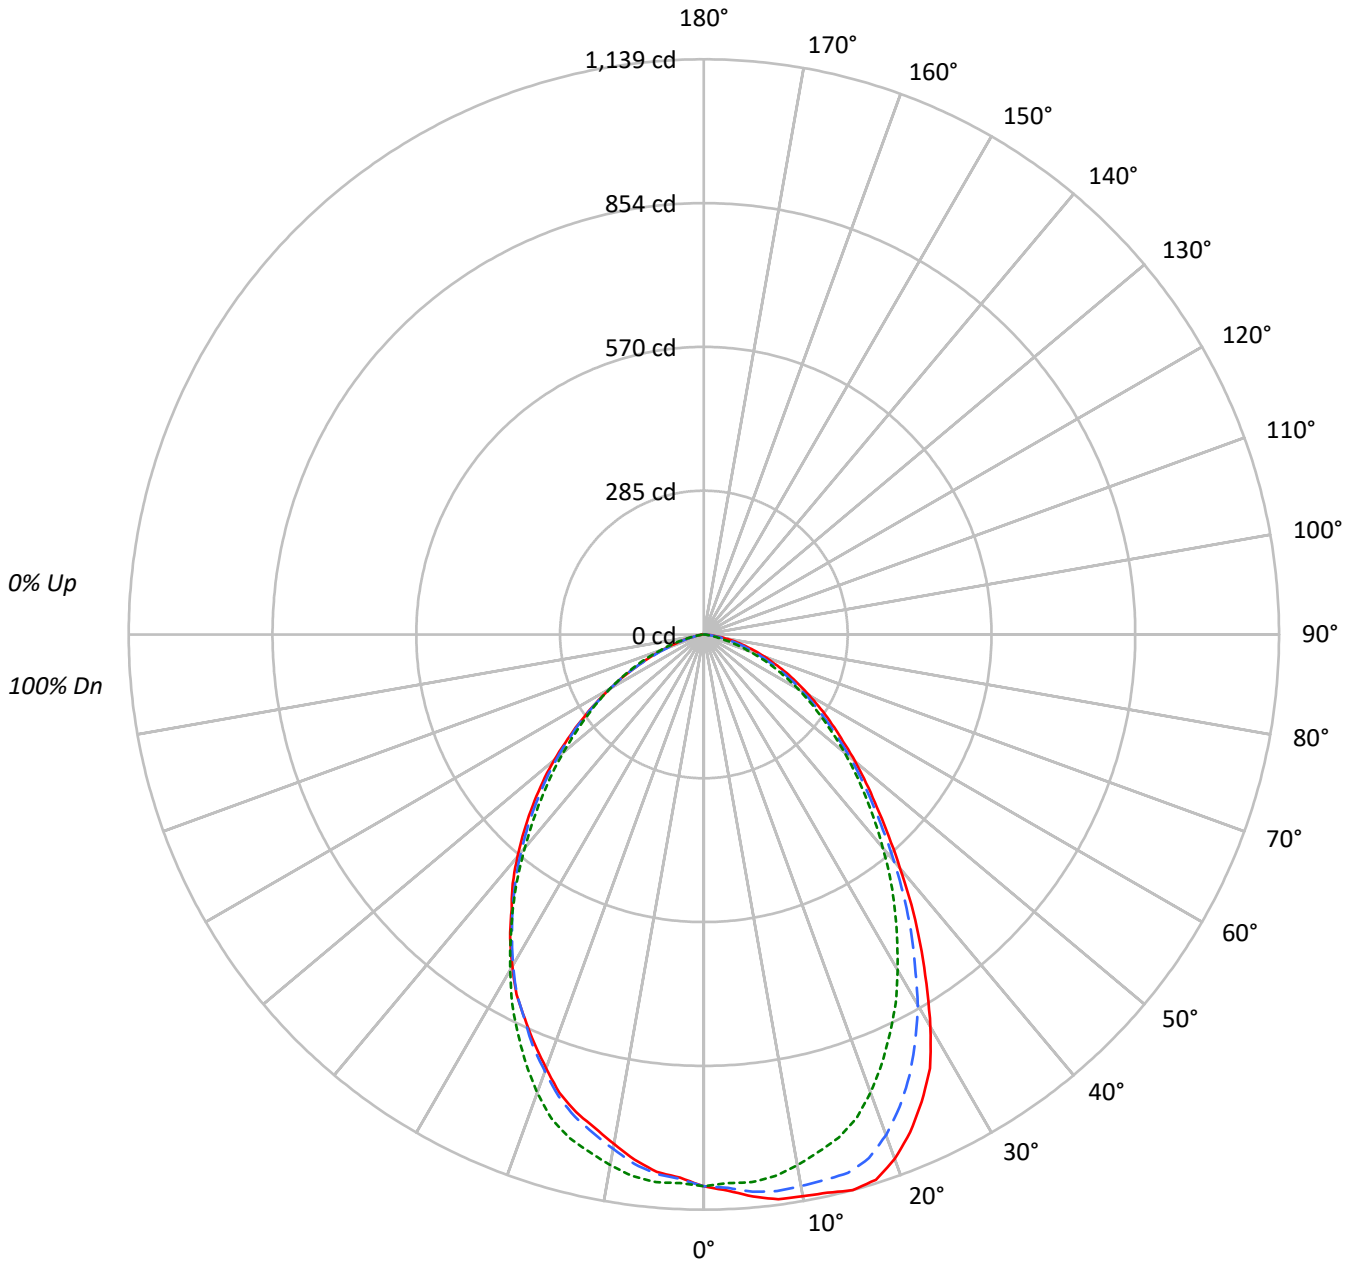

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580017

CATALOG NUMBER: HCC4S20D010SL-HM40525835-41RWWH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	104	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77					77			
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67					67			
4	88	77	70	64	86	76	69	63	74	67	62	71	66	62	69	65	61	59					59			
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52					52			
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47					47			
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42					42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38					38			
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	37	35					35			
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	134780	134780	134780
5°	138328	134799	132273
10°	141468	133628	128355
15°	145447	131745	124977
20°	145044	126694	119921
25°	138928	118608	114172
30°	127800	109242	108088
35°	112421	99140	99953
40°	97270	88736	92456
45°	84532	78846	83590
50°	75010	69561	74243
55°	66557	61030	63632
60°	59280	52915	52915
65°	52681	43983	41211
70°	45549	33287	29356
75°	38173	21970	18110
80°	28910	10584	9589
85°	15426	3963	3963



TEST NUMBER: P580017  
 CATALOG NUMBER: HCC4S20D010SL-HM40525835-41RWWH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	103.5	5.0
10°-20°	293.4	14.1
20°-30°	413.8	19.9
30°-40°	427.4	20.5
40°-50°	362.3	17.4
50°-60°	263.6	12.7
60°-70°	154.0	7.4
70°-80°	57.3	2.7
80°-90°	7.5	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	810.6	38.9
0°-40°	1238.1	59.4
0°-60°	1864.0	89.5
0°-90°	2082.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2082.9	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1093	1093	1093	1093	1093	
5°	1117	1108	1089	1072	1068	107
15°	1139	1104	1032	988	979	320
25°	1021	964	872	840	839	467
35°	747	714	658	660	664	466
45°	485	471	452	468	479	377
55°	310	294	284	293	296	278
65°	180	166	151	141	141	179
75°	80	66	46	37	38	86
85°	11	7	3	3	3	15
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580017

CATALOG NUMBER: HCC4S20D010SL-HM40525835-41RWWH

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1092.7	1092.7	1092.7	1092.7	1092.7	1092.7	1092.7	1092.7	1092.7
2.5°	1102.3	1099.5	1096.9	1092.7	1087.4	1083.2	1079.2	1076.5	1076.5
5°	1117.2	1113.2	1107.7	1098.3	1088.7	1080.6	1072.4	1068.3	1068.3
7.5°	1128.1	1122.7	1111.8	1098.3	1081.9	1069.7	1057.4	1052.0	1049.3
10°	1129.5	1123.9	1109.0	1088.7	1066.9	1048.0	1034.4	1026.2	1024.8
12.5°	1132.1	1125.3	1106.4	1077.8	1049.3	1026.2	1011.3	1003.2	1000.4
15°	1139.0	1129.5	1103.6	1066.9	1031.7	1004.5	988.3	981.5	978.7
17.5°	1132.1	1118.6	1087.4	1043.9	1004.5	974.7	958.4	951.6	951.6
20°	1105.0	1091.4	1054.8	1007.3	965.2	936.6	920.4	916.3	913.6
22.5°	1066.9	1052.0	1012.7	962.4	920.4	894.5	883.8	878.3	876.9
25°	1020.8	1005.9	963.8	912.2	871.5	849.8	840.3	840.3	838.9
27.5°	969.2	950.2	906.8	862.0	822.6	806.3	802.2	802.2	803.6
30°	897.3	883.8	847.1	803.6	767.0	756.1	756.1	758.9	758.9
32.5°	819.9	810.4	777.8	739.8	711.4	704.5	707.2	712.6	714.0
35°	746.6	735.8	714.0	680.1	658.4	655.6	659.8	663.8	663.8
37.5°	674.7	663.8	648.9	621.7	605.4	606.8	612.3	617.7	621.7
40°	604.1	596.0	585.1	563.4	551.1	556.5	563.4	568.8	574.2
42.5°	541.6	533.5	525.3	509.0	500.9	507.7	515.8	521.3	526.7
45°	484.6	479.2	471.1	457.4	452.0	458.8	468.3	473.7	479.2
47.5°	435.7	433.0	422.2	409.9	407.2	414.1	422.2	429.0	433.0
50°	390.9	386.9	377.4	365.2	362.5	373.3	378.7	382.8	386.9
52.5°	347.5	343.4	332.6	321.7	321.7	329.9	333.9	335.3	339.4
55°	309.5	305.4	294.5	286.4	283.8	290.5	293.2	293.2	295.9
57.5°	274.2	270.1	259.2	249.8	248.4	252.5	252.5	252.5	253.8
60°	240.3	236.2	225.4	217.2	214.5	215.9	214.5	213.1	214.5
62.5°	209.1	205.0	194.1	184.7	181.9	181.9	177.8	176.5	177.8
65°	180.5	173.8	165.6	156.1	150.7	146.6	141.2	141.2	141.2
67.5°	152.1	146.6	137.1	127.5	120.8	114.0	105.9	108.6	110.0
70°	126.3	122.2	111.3	101.9	92.3	84.2	77.4	80.1	81.4
72.5°	103.1	97.7	88.2	77.4	69.3	58.4	54.3	57.0	57.0
75°	80.1	74.7	66.5	55.6	46.1	36.7	36.7	38.0	38.0
77.5°	59.8	54.3	46.1	36.7	28.6	21.7	23.1	23.1	23.1
80°	40.7	36.7	29.8	21.7	14.9	12.3	12.3	12.3	13.5
82.5°	23.1	20.4	16.3	10.9	6.8	6.8	6.8	6.8	6.8
85°	10.9	8.1	6.8	4.1	2.8	2.8	2.8	2.8	2.8
87.5°	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)