

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580126

Luminaire Tested: **HCC4S25D010MB-HM40525827-41WWBB**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P580126
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-17)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4S25D010MB-HM40525827-41WWBB
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1792.3 lumens
Efficiency: N/A
Efficacy: 66.9 lumens/watt
Spacing Criteria (0/90/45): 1.11 / 1.04 / 1.12
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 26.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580126
CATALOG NUMBER: HCC4S25D010MB-HM40525827-41WWBB

Luminous Intensity Polar Plot

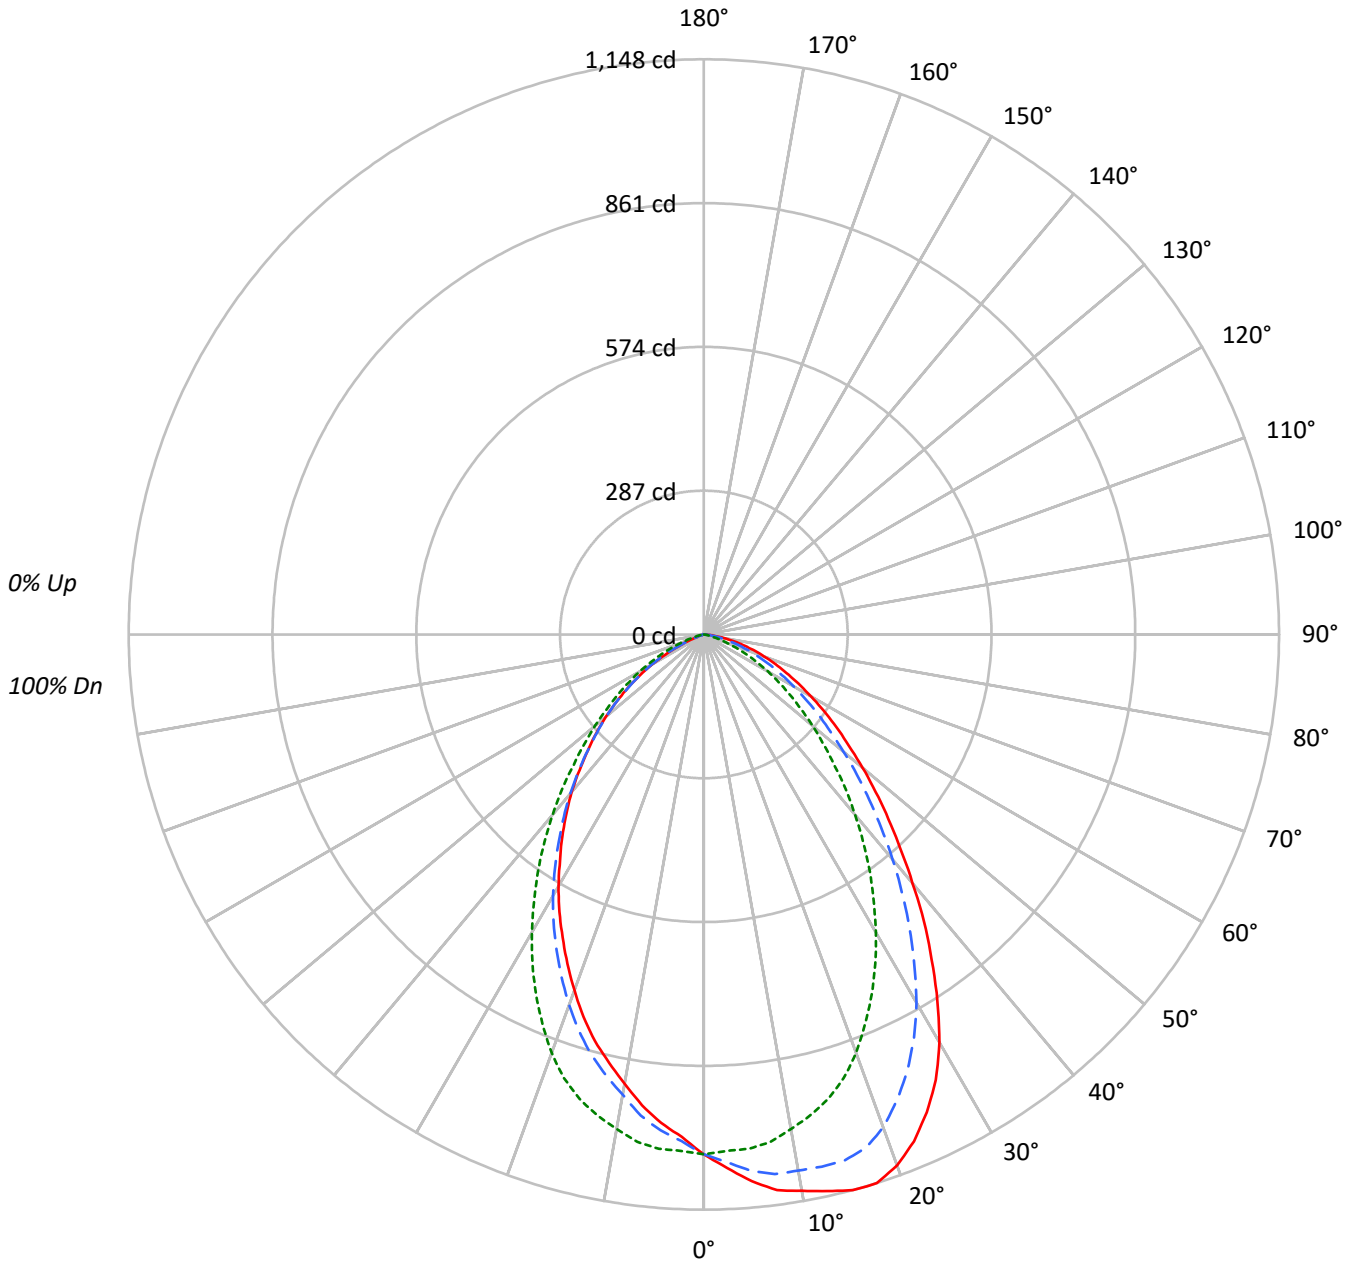

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580126

CATALOG NUMBER: HCC4S25D010MB-HM40525827-41WWBB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89					89			
2	103	97	91	87	101	95	90	86	92	87	84	88	85	82	85	83	80	78					78			
3	96	87	80	75	94	86	79	74	83	78	73	80	76	72	78	74	71	69					69			
4	89	79	72	66	87	78	71	65	75	69	65	73	68	64	71	67	63	61					61			
5	83	72	64	58	81	71	64	58	69	62	58	67	61	57	65	60	56	55					55			
6	77	66	58	52	75	65	57	52	63	57	52	61	56	51	60	55	51	49					49			
7	72	60	53	47	71	59	52	47	58	51	47	57	51	46	55	50	46	44					44			
8	68	56	48	43	66	55	48	43	54	47	42	53	47	42	51	46	42	40					40			
9	64	52	44	39	62	51	44	39	50	43	39	49	43	39	48	43	39	37					37			
10	60	48	41	36	59	47	41	36	46	40	36	46	40	36	45	39	36	34					34			

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	127983	127983	127983
5°	135592	127556	121155
10°	141230	125524	114064
15°	146634	122512	107253
20°	148011	116626	99181
25°	143215	107870	90790
30°	133910	97748	82622
35°	119347	86898	74220
40°	104322	75565	66065
45°	90882	64106	57146
50°	79290	54382	49009
55°	69503	45052	39676
60°	60809	36412	29134
65°	52973	27143	16373
70°	46306	17563	5337
75°	37983	9150	1382
80°	28342	4191	1065
85°	16841	2123	2123



TEST NUMBER: P580126
 CATALOG NUMBER: HCC4S25D010MB-HM40525827-41WWBB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	97.9	5.5
10°-20°	274.1	15.3
20°-30°	378.9	21.1
30°-40°	381.0	21.3
40°-50°	307.5	17.2
50°-60°	207.9	11.6
60°-70°	105.8	5.9
70°-80°	33.9	1.9
80°-90°	5.2	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	751.0	41.9
0°-40°	1132.0	63.2
0°-60°	1647.4	91.9
0°-90°	1792.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1792.3	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1038	1038	1038	1038	1038	
5°	1095	1074	1030	993	978	106
15°	1148	1086	959	868	840	323
25°	1052	961	793	695	667	482
35°	793	716	577	505	493	495
45°	521	466	368	328	328	404
55°	323	279	210	183	184	290
65°	182	148	93	60	56	182
75°	80	56	19	4	3	86
85°	12	6	2	2	2	16
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580126

CATALOG NUMBER: HCC4S25D010MB-HM40525827-41WWBB

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1037.6	1037.6	1037.6	1037.6	1037.6	1037.6	1037.6	1037.6	1037.6
2.5°	1065.7	1059.8	1053.8	1043.5	1031.7	1019.9	1012.5	1006.6	1003.7
5°	1095.1	1087.8	1074.5	1052.3	1030.2	1009.6	993.3	983.0	978.5
7.5°	1118.7	1108.5	1086.3	1055.3	1021.4	988.9	968.2	953.4	947.6
10°	1127.6	1115.8	1086.3	1045.0	1002.2	962.4	932.8	918.0	910.7
12.5°	1137.9	1124.7	1087.8	1036.1	983.0	935.7	901.8	882.7	875.2
15°	1148.3	1130.6	1086.3	1022.9	959.4	904.8	867.9	848.7	839.9
17.5°	1148.3	1127.6	1074.5	1000.7	928.4	870.8	829.5	807.3	800.0
20°	1127.6	1104.0	1046.5	965.3	888.5	826.5	786.7	764.6	755.6
22.5°	1095.1	1068.6	1006.6	922.5	841.3	780.8	741.0	720.3	711.4
25°	1052.3	1025.8	960.9	873.7	792.6	732.0	695.1	675.9	667.1
27.5°	1002.2	972.6	907.7	820.7	741.0	683.4	649.4	631.7	624.3
30°	940.2	912.1	848.7	763.1	686.3	633.1	602.2	586.0	580.1
32.5°	867.9	844.3	782.3	702.6	630.2	581.5	553.4	540.2	534.2
35°	792.6	770.4	715.8	642.1	577.1	531.3	504.8	496.0	492.9
37.5°	721.8	702.6	649.4	581.5	522.5	482.6	459.1	453.1	450.1
40°	647.9	634.6	586.0	524.0	469.3	434.0	414.8	410.3	410.3
42.5°	581.5	566.8	524.0	467.9	419.2	383.7	370.4	366.0	367.5
45°	521.0	506.2	466.4	414.8	367.5	338.0	327.6	327.6	327.6
47.5°	464.9	451.6	414.8	361.6	323.2	299.6	289.2	289.2	290.7
50°	413.2	404.4	363.1	317.4	283.4	261.3	253.9	252.4	255.4
52.5°	364.6	354.3	317.4	276.0	243.5	225.8	218.5	217.0	218.5
55°	323.2	311.4	279.0	239.1	209.5	191.9	183.0	181.5	184.5
57.5°	283.4	274.6	240.6	205.1	177.1	159.4	152.1	149.0	150.5
60°	246.5	237.7	206.6	172.7	147.6	129.8	119.6	116.6	118.1
62.5°	212.6	205.1	175.7	143.2	118.1	101.8	91.6	84.1	87.0
65°	181.5	174.2	147.6	115.2	93.0	75.3	60.5	54.6	56.1
67.5°	155.0	146.1	121.0	91.6	69.3	50.1	34.0	31.0	31.0
70°	128.4	119.6	97.4	70.9	48.7	26.5	14.8	14.8	14.8
72.5°	103.3	96.0	75.3	53.2	31.0	11.9	5.9	5.9	5.9
75°	79.7	73.8	56.1	36.9	19.2	5.9	4.4	2.9	2.9
77.5°	59.0	53.2	39.9	25.1	11.9	2.9	2.9	2.9	2.9
80°	39.9	35.5	26.5	14.8	5.9	1.5	1.5	1.5	1.5
82.5°	23.6	20.7	14.8	7.3	2.9	1.5	1.5	1.5	1.5
85°	11.9	8.8	5.9	2.9	1.5	1.5	1.5	1.5	1.5
87.5°	2.9	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)