

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580281

Luminaire Tested: **HCC4S30D010MB-HM43040830-41WDC**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580281  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-7)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4S30D010MB-HM43040830-41WDC  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WIDE DISTRIBUTION, SPECULAR TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 3329.6 lumens  
Efficiency: N/A  
Efficacy: 118.9 lumens/watt  
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.11  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580281  
CATALOG NUMBER: HCC4S30D010MB-HM43040830-41WDC

### Luminous Intensity Polar Plot

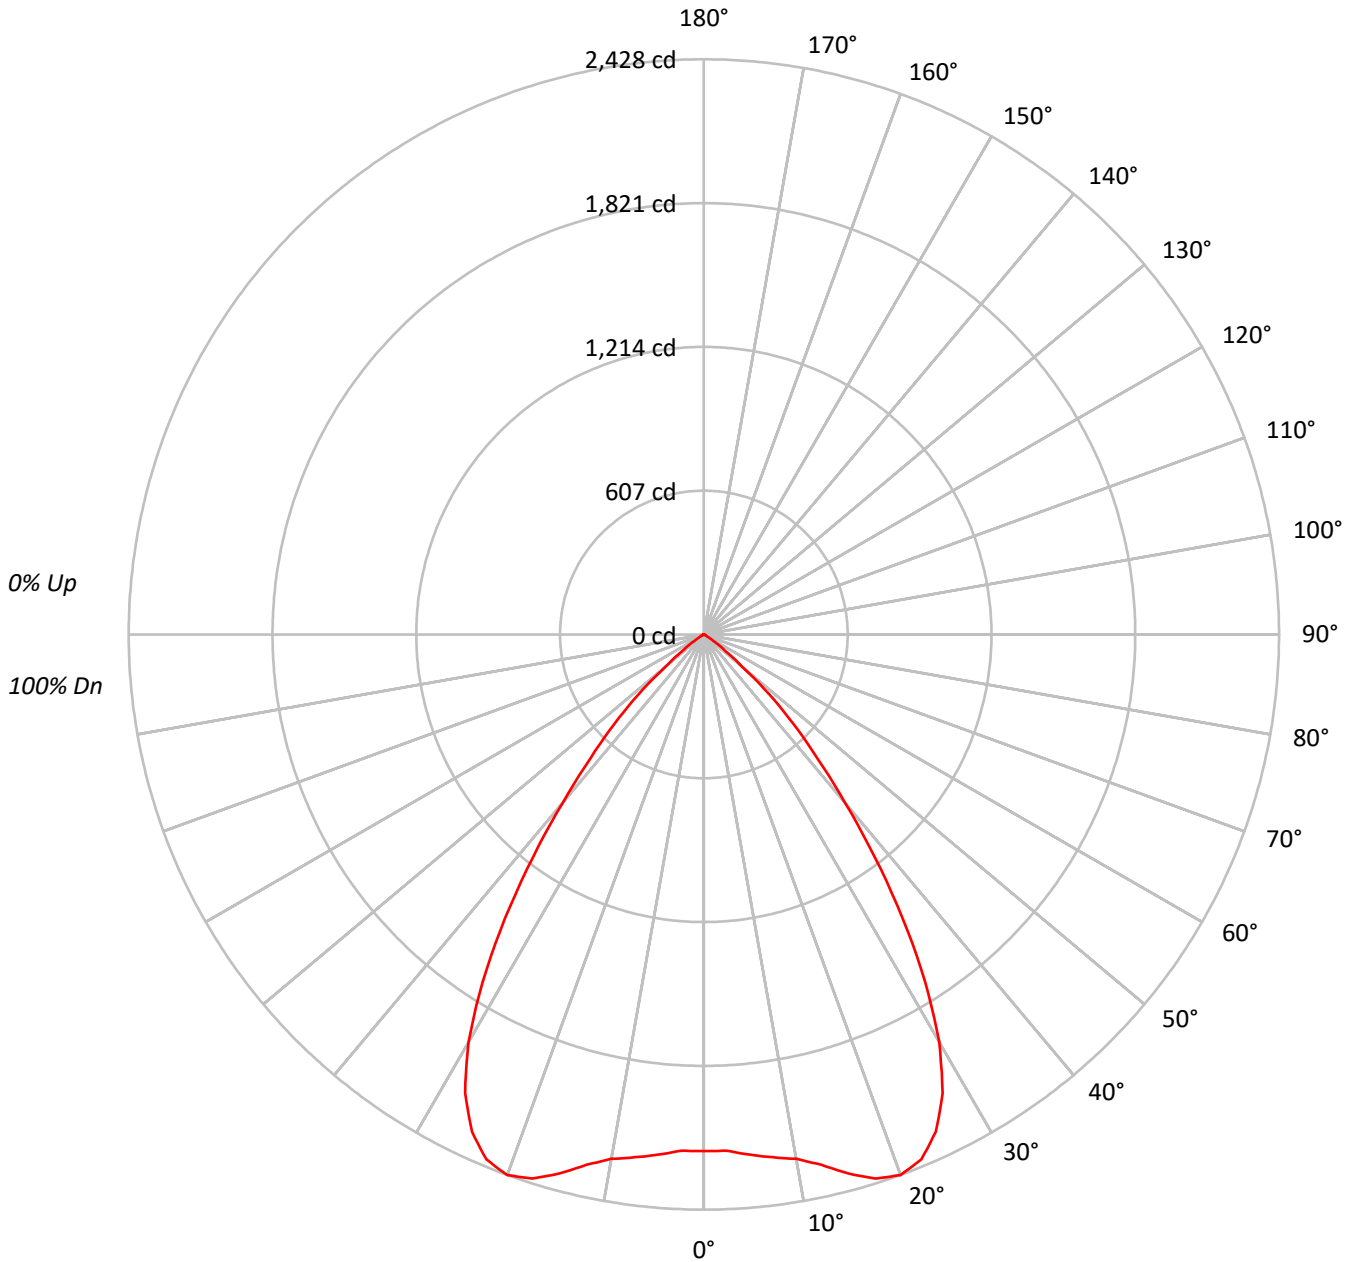

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580281

CATALOG NUMBER: HCC4S30D010MB-HM43040830-41WDC

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	97	95	94	92	92	92	92
2	107	101	97	93	104	100	96	92	96	93	90	93	91	88	91	88	86	85	85	85	85
3	101	93	88	84	98	92	87	83	89	85	82	87	83	80	85	82	79	77	77	77	77
4	95	86	80	76	93	85	79	75	83	78	74	81	77	73	79	75	72	71	71	71	71
5	89	80	73	69	87	79	73	68	77	72	68	75	71	67	74	70	66	65	65	65	65
6	84	74	67	63	82	73	67	62	72	66	62	70	65	62	69	65	61	60	60	60	60
7	79	69	62	57	78	68	62	57	67	61	57	66	60	57	64	60	56	55	55	55	55
8	75	64	57	53	73	63	57	53	62	57	53	61	56	52	60	56	52	51	51	51	51
9	70	60	53	49	69	59	53	49	58	53	49	57	52	48	56	52	48	47	47	47	47
10	67	56	50	45	66	55	49	45	55	49	45	54	49	45	53	48	45	43	43	43	43

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	268992
5°	272929
10°	281496
15°	300790
20°	318703
25°	315228
30°	282918
35°	220189
40°	149165
45°	93132
50°	40297
55°	13505
60°	3404
65°	2306
70°	1406
75°	905
80°	1350
85°	0



TEST NUMBER: P580281  
 CATALOG NUMBER: HCC4S30D010MB-HM43040830-41WDC

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	211.7	6.4
10°-20°	668.6	20.1
20°-30°	1047.6	31.5
30°-40°	904.2	27.2
40°-50°	415.8	12.5
50°-60°	70.6	2.1
60°-70°	8.0	0.2
70°-80°	2.8	0.1
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1928.0	57.9
0°-40°	2832.2	85.1
0°-60°	3318.6	99.7
0°-90°	3329.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3329.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2181	
5°	2204	212
15°	2356	669
25°	2316	1048
35°	1462	904
45°	534	416
55°	63	71
65°	8	8
75°	2	3
85°	0	0
90°	0	



TEST NUMBER: P580281  
CATALOG NUMBER: HCC4S30D010MB-HM43040830-41WDC

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2180.8
2.5°	2180.8
5°	2204.3
7.5°	2225.9
10°	2247.5
12.5°	2292.7
15°	2355.5
17.5°	2408.4
20°	2428.0
22.5°	2398.6
25°	2316.2
27.5°	2182.7
30°	1986.4
32.5°	1739.2
35°	1462.3
37.5°	1183.6
40°	926.4
42.5°	708.6
45°	533.9
47.5°	374.9
50°	210.0
52.5°	115.8
55°	62.8
57.5°	31.4
60°	13.8
62.5°	9.8
65°	7.9
67.5°	5.9
70°	3.9
72.5°	3.9
75°	1.9
77.5°	1.9
80°	1.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)