

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580349

Luminaire Tested: **HCC4S30D010BZ-HM43040930-41WDH**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580349  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-8)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4S30D010BZ-HM43040930-41WDH  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WIDE DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2686.2 lumens  
Efficiency: N/A  
Efficacy: 95.9 lumens/watt  
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.11  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580349  
CATALOG NUMBER: HCC4S30D010BZ-HM43040930-41WDH

### Luminous Intensity Polar Plot

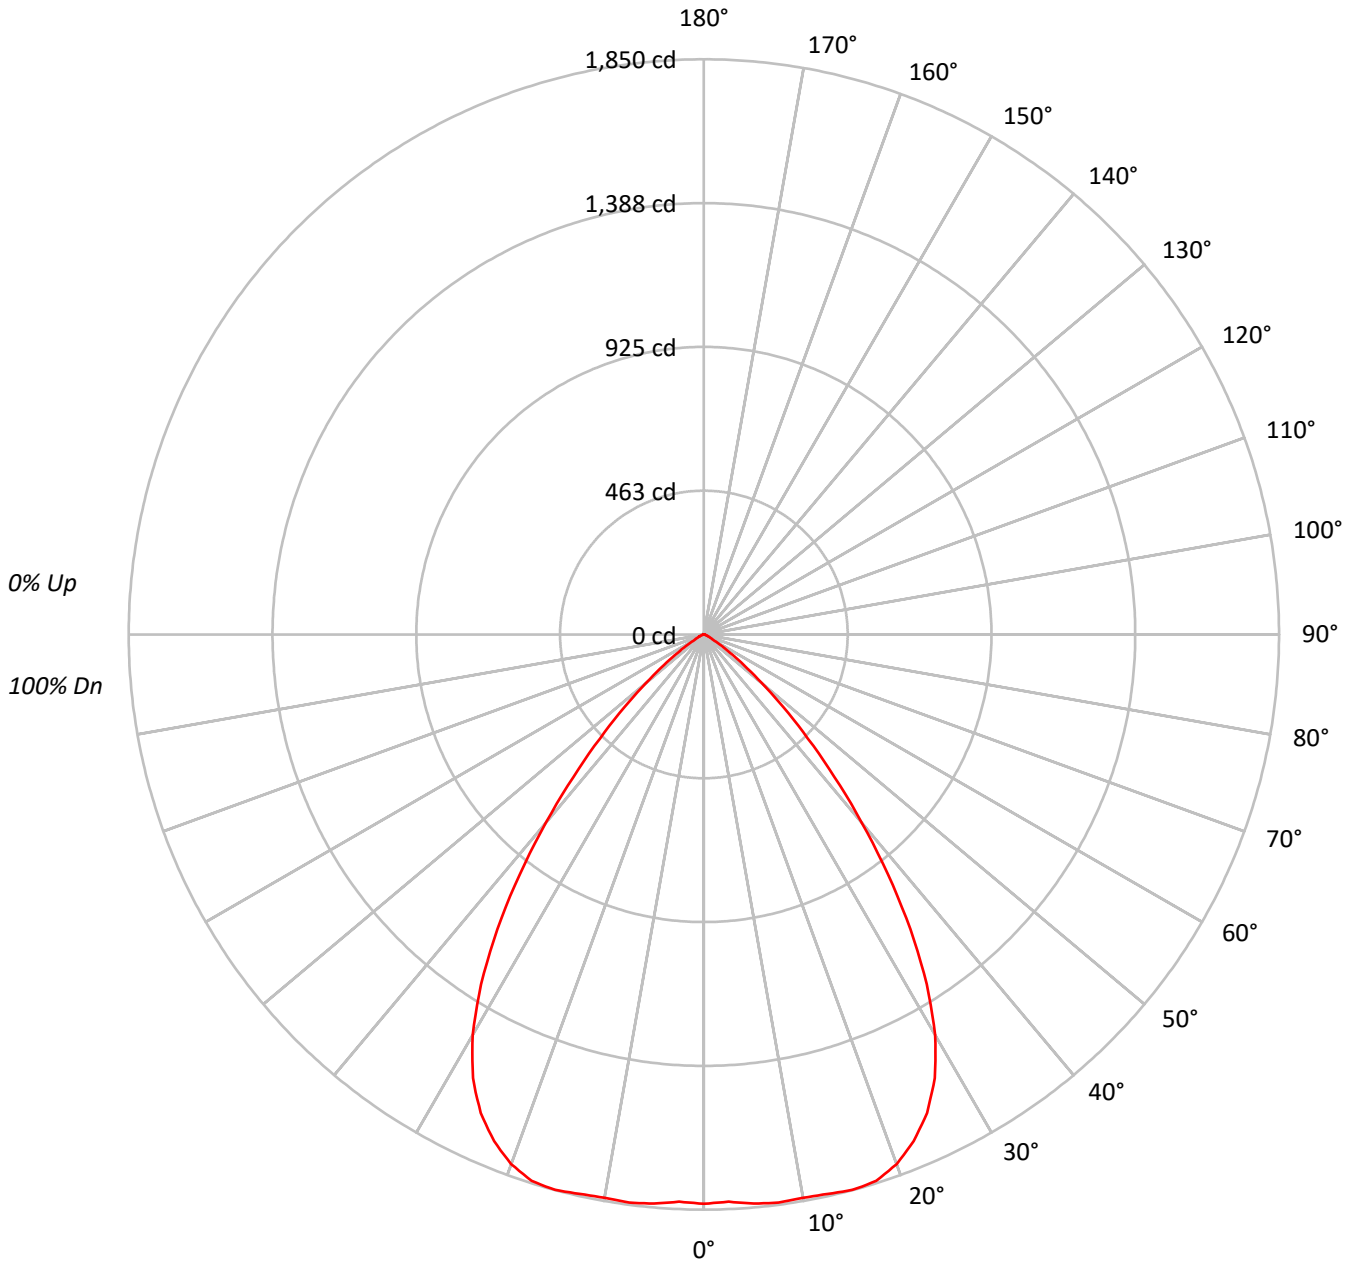

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580349

CATALOG NUMBER: HCC4S30D010BZ-HM43040930-41WDH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									20									20
RC	80									50									30									10									0									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																														
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100											100																	
1	113	110	107	104	110	108	105	103	103	101	100	100	98	97	96	95	94	92											92																	
2	106	101	96	92	104	99	95	91	96	92	89	93	90	87	90	88	86	84											84																	
3	100	93	87	82	98	91	86	82	88	84	80	86	82	79	84	81	78	76											76																	
4	94	85	79	74	92	84	78	74	82	77	73	80	75	72	78	74	71	69											69																	
5	88	79	72	67	86	78	72	67	76	70	66	74	69	66	72	68	65	63											63																	
6	83	73	66	61	81	72	66	61	70	65	61	69	64	60	68	63	60	58											58																	
7	78	68	61	56	77	67	60	56	65	60	55	64	59	55	63	58	55	53											53																	
8	74	63	56	51	72	62	56	51	61	55	51	60	55	51	59	54	51	49											49																	
9	69	59	52	47	68	58	52	47	57	51	47	56	51	47	55	50	47	45											45																	
10	66	55	48	44	65	54	48	44	53	48	44	53	47	44	52	47	43	42											42																	

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	225846
5°	227538
10°	230382
15°	236175
20°	237912
25°	231106
30°	211889
35°	174338
40°	127090
45°	82491
50°	46495
55°	22064
60°	8708
65°	5399
70°	3679
75°	2431
80°	1208
85°	2406



TEST NUMBER: P580349  
 CATALOG NUMBER: HCC4S30D010BZ-HM43040930-41WDH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	175.5	6.5
10°-20°	521.4	19.4
20°-30°	773.4	28.8
30°-40°	714.3	26.6
40°-50°	373.0	13.9
50°-60°	102.2	3.8
60°-70°	19.7	0.7
70°-80°	5.6	0.2
80°-90°	1.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1470.3	54.7
0°-40°	2184.6	81.3
0°-60°	2659.8	99.0
0°-90°	2686.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2686.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1831	
5°	1838	175
15°	1850	521
25°	1698	773
35°	1158	714
45°	473	373
55°	103	102
65°	18	20
75°	5	6
85°	2	1
90°	0	



TEST NUMBER: P580349

CATALOG NUMBER: HCC4S30D010BZ-HM43040930-41WDH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1831.0
2.5°	1825.9
5°	1837.7
7.5°	1842.8
10°	1839.4
12.5°	1842.8
15°	1849.5
17.5°	1842.8
20°	1812.5
22.5°	1763.6
25°	1698.1
27.5°	1608.9
30°	1487.7
32.5°	1334.5
35°	1157.8
37.5°	972.7
40°	789.3
42.5°	621.0
45°	472.9
47.5°	346.6
50°	242.3
52.5°	161.5
55°	102.6
57.5°	60.6
60°	35.3
62.5°	25.3
65°	18.5
67.5°	13.4
70°	10.2
72.5°	6.8
75°	5.1
77.5°	3.4
80°	1.7
82.5°	1.7
85°	1.7
87.5°	0.0
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)