

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580409

Luminaire Tested: **HCC4W35D010MB-HM43040827-41NDW**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P580409
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-3)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4W35D010MB-HM43040827-41NDW
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2989.0 lumens
Efficiency: N/A
Efficacy: 88.7 lumens/watt
Spacing Criteria (0/90/45): 1.03 / 1.03 / 1.01
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580409
CATALOG NUMBER: HCC4W35D010MB-HM43040827-41NDW

Luminous Intensity Polar Plot

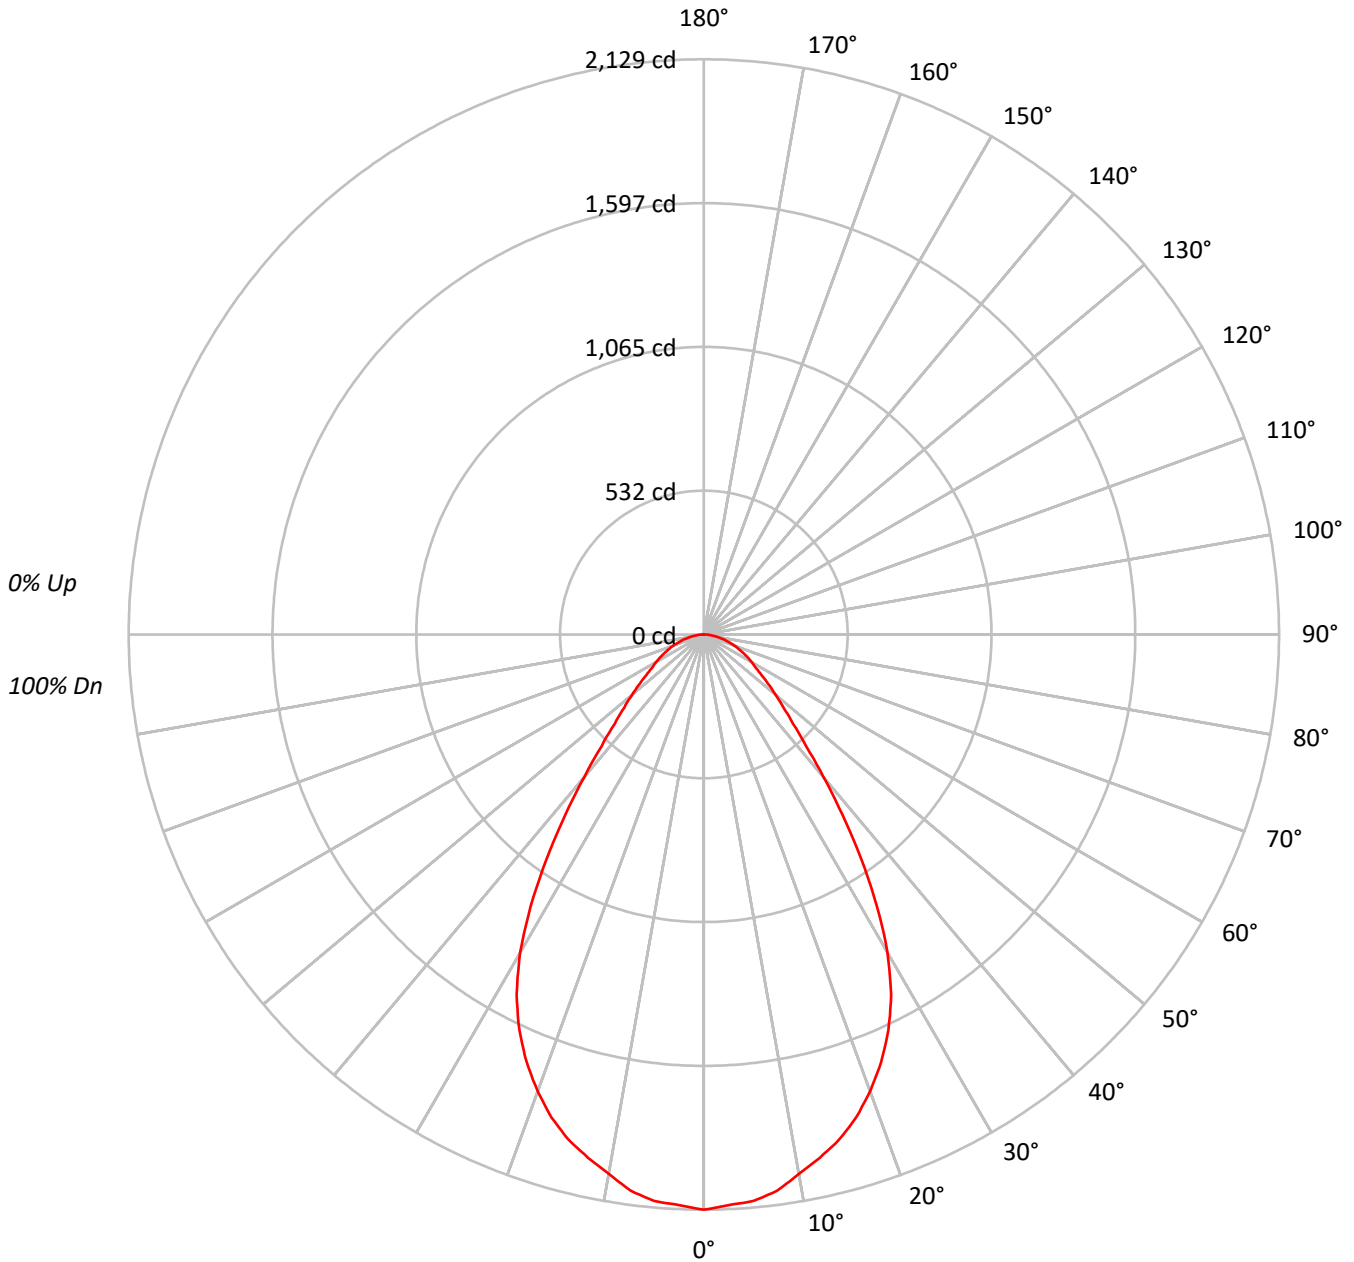

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580409

CATALOG NUMBER: HCC4W35D010MB-HM43040827-41NDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	111	108	104	101	109	105	102	100	101	99	97	98	96	94	94	92	91	89			89
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79			79
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71			71
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64			64
5	85	74	67	61	83	73	66	61	71	65	60	69	64	60	68	63	59	58			58
6	79	68	61	56	78	67	60	55	66	60	55	64	59	55	63	58	54	52			52
7	75	63	56	51	73	62	56	51	61	55	50	60	54	50	59	53	50	48			48
8	70	59	52	47	69	58	51	46	57	51	46	56	50	46	55	50	46	44			44
9	66	55	48	43	65	54	47	43	53	47	43	52	47	43	51	46	42	41			41
10	63	51	44	40	62	51	44	40	50	44	40	49	43	39	48	43	39	38			38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	262603
5°	260647
10°	253866
15°	247170
20°	236100
25°	219973
30°	193687
35°	152761
40°	110892
45°	81462
50°	66279
55°	55590
60°	50374
65°	46289
70°	43096
75°	39317
80°	35516
85°	30711



TEST NUMBER: P580409
 CATALOG NUMBER: HCC4W35D010MB-HM43040827-41NDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	198.5	6.6
10°-20°	542.9	18.2
20°-30°	736.0	24.6
30°-40°	631.5	21.1
40°-50°	372.9	12.5
50°-60°	236.3	7.9
60°-70°	158.8	5.3
70°-80°	87.6	2.9
80°-90°	24.5	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1477.4	49.4
0°-40°	2108.9	70.6
0°-60°	2718.1	90.9
0°-90°	2989.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2989.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2129	
5°	2105	198
15°	1936	543
25°	1616	736
35°	1014	632
45°	467	373
55°	258	236
65°	159	159
75°	82	88
85°	22	25
90°	0	



TEST NUMBER: P580409
CATALOG NUMBER: HCC4W35D010MB-HM43040827-41NDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2129.0
2.5°	2113.8
5°	2105.1
7.5°	2076.8
10°	2026.9
12.5°	1983.4
15°	1935.6
17.5°	1874.8
20°	1798.7
22.5°	1714.1
25°	1616.3
27.5°	1501.1
30°	1359.9
32.5°	1192.7
35°	1014.5
37.5°	842.9
40°	688.7
42.5°	560.5
45°	467.0
47.5°	399.7
50°	345.4
52.5°	299.8
55°	258.5
57.5°	225.9
60°	204.2
62.5°	182.5
65°	158.6
67.5°	139.0
70°	119.5
72.5°	99.9
75°	82.5
77.5°	65.2
80°	50.0
82.5°	34.7
85°	21.7
87.5°	8.7
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)