

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580429

Luminaire Tested: **HCC4S35D010MW-HM43040830-41WDW**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P580429
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4S35D010MW-HM43040830-41WDW
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WIDE DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3501.7 lumens
Efficiency: N/A
Efficacy: 103.9 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.07 / 1.04
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580429
CATALOG NUMBER: HCC4S35D010MW-HM43040830-41WDW

Luminous Intensity Polar Plot

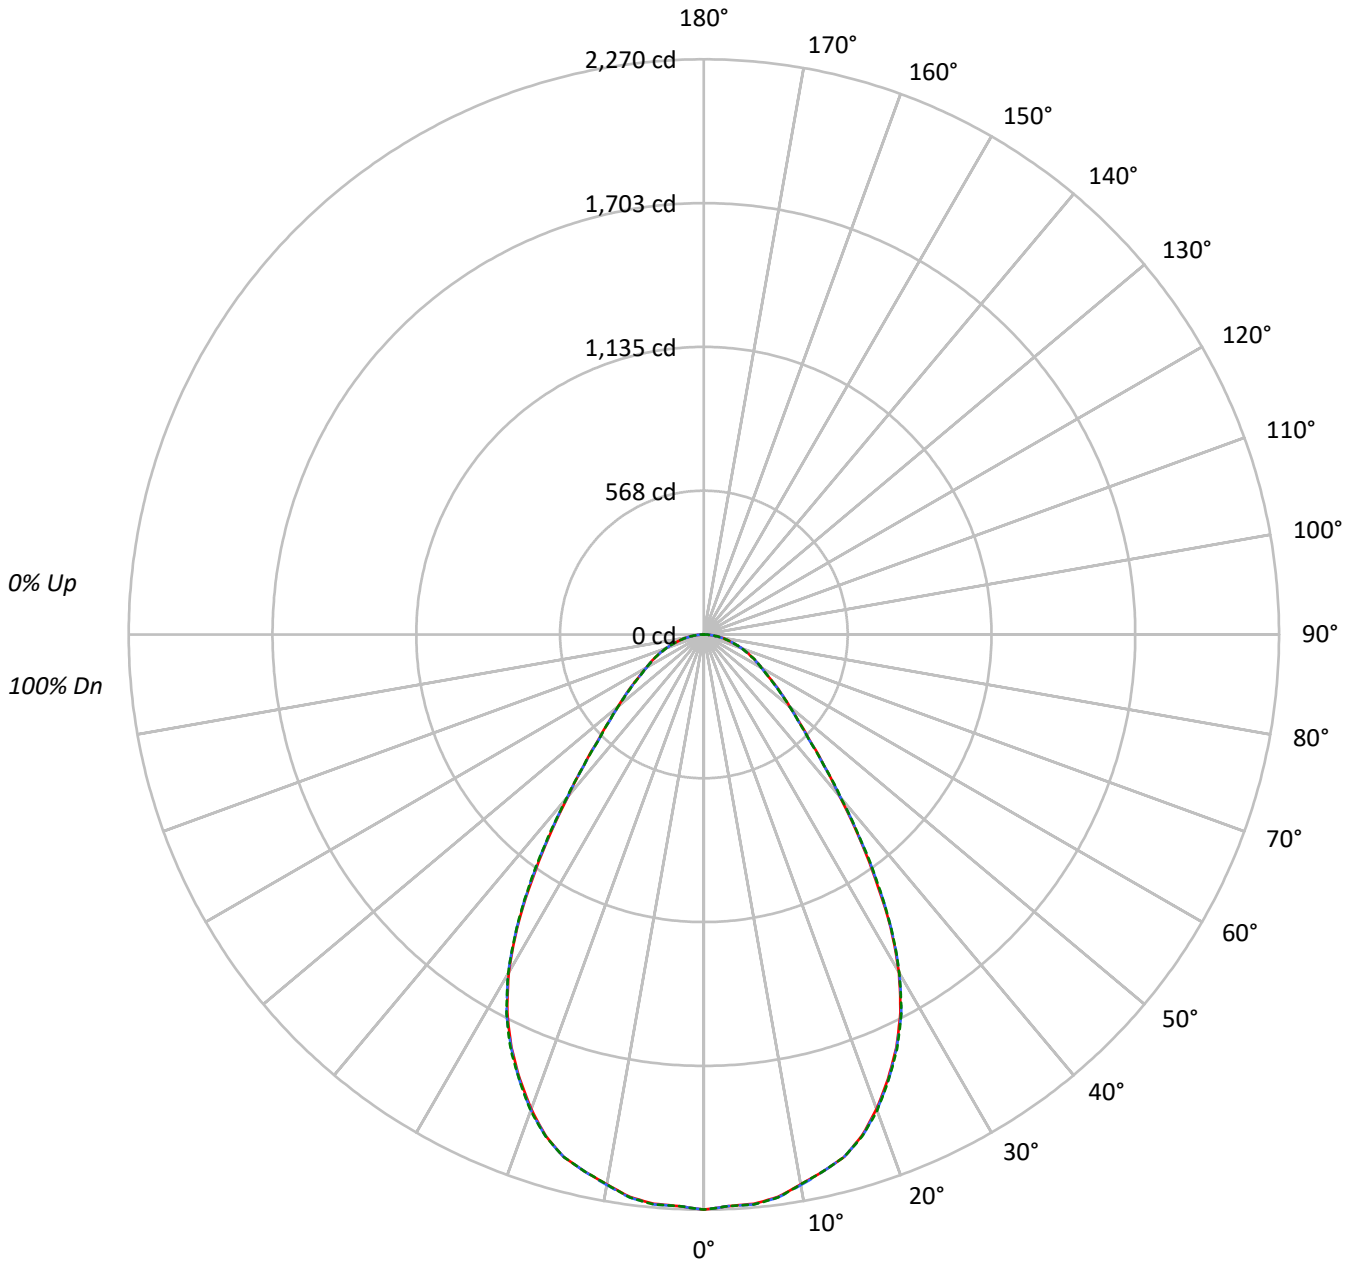

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580429

CATALOG NUMBER: HCC4S35D010MW-HM43040830-41WDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89																			
2	103	97	91	87	101	95	90	86	91	87	84	88	85	82	85	83	80	78																			
3	96	87	81	76	94	86	80	75	83	78	74	81	76	72	78	74	71	69																			
4	90	80	72	67	87	78	72	66	76	70	66	74	69	65	72	68	64	62																			
5	84	73	65	60	82	72	65	59	70	64	59	68	63	58	66	62	58	56																			
6	78	67	59	54	77	66	59	54	64	58	53	63	57	53	61	56	53	51																			
7	73	62	54	49	72	61	54	49	60	53	49	58	53	48	57	52	48	46																			
8	69	57	50	45	68	57	50	45	55	49	45	54	49	44	53	48	44	42																			
9	65	53	46	41	64	53	46	41	52	45	41	51	45	41	50	45	41	39																			
10	61	50	43	38	60	49	43	38	48	42	38	48	42	38	47	42	38	36																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	279945	279945	279945
5°	279256	279554	279554
10°	276010	276311	276010
15°	272709	272709	272709
20°	261513	262130	262445
25°	244607	244920	245573
30°	219181	219851	219851
35°	177952	179353	179714
40°	134288	135044	135431
45°	102866	102464	102464
50°	84759	84317	84317
55°	72750	72256	72256
60°	64904	64337	64337
65°	61028	61028	61028
70°	56764	56764	56764
75°	51517	52613	51517
80°	48373	46739	48373
85°	39910	39910	39910



TEST NUMBER: P580429
 CATALOG NUMBER: HCC4S35D010MW-HM43040830-41WDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	213.8	6.1
10°-20°	598.4	17.1
20°-30°	822.3	23.5
30°-40°	739.3	21.1
40°-50°	467.2	13.3
50°-60°	305.0	8.7
60°-70°	206.6	5.9
70°-80°	116.3	3.3
80°-90°	32.7	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1634.5	46.7
0°-40°	2373.9	67.8
0°-60°	3146.0	89.8
0°-90°	3501.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3501.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2270	2270	2270	2270	2270	
5°	2255	2255	2258	2258	2258	214
15°	2136	2136	2136	2136	2136	598
25°	1797	1800	1800	1804	1804	820
35°	1182	1186	1191	1196	1194	736
45°	590	587	587	587	587	468
55°	338	338	336	338	336	306
65°	209	209	209	209	209	207
75°	108	110	110	110	108	116
85°	28	28	28	28	28	33
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580429

CATALOG NUMBER: HCC4S35D010MW-HM43040830-41WDW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2269.6	2269.6	2269.6	2269.6	2269.6
2.5°	2257.8	2257.8	2257.8	2257.8	2257.8
5°	2255.4	2255.4	2257.8	2257.8	2257.8
7.5°	2239.0	2241.4	2241.4	2241.4	2241.4
10°	2203.7	2203.7	2206.1	2206.1	2203.7
12.5°	2170.9	2170.9	2170.9	2173.3	2170.9
15°	2135.6	2135.6	2135.6	2135.6	2135.6
17.5°	2074.6	2076.9	2076.9	2076.9	2076.9
20°	1992.3	1997.0	1997.0	1999.4	1999.4
22.5°	1898.3	1900.7	1903.0	1905.4	1903.0
25°	1797.3	1799.6	1799.6	1804.4	1804.4
27.5°	1679.8	1682.2	1686.9	1686.9	1686.9
30°	1538.9	1541.2	1543.6	1543.6	1543.6
32.5°	1372.1	1372.1	1376.8	1379.1	1376.8
35°	1181.8	1186.5	1191.1	1195.8	1193.5
37.5°	1000.8	1005.5	1007.9	1007.9	1010.3
40°	834.0	838.7	838.7	843.4	841.1
42.5°	702.5	700.1	700.1	704.9	702.5
45°	589.7	587.4	587.4	587.4	587.4
47.5°	507.5	505.1	505.1	505.1	505.1
50°	441.7	439.4	439.4	439.4	439.4
52.5°	387.7	385.3	385.3	385.3	382.9
55°	338.3	338.3	336.0	338.3	336.0
57.5°	293.7	293.7	293.7	293.7	293.7
60°	263.1	260.8	260.8	260.8	260.8
62.5°	234.9	234.9	234.9	234.9	234.9
65°	209.1	209.1	209.1	209.1	209.1
67.5°	183.2	180.9	183.2	183.2	180.9
70°	157.4	155.1	157.4	157.4	157.4
72.5°	131.6	131.6	131.6	133.9	131.6
75°	108.1	110.4	110.4	110.4	108.1
77.5°	86.9	89.2	86.9	86.9	86.9
80°	68.1	65.8	65.8	65.8	68.1
82.5°	47.0	47.0	47.0	47.0	47.0
85°	28.2	28.2	28.2	28.2	28.2
87.5°	11.8	11.8	11.8	11.8	11.8
90°	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)