

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580484

Luminaire Tested: **HCC4W35D010BZ-HM43040927-41RWWC**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P580484
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-14)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4W35D010BZ-HM43040927-41RWWC
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2894.5 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.15 / 1.21
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P580484
CATALOG NUMBER: HCC4W35D010BZ-HM43040927-41RWWC

Luminous Intensity Polar Plot

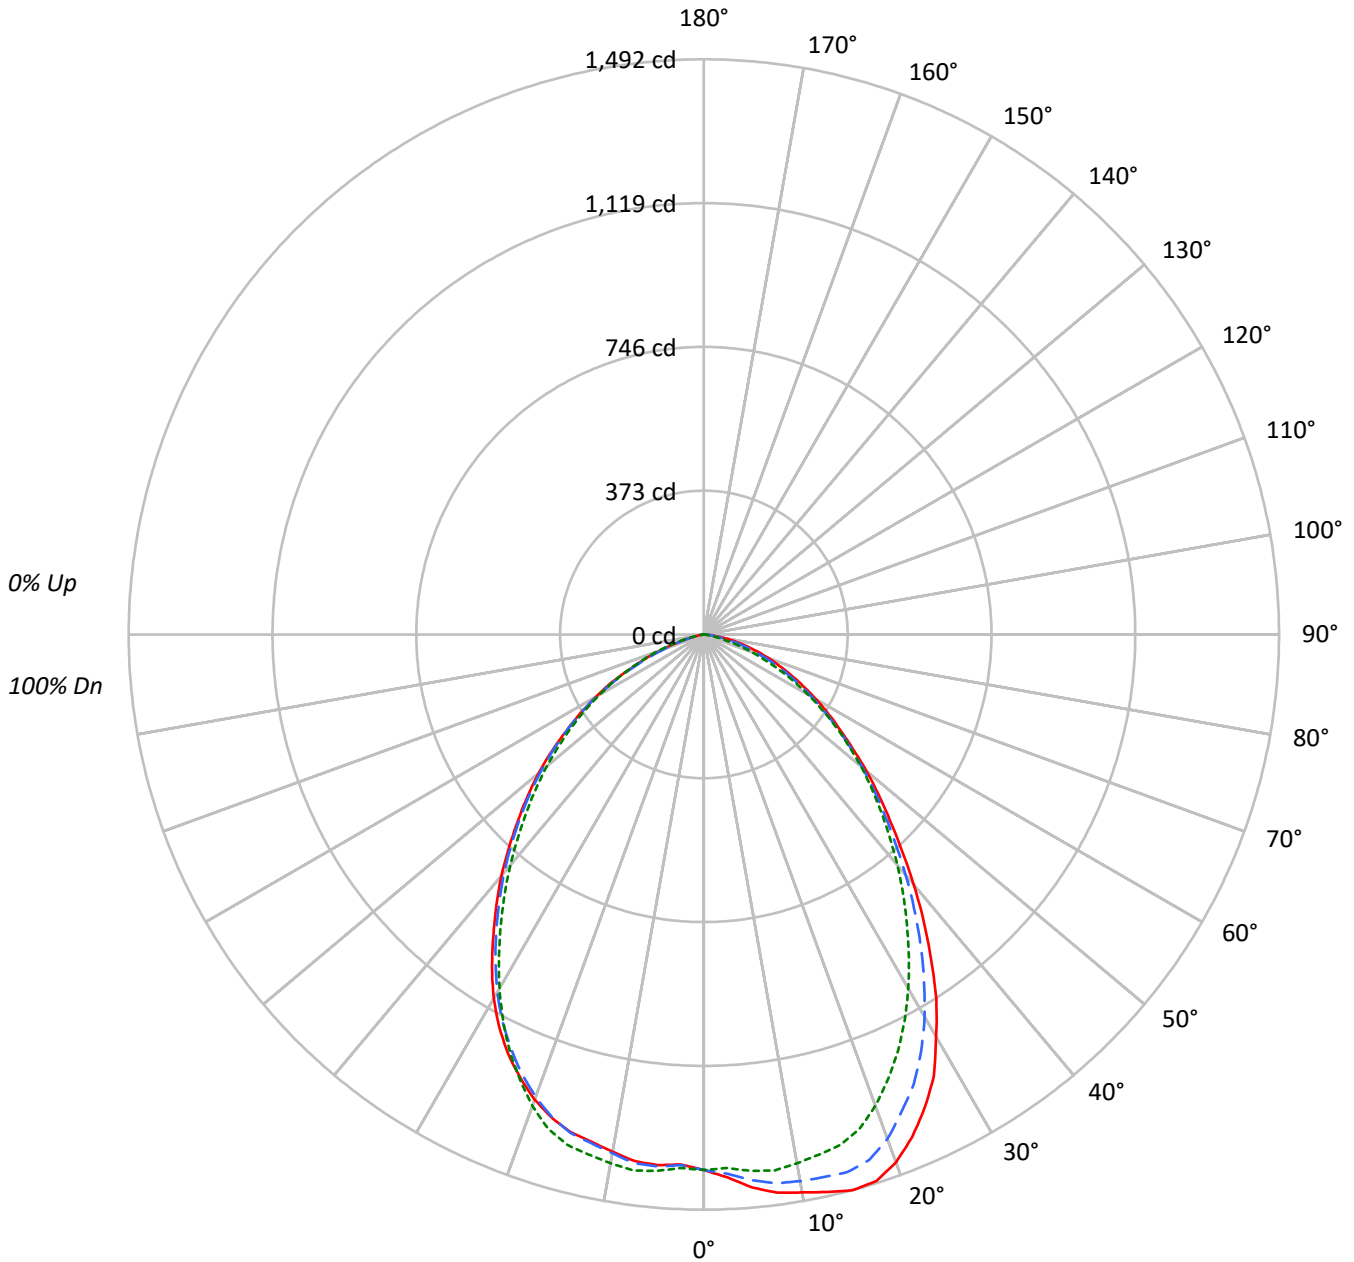

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580484

CATALOG NUMBER: HCC4W35D010BZ-HM43040927-41RWWC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88	88	88	88
2	102	95	90	85	100	94	88	84	90	86	82	87	83	80	84	81	78	76	76	76	76
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67	67	67	67
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58	58	58	58
5	81	70	61	56	79	68	61	55	66	60	55	65	59	54	63	58	54	52	52	52	52
6	75	63	55	49	74	62	55	49	61	54	49	59	53	48	58	52	48	46	46	46	46
7	70	58	50	44	69	57	49	44	56	49	44	54	48	44	53	47	43	41	41	41	41
8	66	53	45	40	64	53	45	40	51	44	40	50	44	39	49	43	39	37	37	37	37
9	62	49	42	36	60	49	41	36	47	41	36	46	40	36	45	40	36	34	34	34	34
10	58	46	38	33	57	45	38	33	44	38	33	43	37	33	42	37	33	31	31	31	31

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	171327	171327	171327
5°	178259	172910	171053
10°	184078	174433	170676
15°	190549	174983	170654
20°	191196	170745	168514
25°	184438	162214	163493
30°	171625	151044	155317
35°	154613	138215	143304
40°	136300	125722	131470
45°	119193	113279	118861
50°	105540	101933	107325
55°	92836	90018	93631
60°	82888	76869	79188
65°	72848	62458	61349
70°	63653	46054	41942
75°	52756	27736	22351
80°	39991	10726	6606
85°	18681	2689	2689



TEST NUMBER: P580484

CATALOG NUMBER: HCC4W35D010BZ-HM43040927-41RWWC

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	134.0	4.6
10°-20°	391.0	13.5
20°-30°	566.2	19.6
30°-40°	597.4	20.6
40°-50°	517.0	17.9
50°-60°	383.0	13.2
60°-70°	220.8	7.6
70°-80°	77.1	2.7
80°-90°	8.1	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1091.1	37.7
0°-40°	1688.5	58.3
0°-60°	2588.5	89.4
0°-90°	2894.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2894.5	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1389	1389	1389	1389	1389	
5°	1440	1421	1396	1385	1382	138
15°	1492	1443	1370	1338	1336	420
25°	1355	1288	1192	1184	1201	620
35°	1027	980	918	938	952	641
45°	683	664	649	674	681	530
55°	432	422	419	434	435	389
65°	250	235	214	203	210	249
75°	111	94	58	47	47	119
85°	13	8	2	2	2	20
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P580484

CATALOG NUMBER: HCC4W35D010BZ-HM43040927-41RWWC

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1389.0	1389.0	1389.0	1389.0	1389.0	1389.0	1389.0	1389.0	1389.0
2.5°	1409.6	1405.9	1400.3	1392.7	1385.2	1379.6	1377.7	1375.9	1375.9
5°	1439.7	1432.2	1421.0	1405.9	1396.5	1390.8	1385.2	1381.5	1381.5
7.5°	1460.3	1452.8	1435.9	1415.2	1402.2	1390.8	1383.4	1377.7	1377.7
10°	1469.7	1460.3	1439.7	1413.4	1392.7	1377.7	1366.4	1362.7	1362.7
12.5°	1481.0	1469.7	1441.5	1407.8	1381.5	1362.7	1351.5	1347.7	1347.7
15°	1492.2	1479.1	1443.4	1404.0	1370.3	1347.7	1338.3	1336.4	1336.4
17.5°	1486.6	1469.7	1428.4	1381.5	1344.0	1321.4	1312.0	1312.0	1314.0
20°	1456.6	1439.7	1392.7	1340.1	1300.8	1283.8	1276.4	1280.1	1283.8
22.5°	1411.5	1390.8	1340.1	1289.6	1248.2	1233.3	1233.3	1238.9	1244.5
25°	1355.2	1336.4	1287.7	1231.3	1191.9	1180.6	1184.4	1193.8	1201.3
27.5°	1291.4	1270.8	1220.1	1167.5	1128.0	1122.4	1131.9	1145.0	1148.7
30°	1205.0	1188.2	1145.0	1094.3	1060.5	1058.7	1071.7	1081.2	1090.5
32.5°	1122.4	1103.7	1062.4	1013.6	989.2	991.0	1006.1	1017.3	1023.0
35°	1026.8	1009.8	979.8	940.3	917.9	921.6	938.5	949.8	951.7
37.5°	936.6	925.4	895.4	865.3	848.4	855.9	871.0	884.0	884.0
40°	846.5	837.2	814.7	790.3	780.8	790.3	805.2	816.5	816.5
42.5°	760.2	754.5	735.8	718.9	713.3	726.4	739.6	748.9	747.0
45°	683.3	677.7	664.5	651.4	649.4	662.6	673.8	679.5	681.4
47.5°	613.8	610.0	598.8	589.4	589.4	602.6	611.9	617.5	619.4
50°	550.0	546.3	536.8	529.3	531.2	544.4	551.9	557.5	559.3
52.5°	486.1	484.2	476.8	467.4	473.0	482.4	491.8	495.6	497.4
55°	431.7	431.7	422.3	414.9	418.6	427.9	433.6	435.4	435.4
57.5°	382.9	381.0	369.8	362.3	364.2	373.5	377.3	379.1	379.1
60°	336.0	334.2	322.8	311.6	311.6	317.2	319.1	321.0	321.0
62.5°	290.9	289.1	275.9	266.5	262.8	260.9	260.9	264.7	272.1
65°	249.6	247.7	234.6	219.6	214.0	208.4	202.8	206.5	210.2
67.5°	212.1	208.4	195.2	182.1	168.9	159.5	150.2	155.8	163.3
70°	176.5	172.6	157.7	142.6	127.7	112.6	105.1	112.6	116.3
72.5°	142.6	138.9	123.9	108.9	90.1	75.1	73.2	75.1	77.0
75°	110.7	108.9	93.9	77.0	58.2	46.9	46.9	46.9	46.9
77.5°	82.6	78.8	63.8	48.8	33.8	26.3	24.4	24.4	24.4
80°	56.3	52.6	39.5	28.1	15.1	11.2	11.2	9.3	9.3
82.5°	31.9	30.0	20.7	11.2	5.6	3.7	3.7	3.7	3.7
85°	13.2	11.2	7.5	3.7	1.9	1.9	1.9	1.9	1.9
87.5°	1.9	1.9	1.9	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)