

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580523

Luminaire Tested: **HCC4W35D010BZ-HM43040935-41WWW**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580523  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W35D010BZ-HM43040935-41WWW  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3189.7 lumens  
Efficiency: N/A  
Efficacy: 94.7 lumens/watt  
Spacing Criteria (0/90/45): 1.06 / 1.03 / 1.1  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 33.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580523  
CATALOG NUMBER: HCC4W35D010BZ-HM43040935-41WWW

### Luminous Intensity Polar Plot

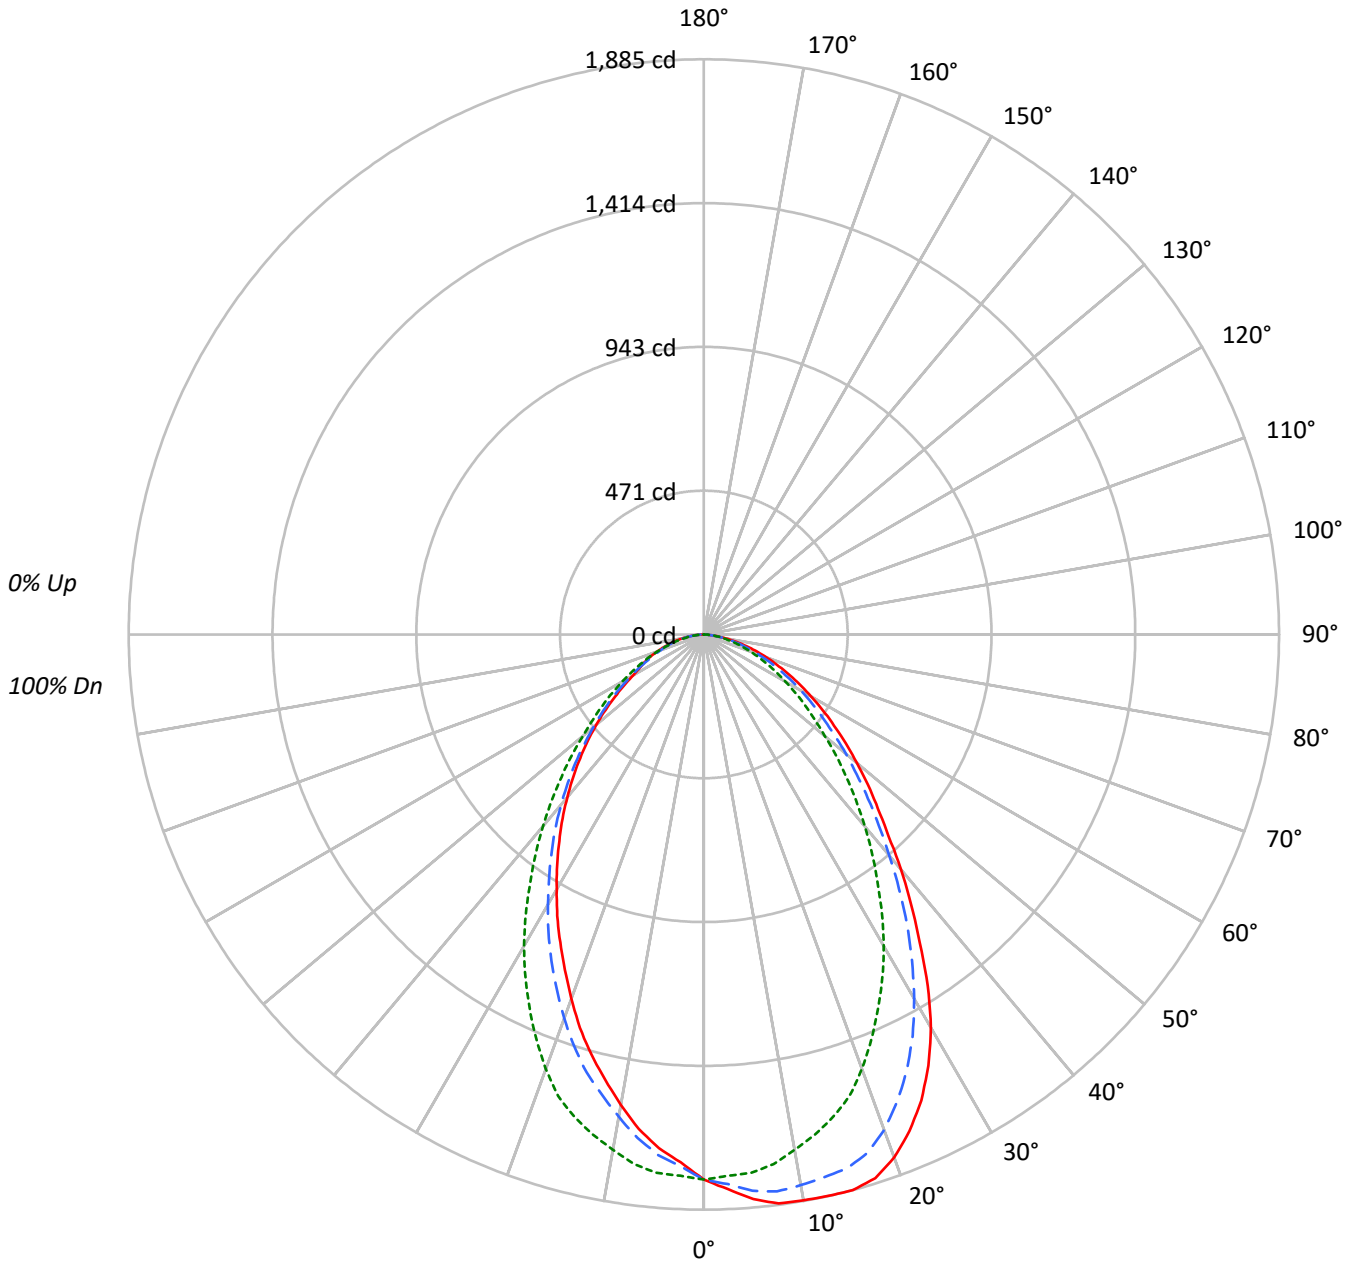

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580523

CATALOG NUMBER: HCC4W35D010BZ-HM43040935-41WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	106	103	100	108	104	101	98	100	97	95	96	94	92	93	91	89	87					87			
2	102	95	89	84	100	93	88	83	90	85	81	87	83	80	84	81	78	76					76			
3	94	85	78	72	92	84	77	72	81	75	71	78	73	69	76	72	68	66					66			
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58					58			
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52					52			
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47					47			
7	71	58	50	45	69	58	50	45	56	49	44	55	49	44	53	48	44	42					42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38					38			
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35					35			
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	220308	220308	220308
5°	230002	219329	209188
10°	235818	214763	196076
15°	240696	209040	181942
20°	239421	198861	166597
25°	229364	183894	151585
30°	211889	167907	137371
35°	185737	149342	124347
40°	161725	131953	111987
45°	140753	115094	100075
50°	125401	99189	88309
55°	112061	87201	76385
60°	100033	76203	65817
65°	88930	66865	62546
70°	78078	57594	58387
75°	66100	49087	54091
80°	50788	41767	49296
85°	29720	32833	41608



TEST NUMBER: P580523  
 CATALOG NUMBER: HCC4W35D010BZ-HM43040935-41WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	167.4	5.2
10°-20°	461.8	14.5
20°-30°	631.0	19.8
30°-40°	633.6	19.9
40°-50°	524.1	16.4
50°-60°	379.8	11.9
60°-70°	240.6	7.5
70°-80°	121.6	3.8
80°-90°	29.8	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1260.2	39.5
0°-40°	1893.8	59.4
0°-60°	2797.7	87.7
0°-90°	3189.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3189.7	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1786	1786	1786	1786	1786	
5°	1858	1830	1771	1713	1690	178
15°	1885	1811	1637	1486	1425	530
25°	1685	1574	1351	1181	1114	770
35°	1234	1160	992	870	826	773
45°	807	761	660	595	574	628
55°	521	475	406	370	355	469
65°	305	271	229	206	214	303
75°	139	120	103	107	114	148
85°	21	21	23	27	29	29
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580523

CATALOG NUMBER: HCC4W35D010BZ-HM43040935-41WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1786.1	1786.1	1786.1	1786.1	1786.1	1786.1	1786.1	1786.1	1786.1
2.5°	1819.8	1813.5	1803.0	1790.4	1775.7	1758.8	1744.1	1735.7	1731.5
5°	1857.6	1849.2	1830.3	1803.0	1771.4	1740.0	1712.6	1695.8	1689.5
7.5°	1880.7	1868.1	1840.8	1798.7	1750.4	1704.2	1664.3	1641.2	1634.9
10°	1882.8	1868.1	1832.3	1775.7	1714.7	1653.7	1605.4	1571.8	1565.5
12.5°	1884.9	1866.1	1821.9	1754.7	1679.0	1603.4	1544.5	1504.6	1494.0
15°	1884.9	1866.1	1811.3	1731.5	1637.0	1550.8	1485.7	1439.4	1424.8
17.5°	1868.1	1847.1	1782.0	1689.5	1586.5	1489.9	1414.2	1365.9	1351.2
20°	1824.0	1800.9	1727.4	1626.4	1515.0	1414.2	1338.6	1288.1	1269.2
22.5°	1761.0	1733.7	1655.9	1546.6	1435.2	1332.3	1258.8	1206.2	1189.4
25°	1685.3	1658.0	1573.9	1466.7	1351.2	1254.5	1181.0	1132.7	1113.8
27.5°	1592.8	1563.4	1481.4	1374.3	1267.1	1170.4	1103.2	1059.0	1040.1
30°	1487.7	1456.3	1378.5	1275.5	1178.9	1086.5	1021.3	985.5	964.5
32.5°	1365.9	1338.6	1269.2	1176.7	1086.5	998.1	943.5	912.0	895.2
35°	1233.5	1218.8	1160.0	1080.1	991.8	918.3	870.0	840.5	825.8
37.5°	1115.8	1101.1	1050.7	983.4	905.7	838.4	798.5	773.3	760.7
40°	1004.4	991.8	943.5	886.7	819.5	760.7	727.1	708.1	695.5
42.5°	895.2	888.9	849.0	796.5	737.6	687.1	659.8	645.1	634.6
45°	806.9	798.5	760.7	710.3	659.8	617.8	594.7	584.1	573.7
47.5°	729.1	718.7	678.8	634.6	588.4	550.5	529.5	519.1	514.8
50°	653.5	643.0	607.3	563.1	516.9	489.6	472.8	462.3	460.2
52.5°	586.3	575.8	535.8	493.8	458.1	435.0	420.3	409.8	405.5
55°	521.1	508.5	474.9	435.0	405.5	384.5	369.8	359.3	355.2
57.5°	462.3	449.7	420.3	382.5	355.2	336.2	323.6	313.1	308.9
60°	405.5	395.1	367.8	332.0	308.9	292.1	279.4	271.1	266.8
62.5°	353.0	344.6	317.3	285.8	266.8	252.1	241.7	233.2	237.5
65°	304.7	296.3	271.1	243.8	229.1	214.3	205.9	205.9	214.3
67.5°	258.5	250.1	229.1	205.9	193.3	182.9	176.5	182.9	189.2
70°	216.5	208.1	189.2	170.2	159.7	151.3	151.3	157.6	161.9
72.5°	176.5	168.2	153.4	138.7	130.3	124.0	130.3	134.5	138.7
75°	138.7	132.4	119.8	109.3	103.0	100.8	107.1	111.4	113.5
77.5°	103.0	98.8	90.4	81.9	77.8	79.8	86.2	88.2	90.4
80°	71.5	69.4	63.1	58.8	58.8	60.9	65.2	67.2	69.4
82.5°	44.2	44.2	39.9	37.9	39.9	44.2	46.2	48.3	48.3
85°	21.0	23.2	21.0	21.0	23.2	27.3	27.3	29.4	29.4
87.5°	6.3	6.3	8.4	8.4	10.5	10.5	10.5	10.5	12.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)