

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580540

Luminaire Tested: **HCC4W35D010MW-HM43040940-41WWBB**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580540  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-17)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W35D010MW-HM43040940-41WWBB  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE BAFFLE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2549.1 lumens  
Efficiency: N/A  
Efficacy: 75.6 lumens/watt  
Spacing Criteria (0/90/45): 1.11 / 1.04 / 1.12  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 33.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580540  
CATALOG NUMBER: HCC4W35D010MW-HM43040940-41WWBB

### Luminous Intensity Polar Plot

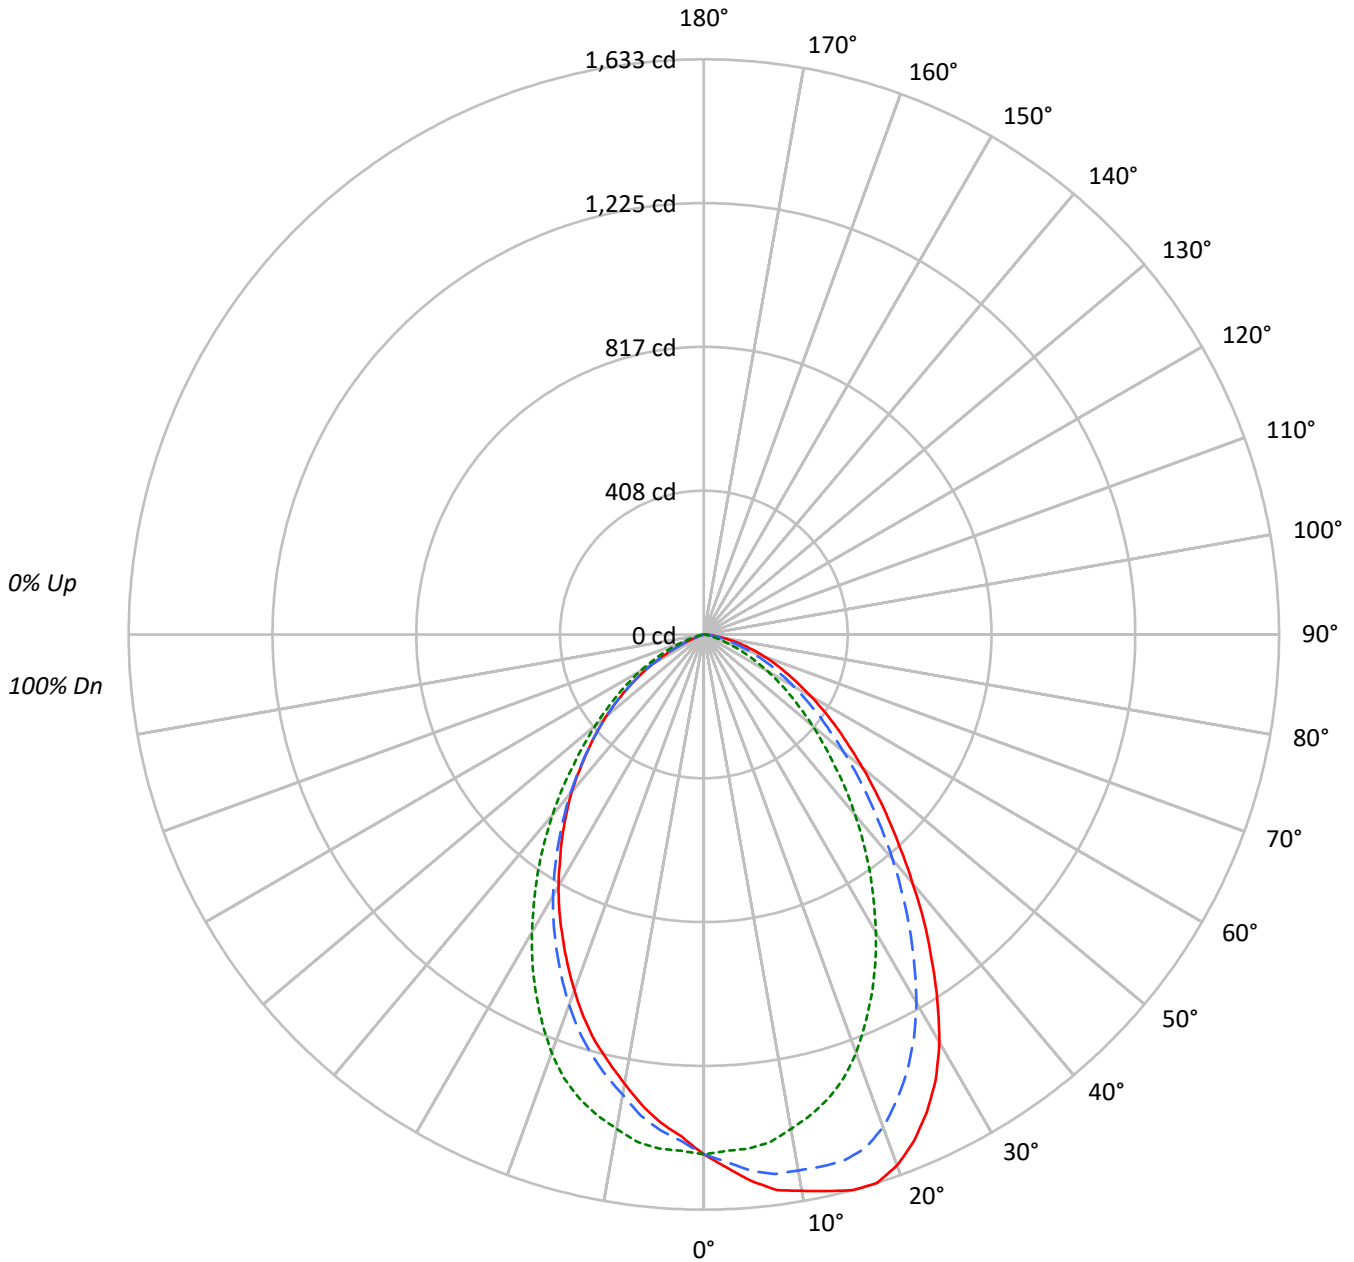

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580540

CATALOG NUMBER: HCC4W35D010MW-HM43040940-41WWBB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89					89			
2	103	97	91	87	101	95	90	86	92	87	84	88	85	82	85	83	80	78					78			
3	96	87	80	75	94	86	79	74	83	78	73	80	76	72	78	74	71	69					69			
4	89	79	72	66	87	78	71	65	75	69	65	73	68	64	71	67	63	61					61			
5	83	72	64	58	81	71	64	58	69	62	58	67	61	57	65	60	56	55					55			
6	77	66	58	52	75	65	57	52	63	57	52	61	56	51	60	55	51	49					49			
7	72	60	53	47	71	59	52	47	58	51	47	57	51	46	55	50	46	44					44			
8	68	56	48	43	66	55	48	43	54	47	42	53	47	42	51	46	42	40					40			
9	64	52	44	39	62	51	44	39	50	43	39	49	43	39	48	43	39	37					37			
10	60	48	41	36	59	47	41	36	46	40	36	46	40	36	45	39	36	34					34			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	182033	182033	182033
5°	192857	181416	172328
10°	200873	178517	162222
15°	208554	174242	152534
20°	210517	165875	141080
25°	203696	153422	129142
30°	190454	139037	117502
35°	169746	123609	105585
40°	148393	107478	93969
45°	129275	91178	81288
50°	112775	77352	69695
55°	98857	64105	56450
60°	86490	51805	41419
65°	75358	38613	23290
70°	65853	24956	7573
75°	54043	13010	2002
80°	40204	5967	1492
85°	23634	2972	2972



TEST NUMBER: P580540

CATALOG NUMBER: HCC4W35D010MW-HM43040940-41WWBB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	139.3	5.5
10°-20°	389.8	15.3
20°-30°	539.0	21.1
30°-40°	541.9	21.3
40°-50°	437.3	17.2
50°-60°	295.7	11.6
60°-70°	150.5	5.9
70°-80°	48.2	1.9
80°-90°	7.4	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1068.1	41.9
0°-40°	1610.0	63.2
0°-60°	2343.1	91.9
0°-90°	2549.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2549.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	1476	1476	1476	1476	1476	
5°	1558	1528	1465	1413	1392	150
15°	1633	1545	1364	1234	1194	460
25°	1497	1367	1127	989	949	685
35°	1127	1018	821	718	701	704
45°	741	663	523	466	466	574
55°	460	397	298	260	262	413
65°	258	210	132	86	80	259
75°	113	80	27	6	4	122
85°	17	8	2	2	2	23
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580540

CATALOG NUMBER: HCC4W35D010MW-HM43040940-41WWBB

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1475.8	1475.8	1475.8	1475.8	1475.8	1475.8	1475.8	1475.8	1475.8
2.5°	1515.7	1507.3	1498.9	1484.1	1467.4	1450.6	1440.1	1431.6	1427.5
5°	1557.6	1547.2	1528.3	1496.7	1465.2	1435.9	1412.8	1398.1	1391.8
7.5°	1591.2	1576.5	1545.1	1501.0	1452.7	1406.5	1377.1	1356.1	1347.7
10°	1603.8	1587.1	1545.1	1486.3	1425.3	1368.7	1326.8	1305.8	1295.2
12.5°	1618.6	1599.7	1547.2	1473.7	1398.1	1330.9	1282.6	1255.4	1244.8
15°	1633.2	1608.0	1545.1	1454.8	1364.5	1286.9	1234.4	1207.1	1194.5
17.5°	1633.2	1603.8	1528.3	1423.3	1320.5	1238.5	1179.8	1148.3	1137.8
20°	1603.8	1570.2	1488.4	1373.0	1263.7	1175.6	1118.9	1087.4	1074.8
22.5°	1557.6	1519.9	1431.6	1312.0	1196.6	1110.5	1053.9	1024.4	1011.8
25°	1496.7	1459.0	1366.6	1242.8	1127.3	1041.3	988.8	961.5	948.9
27.5°	1425.3	1383.4	1291.0	1167.2	1053.9	971.9	923.7	898.5	888.0
30°	1337.2	1297.3	1207.1	1085.3	976.2	900.5	856.5	833.4	825.0
32.5°	1234.4	1200.8	1112.6	999.2	896.4	827.2	787.2	768.4	759.9
35°	1127.3	1095.8	1018.1	913.1	820.9	755.8	717.9	705.3	701.2
37.5°	1026.5	999.2	923.7	827.2	743.2	686.4	652.8	644.5	640.2
40°	921.6	902.7	833.4	745.2	667.5	617.2	589.9	583.6	583.6
42.5°	827.2	806.1	745.2	665.4	596.2	545.8	526.9	520.6	522.7
45°	741.1	720.0	663.4	589.9	522.7	480.7	466.0	466.0	466.0
47.5°	661.2	642.4	589.9	514.3	459.7	426.1	411.5	411.5	413.5
50°	587.7	575.2	516.4	451.3	403.1	371.6	361.0	359.0	363.2
52.5°	518.5	503.8	451.3	392.6	346.4	321.2	310.7	308.5	310.7
55°	459.7	443.0	396.8	340.1	298.1	272.9	260.3	258.2	262.5
57.5°	403.1	390.5	342.1	291.8	251.9	226.7	216.3	212.0	214.1
60°	350.6	338.0	293.9	245.6	210.0	184.8	170.1	165.8	167.9
62.5°	302.2	291.8	249.9	203.7	167.9	144.9	130.2	119.7	123.9
65°	258.2	247.7	210.0	163.8	132.3	107.1	86.1	77.7	79.8
67.5°	220.4	207.8	172.1	130.2	98.7	71.4	48.3	44.1	44.1
70°	182.6	170.1	138.6	100.7	69.2	37.8	21.0	21.0	21.0
72.5°	146.9	136.5	107.1	75.5	44.1	16.7	8.4	8.4	8.4
75°	113.4	105.0	79.8	52.5	27.3	8.4	6.3	4.2	4.2
77.5°	84.0	75.5	56.6	35.7	16.7	4.2	4.2	4.2	4.2
80°	56.6	50.4	37.8	21.0	8.4	2.1	2.1	2.1	2.1
82.5°	33.6	29.3	21.0	10.5	4.2	2.1	2.1	2.1	2.1
85°	16.7	12.6	8.4	4.2	2.1	2.1	2.1	2.1	2.1
87.5°	4.2	2.1	2.1	2.1	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)