

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580559

Luminaire Tested: **HCC4W40D010MW-HM43040827-41WWW**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580559  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W40D010MW-HM43040827-41WWW  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 3814.0 lumens  
Efficiency: N/A  
Efficacy: 93.0 lumens/watt  
Spacing Criteria (0/90/45): 1.06 / 1.03 / 1.1  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580559  
CATALOG NUMBER: HCC4W40D010MW-HM43040827-41WWW

### Luminous Intensity Polar Plot

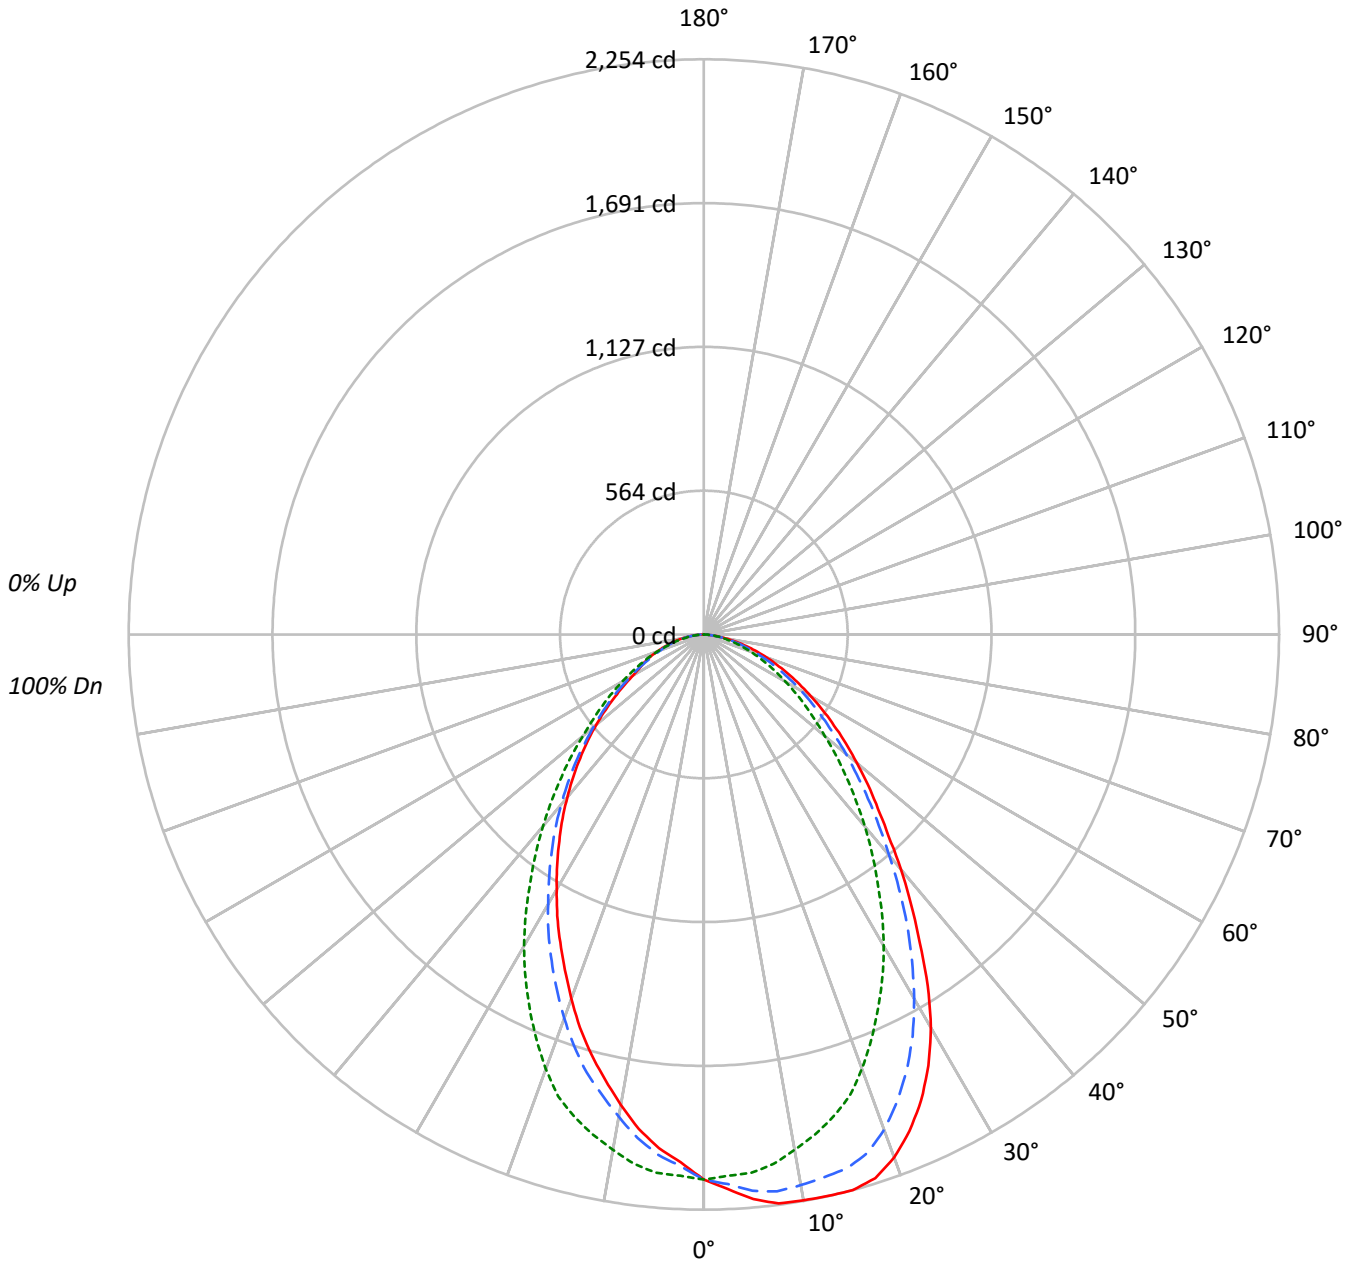

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580559

CATALOG NUMBER: HCC4W40D010MW-HM43040827-41WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	106	103	100	108	104	101	98	100	97	95	96	94	92	93	91	89	87								
2	102	95	89	84	100	93	88	83	90	85	81	87	83	80	84	81	78	76								
3	94	85	78	72	92	84	77	72	81	75	71	78	73	69	76	72	68	66								
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58								
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52								
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47								
7	71	58	50	45	69	58	50	45	56	49	44	55	49	44	53	48	44	42								
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38								
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35								
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	263429	263429	263429
5°	275009	262256	250135
10°	281972	256797	234465
15°	287816	249954	217544
20°	286282	237794	199203
25°	274249	219878	181240
30°	253364	200751	164261
35°	222086	178585	148695
40°	193381	157796	133917
45°	168297	137631	119646
50°	149944	118608	105598
55°	134017	104276	91309
60°	119621	91128	78719
65°	106325	79941	74804
70°	93333	68846	69784
75°	79015	58666	64623
80°	60661	50006	58956
85°	35522	39202	49816



TEST NUMBER: P580559  
 CATALOG NUMBER: HCC4W40D010MW-HM43040827-41WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	200.2	5.2
10°-20°	552.2	14.5
20°-30°	754.5	19.8
30°-40°	757.6	19.9
40°-50°	626.7	16.4
50°-60°	454.2	11.9
60°-70°	287.7	7.5
70°-80°	145.4	3.8
80°-90°	35.6	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1506.9	39.5
0°-40°	2264.4	59.4
0°-60°	3345.3	87.7
0°-90°	3814.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3814.0	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2136	2136	2136	2136	2136	
5°	2221	2188	2118	2048	2020	213
15°	2254	2166	1957	1776	1704	634
25°	2015	1882	1616	1412	1332	921
35°	1475	1387	1186	1040	988	924
45°	965	910	789	711	686	750
55°	623	568	485	442	425	560
65°	364	324	274	246	256	363
75°	166	143	123	128	136	177
85°	25	25	28	33	35	35
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580559

CATALOG NUMBER: HCC4W40D010MW-HM43040827-41WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	2135.7	2135.7	2135.7	2135.7	2135.7	2135.7	2135.7	2135.7	2135.7
2.5°	2176.0	2168.5	2155.9	2140.8	2123.2	2103.1	2085.5	2075.4	2070.4
5°	2221.1	2211.2	2188.5	2155.9	2118.1	2080.5	2047.8	2027.7	2020.2
7.5°	2248.8	2233.7	2201.1	2150.9	2093.0	2037.8	1990.0	1962.4	1954.8
10°	2251.3	2233.7	2191.0	2123.2	2050.3	1977.4	1919.7	1879.5	1872.0
12.5°	2253.9	2231.2	2178.4	2098.1	2007.6	1917.1	1846.8	1799.1	1786.5
15°	2253.9	2231.2	2165.9	2070.4	1957.4	1854.4	1776.4	1721.2	1703.6
17.5°	2233.7	2208.6	2130.7	2020.2	1897.1	1781.5	1691.0	1633.2	1615.6
20°	2181.0	2153.3	2065.4	1944.8	1811.6	1691.0	1600.6	1540.3	1517.6
22.5°	2105.6	2073.0	1980.0	1849.3	1716.1	1593.1	1505.1	1442.3	1422.2
25°	2015.1	1982.5	1881.9	1753.8	1615.6	1500.0	1412.1	1354.3	1331.7
27.5°	1904.6	1869.4	1771.4	1643.3	1515.1	1399.6	1319.2	1266.4	1243.7
30°	1778.9	1741.2	1648.3	1525.2	1409.5	1299.0	1221.1	1178.4	1153.3
32.5°	1633.2	1600.6	1517.6	1407.1	1299.0	1193.5	1128.2	1090.5	1070.4
35°	1474.9	1457.3	1387.0	1291.5	1186.0	1098.0	1040.3	1005.1	987.5
37.5°	1334.2	1316.6	1256.3	1175.9	1083.0	1002.5	954.8	924.6	909.6
40°	1201.0	1186.0	1128.2	1060.4	980.0	909.6	869.3	846.8	831.7
42.5°	1070.4	1062.8	1015.1	952.3	881.9	821.6	789.0	771.4	758.8
45°	964.8	954.8	909.6	849.3	789.0	738.7	711.1	698.5	685.9
47.5°	871.9	859.4	811.6	758.8	703.5	658.4	633.1	620.6	615.7
50°	781.4	768.9	726.2	673.4	618.1	585.5	565.3	552.8	550.3
52.5°	701.1	688.5	640.8	590.4	547.7	520.1	502.5	490.0	484.9
55°	623.2	608.0	567.9	520.1	484.9	459.8	442.2	429.7	424.6
57.5°	552.8	537.7	502.5	457.3	424.6	402.0	387.0	374.4	369.4
60°	484.9	472.4	439.8	396.9	369.4	349.3	334.2	324.1	319.1
62.5°	422.2	412.1	379.5	341.7	319.1	301.5	289.0	278.9	283.9
65°	364.3	354.2	324.1	291.5	273.9	256.3	246.3	246.3	256.3
67.5°	309.1	299.0	273.9	246.3	231.2	218.6	211.1	218.6	226.1
70°	258.8	248.7	226.1	203.6	190.9	180.9	180.9	188.4	193.5
72.5°	211.1	201.0	183.4	165.8	155.8	148.2	155.8	160.9	165.8
75°	165.8	158.3	143.3	130.7	123.1	120.6	128.1	133.2	135.6
77.5°	123.1	118.0	108.1	98.0	92.9	95.5	103.0	105.5	108.1
80°	85.4	83.0	75.3	70.4	70.4	72.9	77.9	80.4	83.0
82.5°	52.8	52.8	47.8	45.2	47.8	52.8	55.3	57.8	57.8
85°	25.1	27.7	25.1	25.1	27.7	32.6	32.6	35.2	35.2
87.5°	7.5	7.5	10.1	10.1	12.6	12.6	12.6	12.6	15.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)