

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580611

Luminaire Tested: **HCC4W40D010MW-HM43040840-41RWWH**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580611  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-15)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W40D010MW-HM43040840-41RWWH  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 4375.2 lumens  
Efficiency: N/A  
Efficacy: 106.7 lumens/watt  
Spacing Criteria (0/90/45): 1.14 / 1.08 / 1.16  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580611  
CATALOG NUMBER: HCC4W40D010MW-HM43040840-41RWWH

### Luminous Intensity Polar Plot

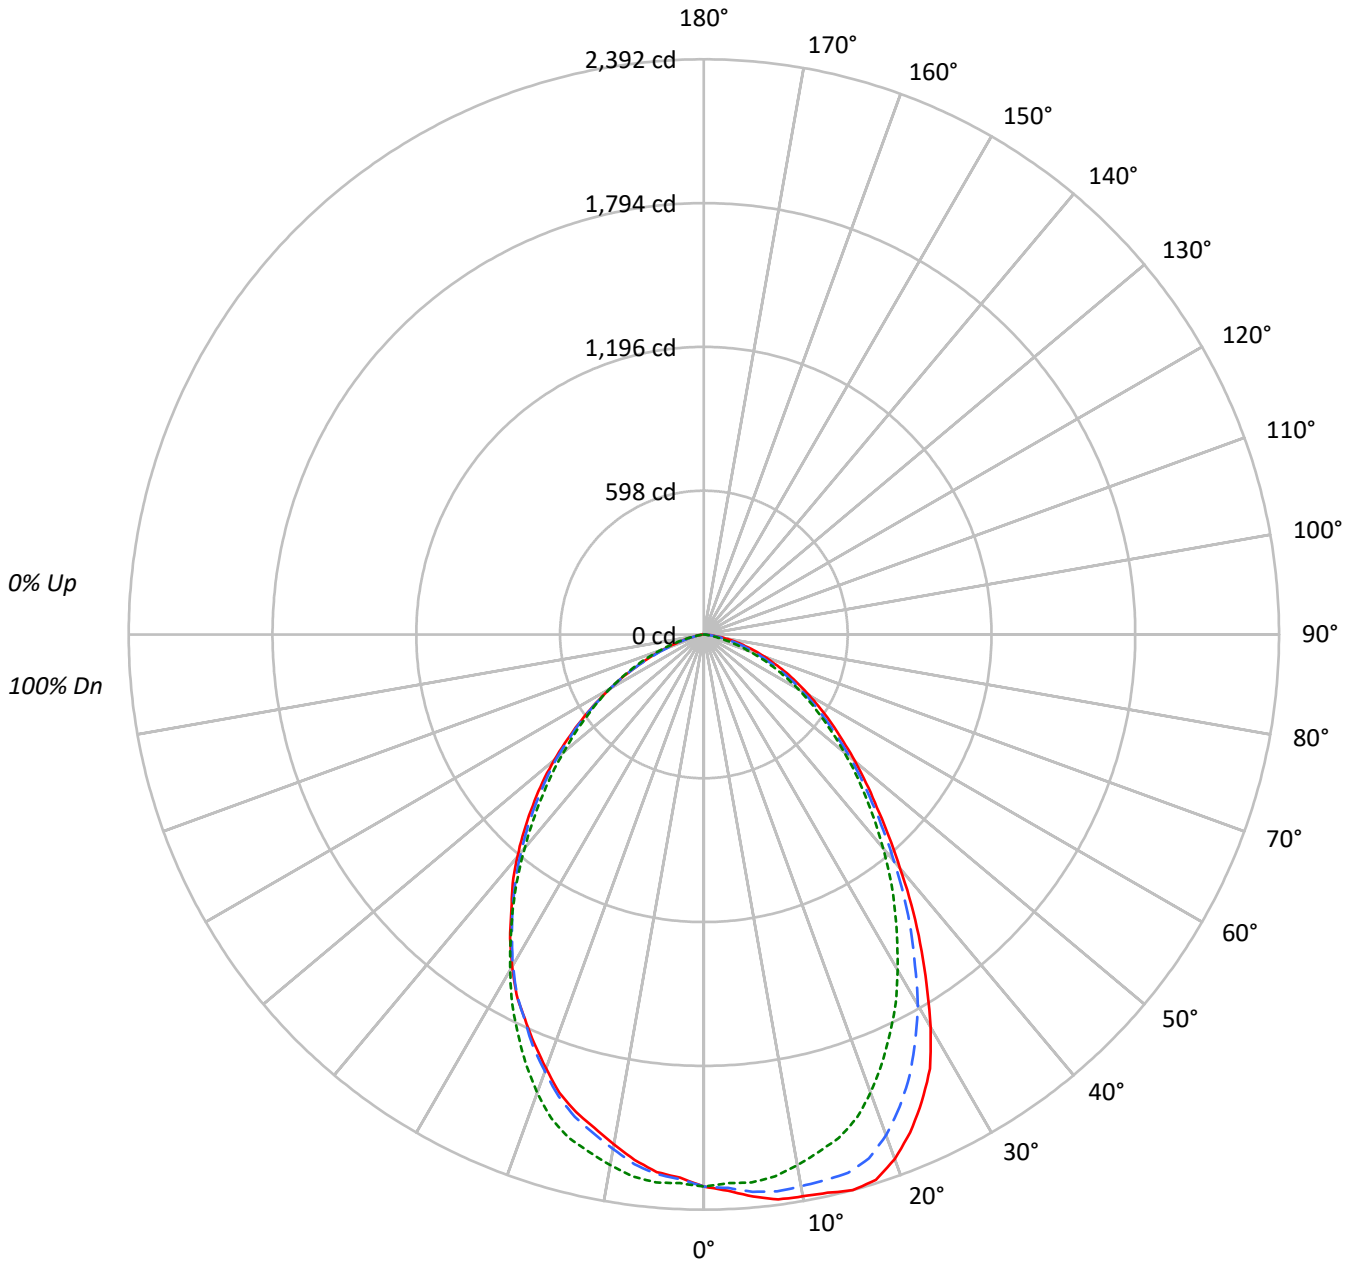

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580611

CATALOG NUMBER: HCC4W40D010MW-HM43040840-41RWWH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	104	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77					77			
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67					67			
4	88	77	70	64	86	76	69	63	74	67	62	71	66	62	69	65	61	59					59			
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52					52			
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47					47			
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42					42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38					38			
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	37	35					35			
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32					32			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	283140	283140	283140
5°	290573	283169	277857
10°	297152	280719	269647
15°	305502	276744	262545
20°	304671	266120	251917
25°	291846	249152	239830
30°	268447	229465	227043
35°	236165	208248	209965
40°	204330	186425	194218
45°	177577	165645	175571
50°	157581	146106	155950
55°	139823	128146	133673
60°	124505	111134	111134
65°	110674	92403	86566
70°	95641	69928	61705
75°	80207	46227	38030
80°	60732	22304	20244
85°	32409	8067	8067



TEST NUMBER: P580611

CATALOG NUMBER: HCC4W40D010MW-HM43040840-41RWWH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	217.4	5.0
10°-20°	616.3	14.1
20°-30°	869.2	19.9
30°-40°	897.9	20.5
40°-50°	761.1	17.4
50°-60°	553.8	12.7
60°-70°	323.6	7.4
70°-80°	120.2	2.7
80°-90°	15.7	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1702.9	38.9
0°-40°	2600.7	59.4
0°-60°	3915.7	89.5
0°-90°	4375.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4375.2	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	2296	2296	2296	2296	2296	
5°	2347	2327	2287	2253	2244	225
15°	2392	2318	2167	2076	2056	672
25°	2144	2025	1831	1765	1762	981
35°	1568	1500	1383	1386	1394	980
45°	1018	990	950	984	1006	792
55°	650	619	596	616	622	585
65°	379	348	317	297	297	376
75°	168	140	97	77	80	181
85°	23	14	6	6	6	32
90°	0	0	0	0	0	



TEST NUMBER: P580611

CATALOG NUMBER: HCC4W40D010MW-HM43040840-41RWWH

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	2295.5	2295.5	2295.5	2295.5	2295.5	2295.5	2295.5	2295.5	2295.5
2.5°	2315.4	2309.7	2304.1	2295.5	2284.1	2275.5	2267.0	2261.3	2261.3
5°	2346.8	2338.3	2326.9	2306.9	2287.0	2269.8	2252.8	2244.1	2244.1
7.5°	2369.7	2358.2	2335.4	2306.9	2272.7	2247.0	2221.4	2209.9	2204.2
10°	2372.5	2361.1	2329.8	2287.0	2241.3	2201.4	2172.8	2155.8	2152.9
12.5°	2378.2	2364.0	2324.1	2264.1	2204.2	2155.8	2124.4	2107.3	2101.7
15°	2392.4	2372.5	2318.3	2241.3	2167.2	2110.2	2076.0	2061.6	2056.0
17.5°	2378.2	2349.7	2284.1	2192.9	2110.2	2047.4	2013.2	1999.0	1999.0
20°	2321.1	2292.7	2215.7	2115.9	2027.4	1967.6	1933.4	1924.8	1919.2
22.5°	2241.3	2209.9	2127.2	2021.7	1933.4	1879.1	1856.4	1844.9	1842.1
25°	2144.4	2113.0	2024.6	1916.2	1830.7	1785.1	1765.1	1765.1	1762.2
27.5°	2036.0	1996.1	1904.8	1810.8	1728.0	1693.8	1685.3	1685.3	1688.1
30°	1884.8	1856.4	1779.4	1688.1	1611.1	1588.3	1588.3	1594.1	1594.1
32.5°	1722.3	1702.4	1634.0	1554.2	1494.2	1479.9	1485.7	1497.1	1499.9
35°	1568.4	1545.5	1499.9	1428.6	1383.0	1377.3	1385.9	1394.4	1394.4
37.5°	1417.2	1394.4	1363.0	1306.0	1271.8	1274.7	1286.0	1297.4	1306.0
40°	1269.0	1251.8	1229.1	1183.4	1157.8	1169.1	1183.4	1194.8	1206.2
42.5°	1137.8	1120.7	1103.5	1069.3	1052.2	1066.5	1083.6	1095.0	1106.4
45°	1018.0	1006.5	989.5	960.9	949.6	963.8	983.8	995.2	1006.5
47.5°	915.3	909.7	886.8	861.2	855.4	869.7	886.8	901.1	909.7
50°	821.2	812.7	792.8	767.1	761.4	784.1	795.6	804.1	812.7
52.5°	730.0	721.5	698.6	675.9	675.9	692.9	701.5	704.3	712.8
55°	650.2	641.5	618.8	601.6	595.9	610.3	616.0	616.0	621.6
57.5°	576.0	567.5	544.7	524.7	521.8	530.3	530.3	530.3	533.3
60°	504.7	496.2	473.4	456.2	450.5	453.4	450.5	447.7	450.5
62.5°	439.1	430.6	407.8	387.9	382.1	382.1	373.5	370.7	373.5
65°	379.2	365.0	347.8	327.9	316.6	307.9	296.6	296.6	296.6
67.5°	319.4	307.9	288.0	268.0	253.8	239.6	222.4	228.1	230.9
70°	265.2	256.6	233.8	213.9	193.9	176.8	162.5	168.3	171.1
72.5°	216.7	205.4	185.3	162.5	145.4	122.6	114.1	119.7	119.7
75°	168.3	156.8	139.7	116.9	97.0	77.0	77.0	79.8	79.8
77.5°	125.4	114.1	97.0	77.0	59.9	45.6	48.4	48.4	48.4
80°	85.5	77.0	62.8	45.6	31.4	25.7	25.7	25.7	28.5
82.5°	48.4	42.8	34.2	22.9	14.2	14.2	14.2	14.2	14.2
85°	22.9	17.2	14.2	8.5	5.7	5.7	5.7	5.7	5.7
87.5°	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)