

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P580660

Luminaire Tested: **HCC4W40D010MW-HM43040935-41MDW**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P580660  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-6)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W40D010MW-HM43040935-41MDW  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" MEDIUM DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 3509.6 lumens  
Efficiency: N/A  
Efficacy: 85.6 lumens/watt  
Spacing Criteria (0/90/45): 1.04 / 1.04 / 1.01  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 41  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P580660  
CATALOG NUMBER: HCC4W40D010MW-HM43040935-41MDW

### Luminous Intensity Polar Plot

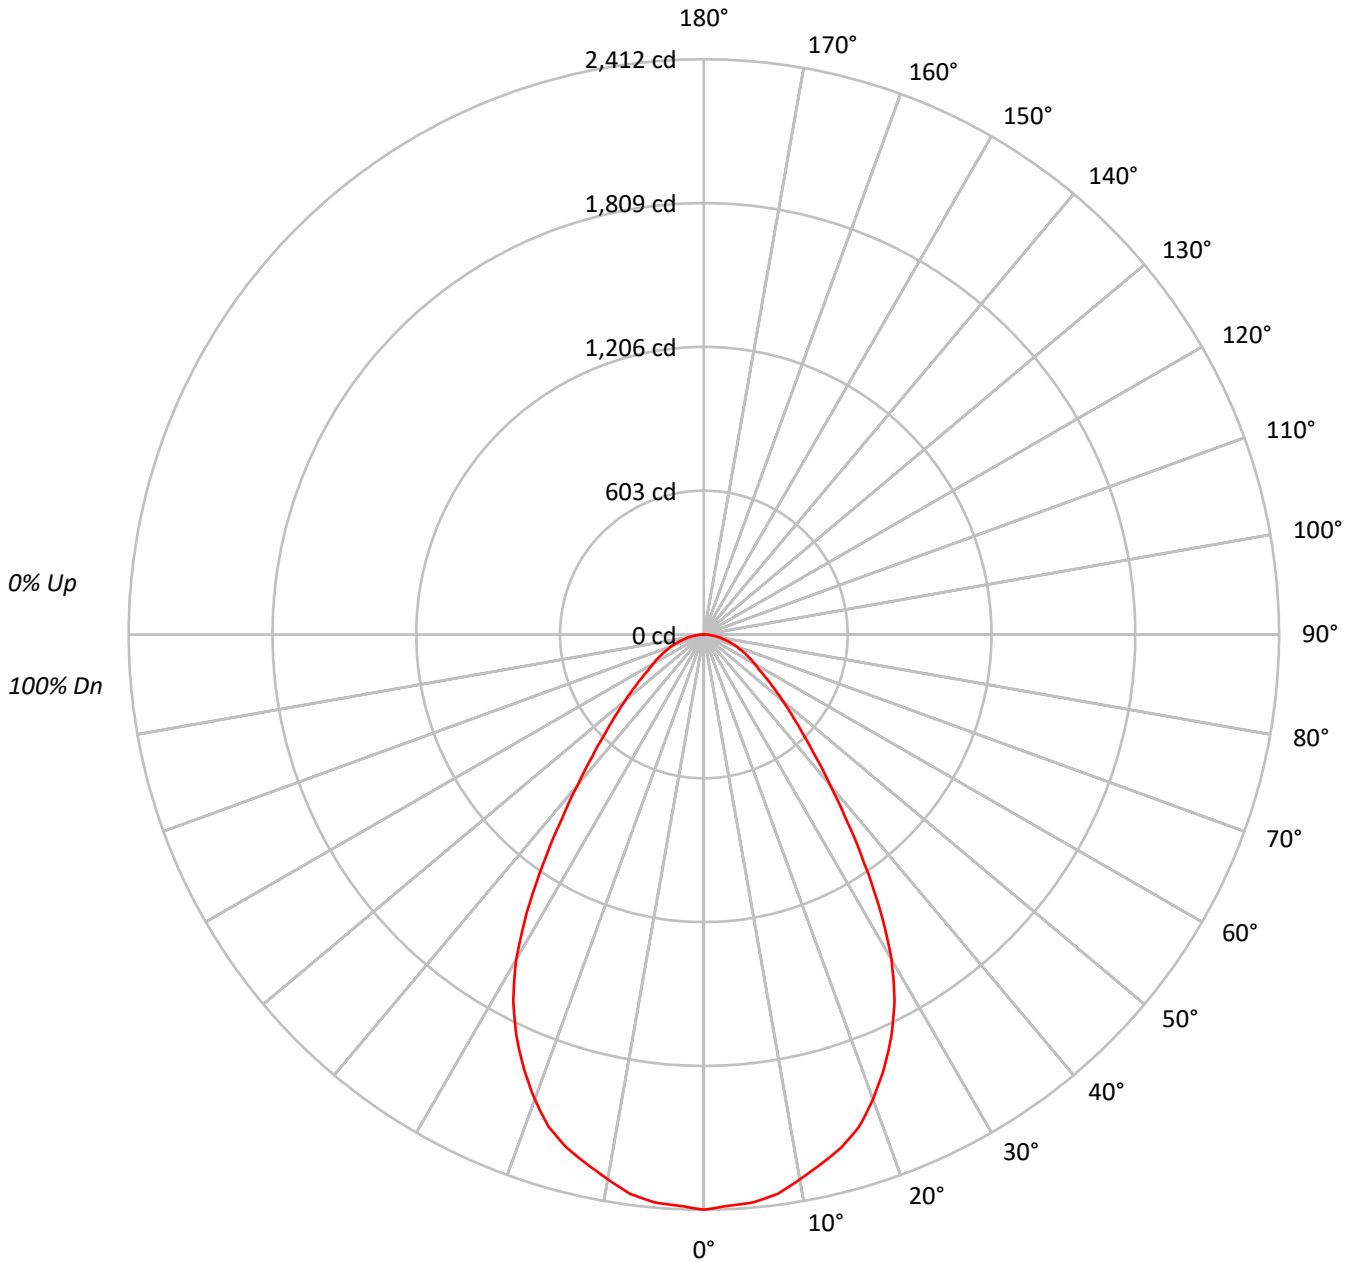

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P580660

CATALOG NUMBER: HCC4W40D010MW-HM43040935-41MDW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89					89			
2	104	97	92	87	101	95	90	86	92	88	84	89	85	82	86	83	81	79					79			
3	97	88	82	76	94	87	81	76	84	79	75	81	77	73	79	75	72	70					70			
4	90	80	73	68	88	79	73	67	77	71	67	75	70	66	73	68	65	63					63			
5	84	74	66	61	82	73	66	61	71	65	60	69	64	59	67	63	59	57					57			
6	79	68	60	55	77	67	60	55	65	59	54	64	58	54	62	57	54	52					52			
7	74	63	55	50	73	62	55	50	61	54	50	59	54	49	58	53	49	47					47			
8	70	58	51	46	68	58	51	46	56	50	46	55	50	45	54	49	45	44					44			
9	66	54	47	42	65	54	47	42	53	46	42	52	46	42	51	46	42	40					40			
10	62	51	44	39	61	50	44	39	49	43	39	48	43	39	48	42	39	37					37			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	297534
5°	295959
10°	290551
15°	284432
20°	272263
25°	253167
30°	224081
35°	176853
40°	132339
45°	101801
50°	82590
55°	68514
60°	60587
65°	56066
70°	51752
75°	47514
80°	43187
85°	34390



TEST NUMBER: P580660  
 CATALOG NUMBER: HCC4W40D010MW-HM43040935-41MDW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	226.0	6.4
10°-20°	624.6	17.8
20°-30°	848.2	24.2
30°-40°	734.7	20.9
40°-50°	461.3	13.1
50°-60°	290.2	8.3
60°-70°	190.6	5.4
70°-80°	105.2	3.0
80°-90°	28.8	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1698.8	48.4
0°-40°	2433.5	69.3
0°-60°	3185.0	90.8
0°-90°	3509.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3509.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2412	
5°	2390	226
15°	2227	625
25°	1860	848
35°	1174	735
45°	584	461
55°	319	290
65°	192	191
75°	100	105
85°	24	29
90°	0	



TEST NUMBER: P580660  
CATALOG NUMBER: HCC4W40D010MW-HM43040935-41MDW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2412.2
2.5°	2397.6
5°	2390.3
7.5°	2366.0
10°	2319.8
12.5°	2273.6
15°	2227.4
17.5°	2164.2
20°	2074.2
22.5°	1972.1
25°	1860.2
27.5°	1731.4
30°	1573.3
32.5°	1381.2
35°	1174.5
37.5°	984.8
40°	821.9
42.5°	693.0
45°	583.6
47.5°	501.0
50°	430.4
52.5°	369.6
55°	318.6
57.5°	274.8
60°	245.6
62.5°	218.8
65°	192.1
67.5°	165.3
70°	143.5
72.5°	119.2
75°	99.7
77.5°	77.8
80°	60.8
82.5°	41.4
85°	24.3
87.5°	9.8
90°	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)