

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581024

Luminaire Tested: **HCC4S05D010SL-HM40525835-41RWWC**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P581024  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-14)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4S05D010SL-HM40525835-41RWWC  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, SPECULAR TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 691.1 lumens  
Efficiency: N/A  
Efficacy: 115.2 lumens/watt  
Spacing Criteria (0/90/45): 1.21 / 1.15 / 1.21  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 6  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P581024  
CATALOG NUMBER: HCC4S05D010SL-HM40525835-41RWWC

### Luminous Intensity Polar Plot

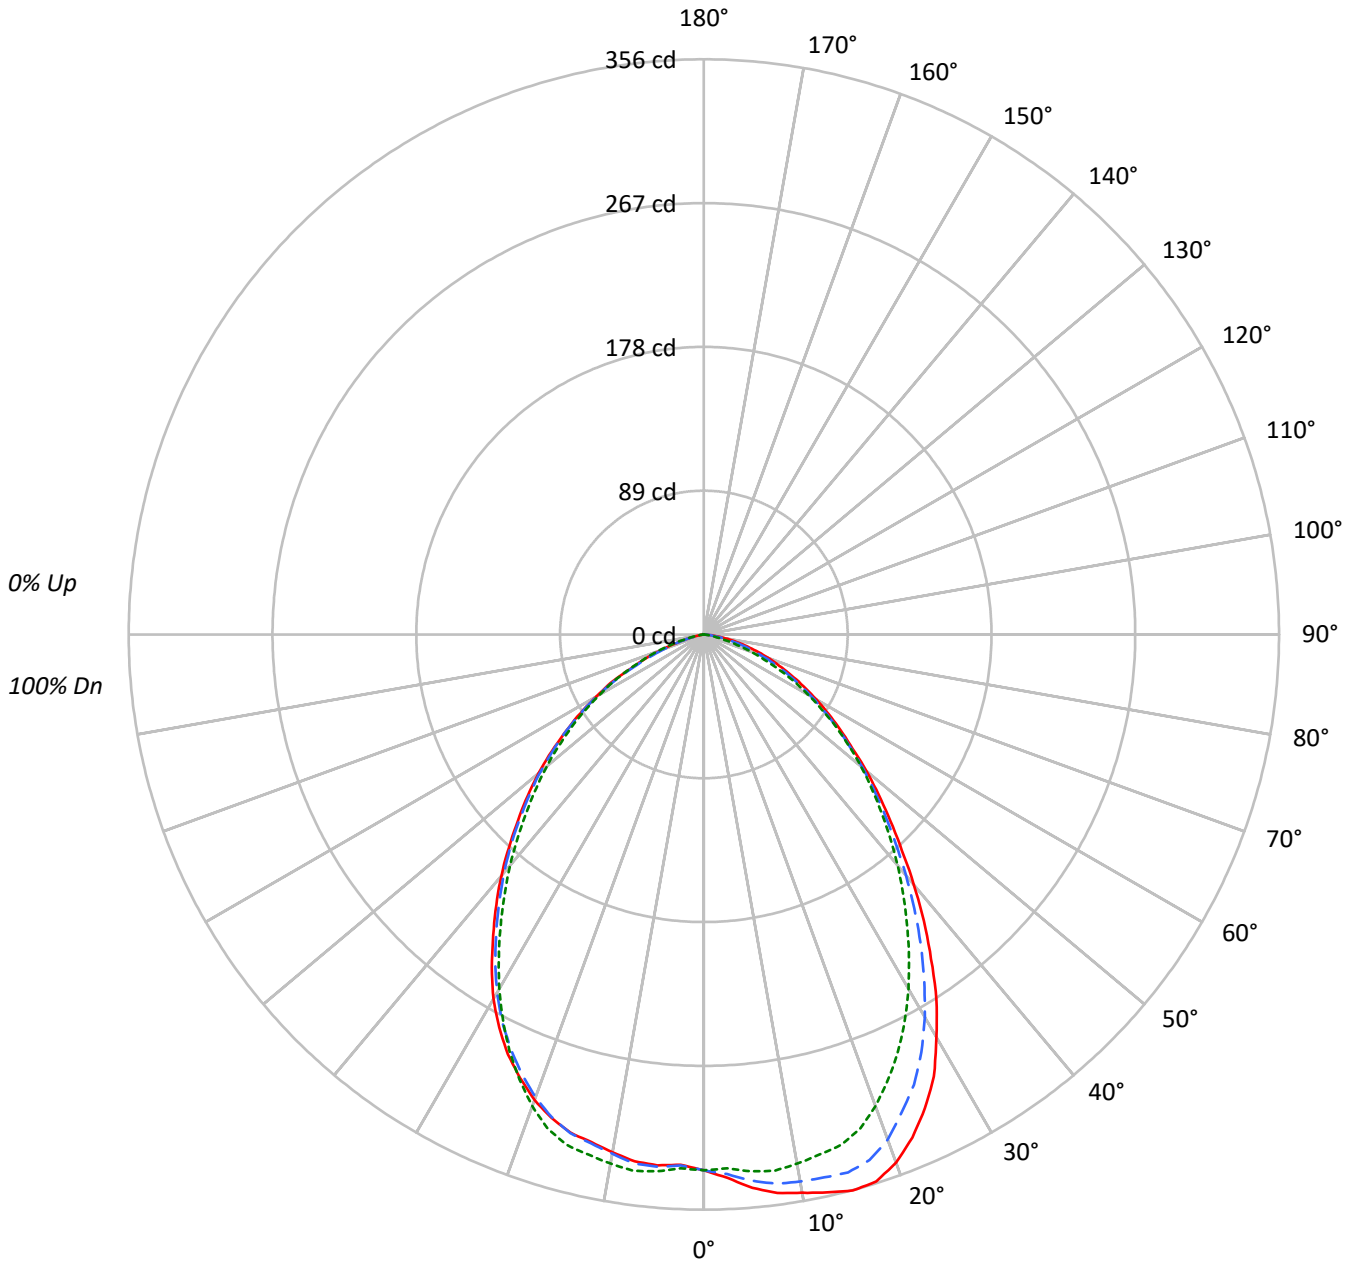

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581024

CATALOG NUMBER: HCC4S05D010SL-HM40525835-41RWWC

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88								
2	102	95	90	85	100	94	88	84	90	86	82	87	83	80	84	81	78	76								
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67								
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58								
5	81	70	61	56	79	68	61	55	66	60	55	65	59	54	63	58	54	52								
6	75	63	55	49	74	62	55	49	61	54	49	59	53	48	58	52	48	46								
7	70	58	50	44	69	57	49	44	56	49	44	54	48	44	53	47	43	41								
8	66	53	45	40	64	53	45	40	51	44	40	50	44	39	49	43	39	37								
9	62	49	42	36	60	49	41	36	47	41	36	46	40	36	45	40	36	34								
10	58	46	38	33	57	45	38	33	44	38	33	43	37	33	42	37	33	31								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	40901	40901	40901
5°	42568	41293	40835
10°	43950	41658	40756
15°	45498	41782	40761
20°	45653	40770	40245
25°	44041	38720	39033
30°	40976	36063	37088
35°	36922	33007	34211
40°	32541	30030	31398
45°	28451	27038	28363
50°	25195	24351	25637
55°	22171	21505	22365
60°	19785	18329	18897
65°	17395	14914	14651
70°	15183	10999	10026
75°	12581	6577	5338
80°	9518	2557	1634
85°	4529	708	708



TEST NUMBER: P581024

CATALOG NUMBER: HCC4S05D010SL-HM40525835-41RWWC

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	32.0	4.6
10°-20°	93.4	13.5
20°-30°	135.2	19.6
30°-40°	142.6	20.6
40°-50°	123.4	17.9
50°-60°	91.5	13.2
60°-70°	52.7	7.6
70°-80°	18.4	2.7
80°-90°	2.0	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	260.5	37.7
0°-40°	403.2	58.3
0°-60°	618.1	89.4
0°-90°	691.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	691.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	332	332	332	332	332	
5°	344	339	334	331	330	33
15°	356	345	327	320	319	100
25°	324	308	284	283	287	148
35°	245	234	219	224	227	153
45°	163	159	155	161	163	127
55°	103	101	100	104	104	93
65°	60	56	51	48	50	60
75°	26	22	14	11	11	28
85°	3	2	0	0	0	5
90°	0	0	0	0	0	



TEST NUMBER: P581024

CATALOG NUMBER: HCC4S05D010SL-HM40525835-41RWWC

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	331.6	331.6	331.6	331.6	331.6	331.6	331.6	331.6	331.6
2.5°	336.6	335.7	334.4	332.6	330.7	329.4	328.9	328.5	328.5
5°	343.8	342.0	339.3	335.7	333.5	332.1	330.7	329.8	329.8
7.5°	348.7	346.9	342.9	337.9	334.8	332.1	330.3	328.9	328.9
10°	350.9	348.7	343.8	337.4	332.6	328.9	326.3	325.4	325.4
12.5°	353.7	350.9	344.2	336.2	329.8	325.4	322.7	321.8	321.8
15°	356.3	353.2	344.7	335.3	327.2	321.8	319.5	319.2	319.2
17.5°	354.9	350.9	341.1	329.8	320.9	315.5	313.3	313.3	313.7
20°	347.8	343.8	332.6	320.0	310.6	306.6	304.7	305.7	306.6
22.5°	337.0	332.1	320.0	307.9	298.1	294.4	294.4	295.8	297.1
25°	323.6	319.2	307.5	294.0	284.5	281.9	282.8	285.0	286.8
27.5°	308.4	303.4	291.4	278.8	269.3	268.0	270.2	273.4	274.3
30°	287.7	283.8	273.4	261.3	253.2	252.8	255.9	258.2	260.4
32.5°	268.0	263.5	253.7	242.0	236.2	236.6	240.3	242.9	244.3
35°	245.2	241.1	233.9	224.5	219.2	220.1	224.0	226.8	227.2
37.5°	223.6	221.0	213.8	206.6	202.6	204.4	207.9	211.1	211.1
40°	202.1	199.9	194.5	188.6	186.5	188.6	192.3	195.0	195.0
42.5°	181.5	180.1	175.7	171.6	170.4	173.4	176.6	178.9	178.4
45°	163.1	161.9	158.7	155.5	155.0	158.2	160.9	162.2	162.6
47.5°	146.5	145.6	143.0	140.7	140.7	143.9	146.1	147.4	147.9
50°	131.3	130.4	128.1	126.4	126.9	130.0	131.8	133.1	133.6
52.5°	116.1	115.7	113.8	111.6	112.9	115.2	117.5	118.3	118.7
55°	103.1	103.1	100.8	99.1	100.0	102.2	103.5	104.0	104.0
57.5°	91.5	91.0	88.3	86.5	86.9	89.2	90.1	90.6	90.6
60°	80.2	79.8	77.1	74.3	74.3	75.7	76.2	76.6	76.6
62.5°	69.5	69.0	65.8	63.7	62.8	62.3	62.3	63.2	65.0
65°	59.6	59.1	56.1	52.4	51.1	49.7	48.4	49.3	50.2
67.5°	50.6	49.7	46.6	43.5	40.3	38.1	35.9	37.2	39.0
70°	42.1	41.2	37.7	34.0	30.5	26.9	25.1	26.9	27.8
72.5°	34.0	33.1	29.6	26.0	21.6	17.9	17.5	17.9	18.4
75°	26.4	26.0	22.4	18.4	13.8	11.2	11.2	11.2	11.2
77.5°	19.7	18.8	15.2	11.7	8.1	6.2	5.8	5.8	5.8
80°	13.4	12.6	9.4	6.7	3.6	2.7	2.7	2.3	2.3
82.5°	7.6	7.2	4.9	2.7	1.4	0.9	0.9	0.9	0.9
85°	3.2	2.7	1.8	0.9	0.5	0.5	0.5	0.5	0.5
87.5°	0.5	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)