

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581074

Luminaire Tested: **HCC4S05D010SL-HM40525930-41MDW**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581074
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4S05D010SL-HM40525930-41MDW
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" MEDIUM DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 548.7 lumens
Efficiency: N/A
Efficacy: 91.5 lumens/watt
Spacing Criteria (0/90/45): 1.04 / 1.04 / 1.01
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581074
CATALOG NUMBER: HCC4S05D010SL-HM40525930-41MDW

Luminous Intensity Polar Plot

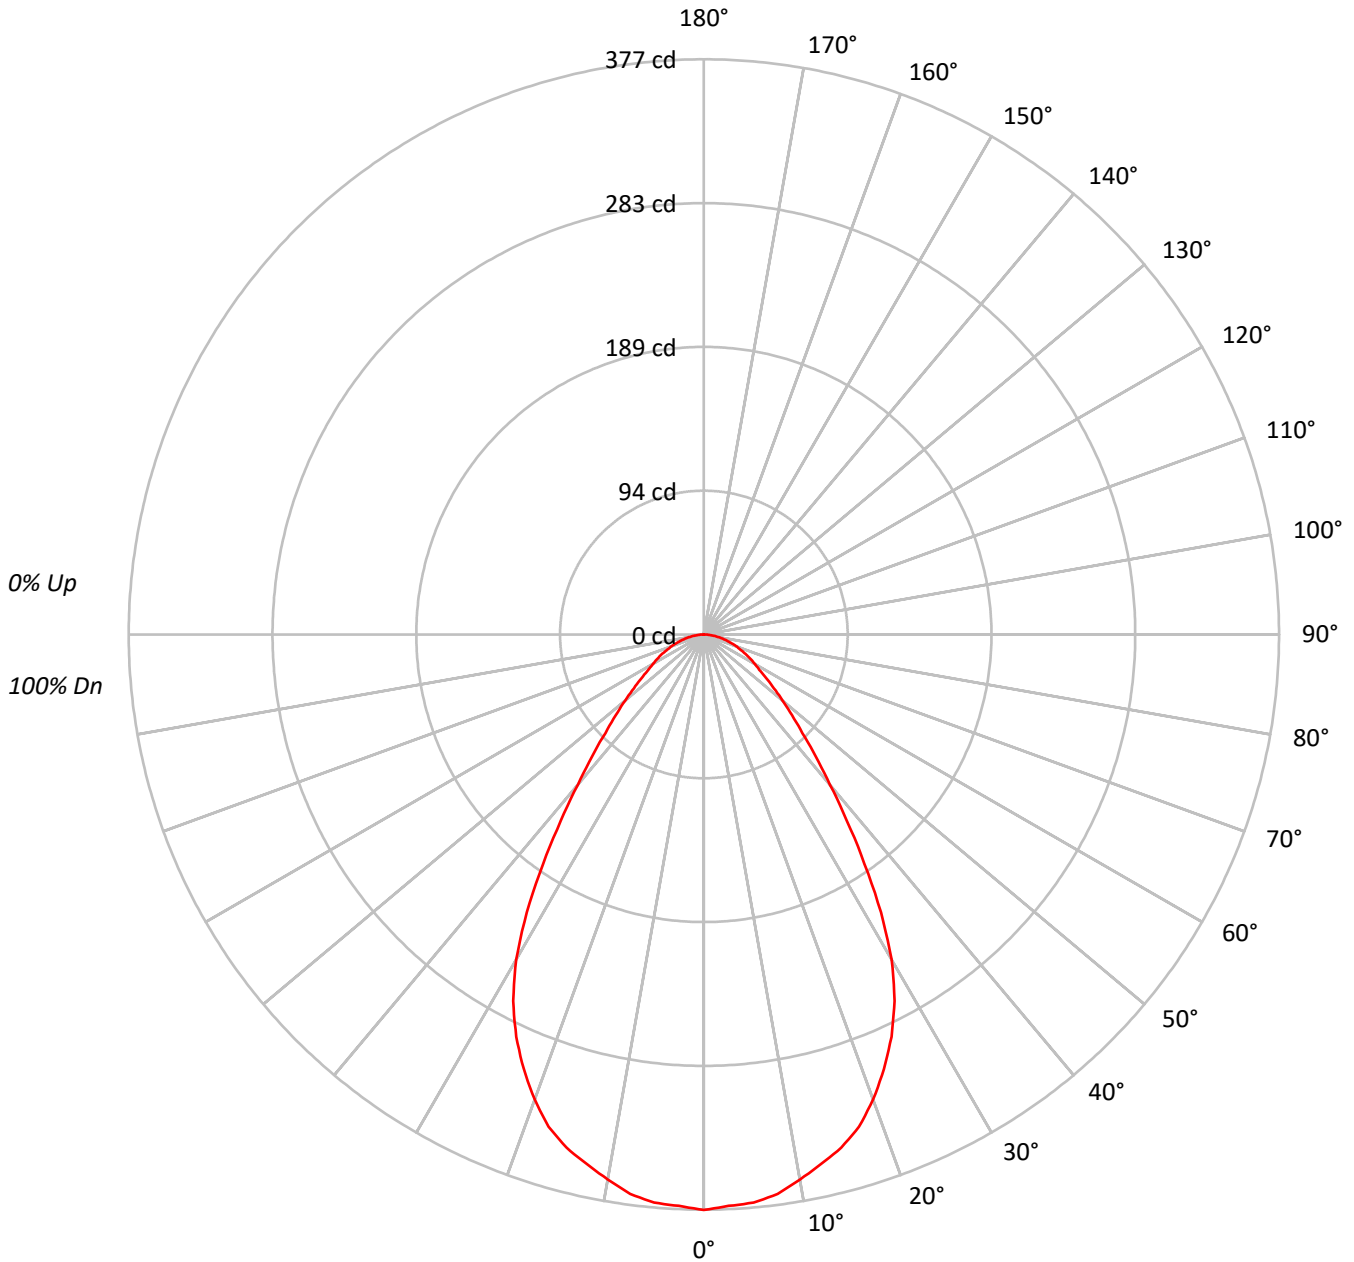

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P581074

CATALOG NUMBER: HCC4S05D010SL-HM40525930-41MDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89																			
2	104	97	92	87	101	95	90	86	92	88	84	89	85	82	86	83	81	79																			
3	97	88	82	76	94	87	81	76	84	79	75	81	77	73	79	75	72	70																			
4	90	80	73	68	88	79	73	67	77	71	67	75	70	66	73	68	65	63																			
5	84	74	66	61	82	73	66	61	71	65	60	69	64	59	67	63	59	57																			
6	79	68	60	55	77	67	60	55	65	59	54	64	58	54	62	57	54	52																			
7	74	63	55	50	73	62	55	50	61	54	50	59	54	49	58	53	49	47																			
8	70	58	51	46	68	58	51	46	56	50	46	55	50	45	54	49	45	44																			
9	66	54	47	42	65	54	47	42	53	46	42	52	46	42	51	46	42	40																			
10	62	51	44	39	61	50	44	39	49	43	39	48	43	39	48	42	39	37																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	46526
5°	46283
10°	45428
15°	44464
20°	42568
25°	39591
30°	35037
35°	27646
40°	20691
45°	15926
50°	12914
55°	10709
60°	9473
65°	8785
70°	8114
75°	7387
80°	6748
85°	5236



TEST NUMBER: P581074
 CATALOG NUMBER: HCC4S05D010SL-HM40525930-41MDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	35.3	6.4
10°-20°	97.7	17.8
20°-30°	132.6	24.2
30°-40°	114.9	20.9
40°-50°	72.1	13.1
50°-60°	45.4	8.3
60°-70°	29.8	5.4
70°-80°	16.4	3.0
80°-90°	4.5	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	265.6	48.4
0°-40°	380.5	69.3
0°-60°	498.0	90.8
0°-90°	548.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	548.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	377	
5°	374	35
15°	348	98
25°	291	133
35°	184	115
45°	91	72
55°	50	45
65°	30	30
75°	16	16
85°	4	4
90°	0	



TEST NUMBER: P581074
CATALOG NUMBER: HCC4S05D010SL-HM40525930-41MDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	377.2
2.5°	374.9
5°	373.8
7.5°	369.9
10°	362.7
12.5°	355.5
15°	348.2
17.5°	338.3
20°	324.3
22.5°	308.4
25°	290.9
27.5°	270.7
30°	246.0
32.5°	216.0
35°	183.6
37.5°	154.0
40°	128.5
42.5°	108.4
45°	91.3
47.5°	78.3
50°	67.3
52.5°	57.8
55°	49.8
57.5°	43.0
60°	38.4
62.5°	34.2
65°	30.1
67.5°	25.9
70°	22.5
72.5°	18.6
75°	15.5
77.5°	12.1
80°	9.5
82.5°	6.5
85°	3.7
87.5°	1.5
90°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)