

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581420

Luminaire Tested: **HCC4S07D010BZ-HM40525827-41RWWC**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P581420  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-14)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4S07D010BZ-HM40525827-41RWWC  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, SPECULAR TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 814.1 lumens  
Efficiency: N/A  
Efficacy: 101.8 lumens/watt  
Spacing Criteria (0/90/45): 1.21 / 1.15 / 1.21  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P581420  
CATALOG NUMBER: HCC4S07D010BZ-HM40525827-41RWWC

### Luminous Intensity Polar Plot

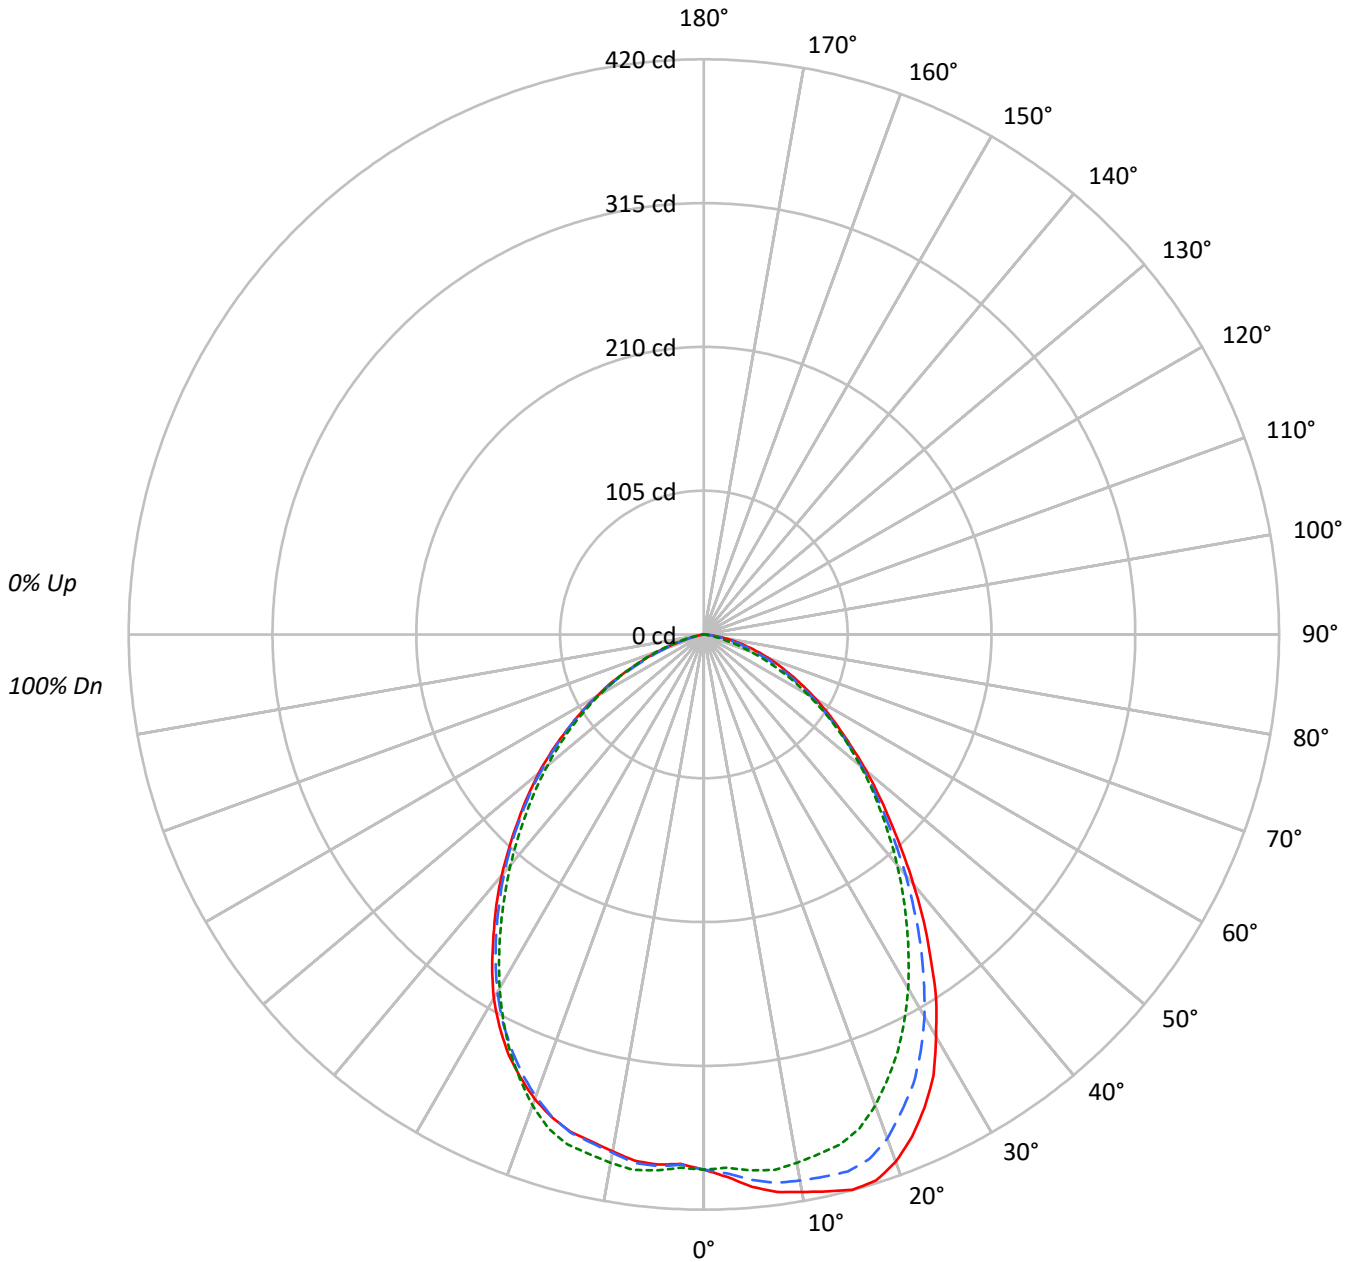

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581420

CATALOG NUMBER: HCC4S07D010BZ-HM40525827-41RWWC

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20										
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88					88			
2	102	95	90	85	100	94	88	84	90	86	82	87	83	80	84	81	78	76					76			
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67					67			
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58					58			
5	81	70	61	56	79	68	61	55	66	60	55	65	59	54	63	58	54	52					52			
6	75	63	55	49	74	62	55	49	61	54	49	59	53	48	58	52	48	46					46			
7	70	58	50	44	69	57	49	44	56	49	44	54	48	44	53	47	43	41					41			
8	66	53	45	40	64	53	45	40	51	44	40	50	44	39	49	43	39	37					37			
9	62	49	42	36	60	49	41	36	47	41	36	46	40	36	45	40	36	34					34			
10	58	46	38	33	57	45	38	33	44	38	33	43	37	33	42	37	33	31					31			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	48191	48191	48191
5°	50133	48635	48103
10°	51765	49060	48008
15°	53594	49214	48001
20°	53778	48029	47399
25°	51880	45633	45987
30°	48269	42486	43682
35°	43487	38879	40310
40°	38338	35359	36969
45°	33527	31852	33422
50°	29686	28669	30185
55°	26107	25332	26322
60°	23312	21610	22252
65°	20489	17570	17278
70°	17888	12911	11829
75°	14869	7816	6291
80°	11223	2983	1847
85°	5095	849	849



TEST NUMBER: P581420  
 CATALOG NUMBER: HCC4S07D010BZ-HM40525827-41RWWC

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	37.7	4.6
10°-20°	110.0	13.5
20°-30°	159.3	19.6
30°-40°	168.0	20.6
40°-50°	145.4	17.9
50°-60°	107.7	13.2
60°-70°	62.1	7.6
70°-80°	21.7	2.7
80°-90°	2.3	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	306.9	37.7
0°-40°	474.9	58.3
0°-60°	728.0	89.4
0°-90°	814.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	814.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	391	391	391	391	391	
5°	405	400	393	390	388	39
15°	420	406	385	376	376	118
25°	381	362	335	333	338	174
35°	289	276	258	264	268	180
45°	192	187	183	190	192	149
55°	121	119	118	122	122	110
65°	70	66	60	57	59	70
75°	31	26	16	13	13	34
85°	4	2	1	1	1	6
90°	0	0	0	0	0	



TEST NUMBER: P581420

CATALOG NUMBER: HCC4S07D010BZ-HM40525827-41RWWC

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	390.7	390.7	390.7	390.7	390.7	390.7	390.7	390.7	390.7
2.5°	396.5	395.5	393.9	391.7	389.7	388.1	387.5	387.0	387.0
5°	404.9	402.9	399.7	395.5	392.8	391.2	389.7	388.5	388.5
7.5°	410.7	408.7	403.9	398.1	394.3	391.2	389.1	387.5	387.5
10°	413.3	410.7	404.9	397.5	391.7	387.5	384.3	383.3	383.3
12.5°	416.5	413.3	405.5	395.9	388.5	383.3	380.1	379.1	379.1
15°	419.7	416.1	406.0	394.9	385.4	379.1	376.5	375.9	375.9
17.5°	418.1	413.3	401.7	388.5	378.0	371.7	369.1	369.1	369.5
20°	409.7	404.9	391.7	376.9	365.9	361.1	359.0	360.1	361.1
22.5°	397.0	391.2	376.9	362.7	351.1	346.9	346.9	348.5	350.0
25°	381.2	375.9	362.1	346.3	335.3	332.1	333.1	335.8	337.9
27.5°	363.2	357.4	343.1	328.4	317.3	315.7	318.3	322.1	323.1
30°	338.9	334.2	322.1	307.8	298.3	297.8	301.5	304.1	306.7
32.5°	315.7	310.4	298.8	285.1	278.2	278.8	283.0	286.1	287.7
35°	288.8	284.0	275.6	264.5	258.2	259.2	264.0	267.1	267.7
37.5°	263.4	260.3	251.8	243.4	238.6	240.7	245.0	248.7	248.7
40°	238.1	235.5	229.1	222.3	219.6	222.3	226.5	229.6	229.6
42.5°	213.8	212.2	207.0	202.2	200.6	204.3	208.0	210.6	210.1
45°	192.2	190.6	186.9	183.2	182.6	186.4	189.5	191.1	191.6
47.5°	172.6	171.6	168.4	165.8	165.8	169.4	172.1	173.7	174.2
50°	154.7	153.6	151.0	148.9	149.4	153.1	155.2	156.8	157.3
52.5°	136.8	136.2	134.1	131.4	133.0	135.6	138.3	139.4	139.9
55°	121.4	121.4	118.8	116.6	117.8	120.4	122.0	122.4	122.4
57.5°	107.7	107.2	104.0	101.9	102.4	105.0	106.1	106.6	106.6
60°	94.5	94.0	90.8	87.6	87.6	89.2	89.8	90.2	90.2
62.5°	81.8	81.3	77.6	75.0	73.9	73.4	73.4	74.4	76.6
65°	70.2	69.6	66.0	61.8	60.2	58.6	57.0	58.0	59.2
67.5°	59.6	58.6	54.9	51.2	47.6	44.8	42.2	43.8	46.0
70°	49.6	48.6	44.4	40.2	35.8	31.6	29.6	31.6	32.8
72.5°	40.2	39.0	34.8	30.6	25.4	21.2	20.6	21.2	21.6
75°	31.2	30.6	26.4	21.6	16.4	13.2	13.2	13.2	13.2
77.5°	23.2	22.2	18.0	13.8	9.6	7.4	6.8	6.8	6.8
80°	15.8	14.8	11.0	8.0	4.2	3.2	3.2	2.6	2.6
82.5°	9.0	8.4	5.8	3.2	1.6	1.0	1.0	1.0	1.0
85°	3.6	3.2	2.2	1.0	0.6	0.6	0.6	0.6	0.6
87.5°	0.6	0.6	0.6	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)