

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581423

Luminaire Tested: **HCC4W07D010MW-HM40525827-41WWW**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P581423  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W07D010MW-HM40525827-41WWW  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 2700K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 801.4 lumens  
Efficiency: N/A  
Efficacy: 100.2 lumens/watt  
Spacing Criteria (0/90/45): 1.06 / 1.03 / 1.1  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P581423  
CATALOG NUMBER: HCC4W07D010MW-HM40525827-41WWW

### Luminous Intensity Polar Plot

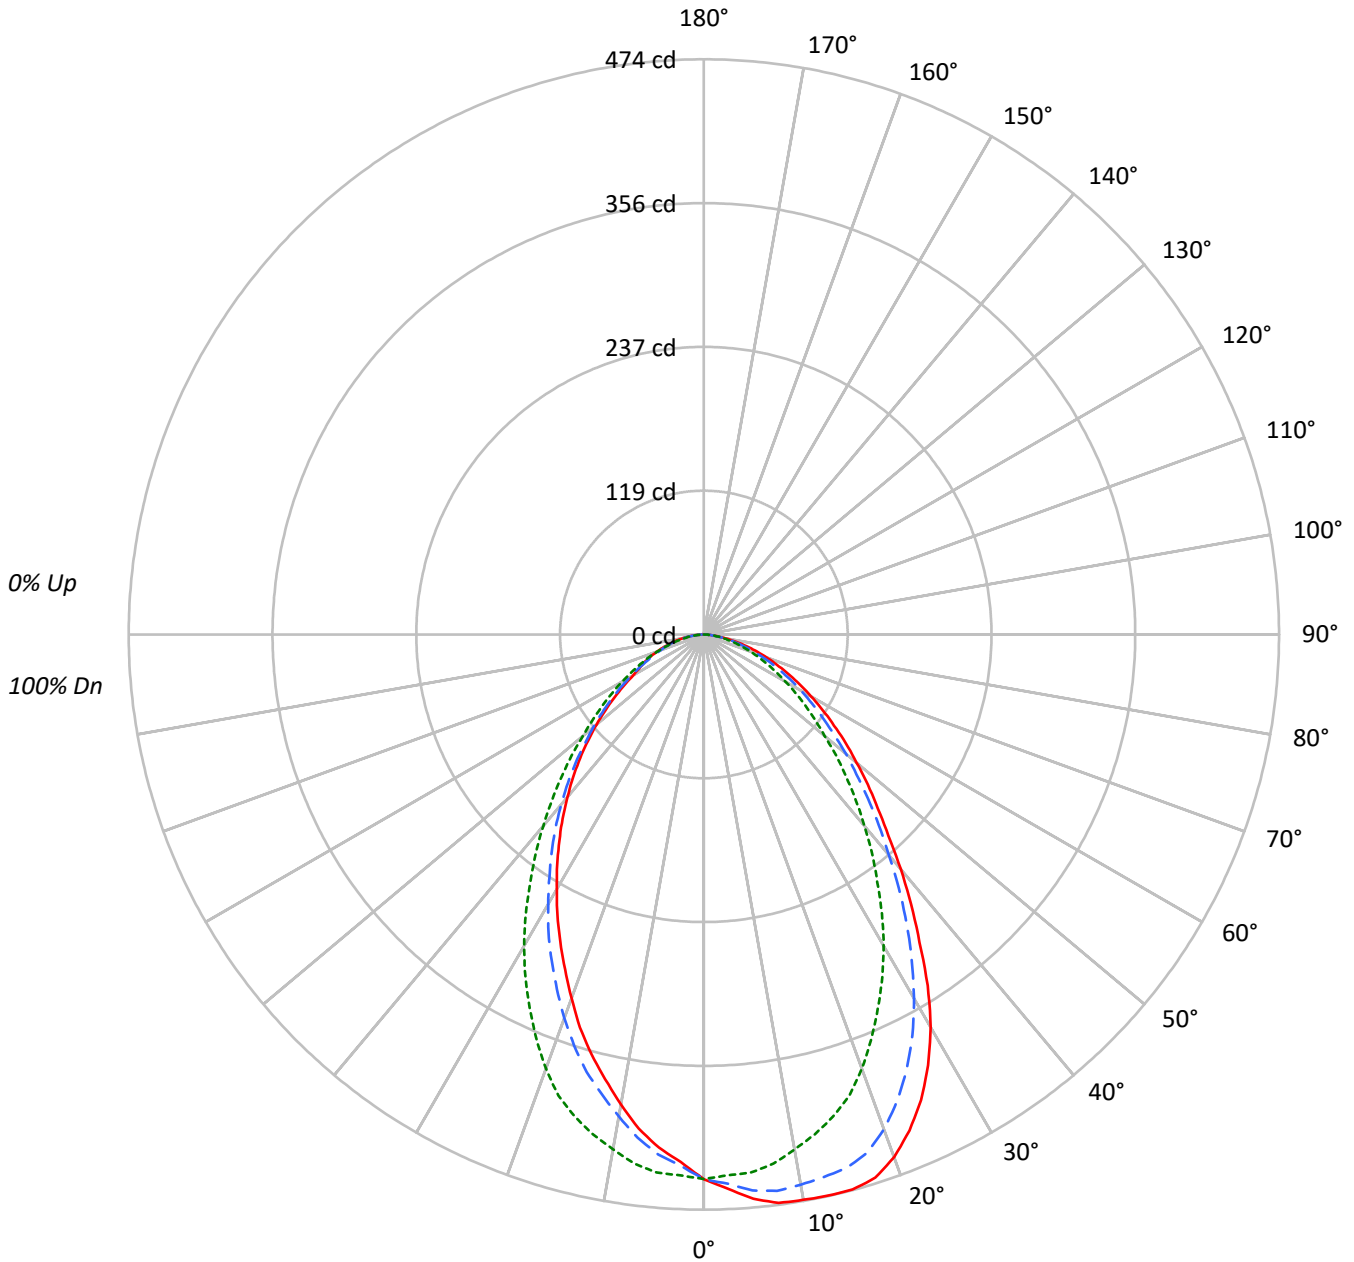

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581423

CATALOG NUMBER: HCC4W07D010MW-HM40525827-41WWW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	106	103	100	108	104	101	98	100	97	95	96	94	92	93	91	89	87								
2	102	95	89	84	100	93	88	83	90	85	81	87	83	80	84	81	78	76								
3	94	85	78	72	92	84	77	72	81	75	71	78	73	69	76	72	68	66								
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58								
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52								
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47								
7	71	58	50	45	69	58	50	45	56	49	44	55	49	44	53	48	44	42								
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38								
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35								
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	55358	55358	55358
5°	57785	55111	52560
10°	59255	53957	49260
15°	60477	52522	45715
20°	60157	49971	41859
25°	57623	46205	38080
30°	53239	42187	34524
35°	46664	37524	31245
40°	40641	33153	28146
45°	35376	28922	25154
50°	31509	24908	22183
55°	28171	21913	19182
60°	25138	19143	16528
65°	22357	16811	15702
70°	19619	14498	14642
75°	16585	12296	13630
80°	12786	10513	12360
85°	7359	8208	10473



TEST NUMBER: P581423  
 CATALOG NUMBER: HCC4W07D010MW-HM40525827-41WWW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	42.1	5.2
10°-20°	116.0	14.5
20°-30°	158.5	19.8
30°-40°	159.2	19.9
40°-50°	131.7	16.4
50°-60°	95.4	11.9
60°-70°	60.5	7.5
70°-80°	30.6	3.8
80°-90°	7.5	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	316.6	39.5
0°-40°	475.8	59.4
0°-60°	702.9	87.7
0°-90°	801.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	801.4	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	449	449	449	449	449	
5°	467	460	445	430	424	45
15°	474	455	411	373	358	133
25°	423	396	340	297	280	194
35°	310	291	249	219	208	194
45°	203	191	166	149	144	158
55°	131	119	102	93	89	118
65°	77	68	58	52	54	76
75°	35	30	26	27	29	37
85°	5	5	6	7	7	7
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581423

CATALOG NUMBER: HCC4W07D010MW-HM40525827-41WWW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	448.8	448.8	448.8	448.8	448.8	448.8	448.8	448.8	448.8
2.5°	457.2	455.7	453.0	449.9	446.1	441.9	438.2	436.1	435.1
5°	466.7	464.6	459.9	453.0	445.1	437.2	430.3	426.1	424.5
7.5°	472.5	469.4	462.5	451.9	439.8	428.2	418.2	412.4	410.8
10°	473.1	469.4	460.4	446.1	430.8	415.5	403.4	394.9	393.3
12.5°	473.6	468.9	457.8	440.9	421.9	402.9	388.1	378.0	375.4
15°	473.6	468.9	455.1	435.1	411.3	389.7	373.3	361.7	358.0
17.5°	469.4	464.1	447.7	424.5	398.6	374.3	355.3	343.2	339.5
20°	458.3	452.5	434.0	408.7	380.7	355.3	336.3	323.6	318.9
22.5°	442.5	435.6	416.1	388.6	360.6	334.7	316.3	303.0	298.8
25°	423.4	416.6	395.5	368.5	339.5	315.2	296.7	284.6	279.8
27.5°	400.2	392.8	372.2	345.3	318.4	294.1	277.2	266.1	261.4
30°	373.8	365.9	346.4	320.5	296.2	273.0	256.6	247.6	242.4
32.5°	343.2	336.3	318.9	295.7	273.0	250.8	237.0	229.2	224.9
35°	309.9	306.2	291.4	271.4	249.2	230.7	218.6	211.2	207.5
37.5°	280.4	276.6	264.0	247.1	227.6	210.6	200.6	194.3	191.2
40°	252.4	249.2	237.0	222.8	205.9	191.2	182.6	178.0	174.8
42.5°	224.9	223.4	213.3	200.1	185.3	172.6	165.8	162.1	159.4
45°	202.8	200.6	191.2	178.4	165.8	155.2	149.4	146.8	144.2
47.5°	183.2	180.6	170.6	159.4	147.8	138.4	133.0	130.4	129.4
50°	164.2	161.6	152.6	141.5	129.8	123.0	118.8	116.2	115.6
52.5°	147.3	144.6	134.6	124.0	115.1	109.2	105.6	103.0	101.9
55°	131.0	127.8	119.4	109.2	101.9	96.6	93.0	90.2	89.2
57.5°	116.2	113.0	105.6	96.0	89.2	84.4	81.3	78.6	77.6
60°	101.9	99.2	92.4	83.4	77.6	73.4	70.2	68.2	67.0
62.5°	88.7	86.6	79.8	71.8	67.0	63.4	60.8	58.6	59.6
65°	76.6	74.4	68.2	61.2	57.6	53.8	51.8	51.8	53.8
67.5°	65.0	62.8	57.6	51.8	48.6	46.0	44.4	46.0	47.6
70°	54.4	52.2	47.6	42.8	40.2	38.0	38.0	39.6	40.6
72.5°	44.4	42.2	38.6	34.8	32.8	31.2	32.8	33.8	34.8
75°	34.8	33.2	30.0	27.4	25.8	25.4	27.0	28.0	28.6
77.5°	25.8	24.8	22.8	20.6	19.6	20.0	21.6	22.2	22.8
80°	18.0	17.4	15.8	14.8	14.8	15.4	16.4	16.8	17.4
82.5°	11.0	11.0	10.0	9.6	10.0	11.0	11.6	12.2	12.2
85°	5.2	5.8	5.2	5.2	5.8	6.8	6.8	7.4	7.4
87.5°	1.6	1.6	2.2	2.2	2.6	2.6	2.6	2.6	3.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)