

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581456

Luminaire Tested: **HCC4W07D010MW-HM40525835-41RWWC**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P581456  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-14)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4W07D010MW-HM40525835-41RWWC  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, SPECULAR TRIM  
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 914.0 lumens  
Efficiency: N/A  
Efficacy: 114.2 lumens/watt  
Spacing Criteria (0/90/45): 1.21 / 1.15 / 1.21  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P581456  
CATALOG NUMBER: HCC4W07D010MW-HM40525835-41RWWC

### Luminous Intensity Polar Plot

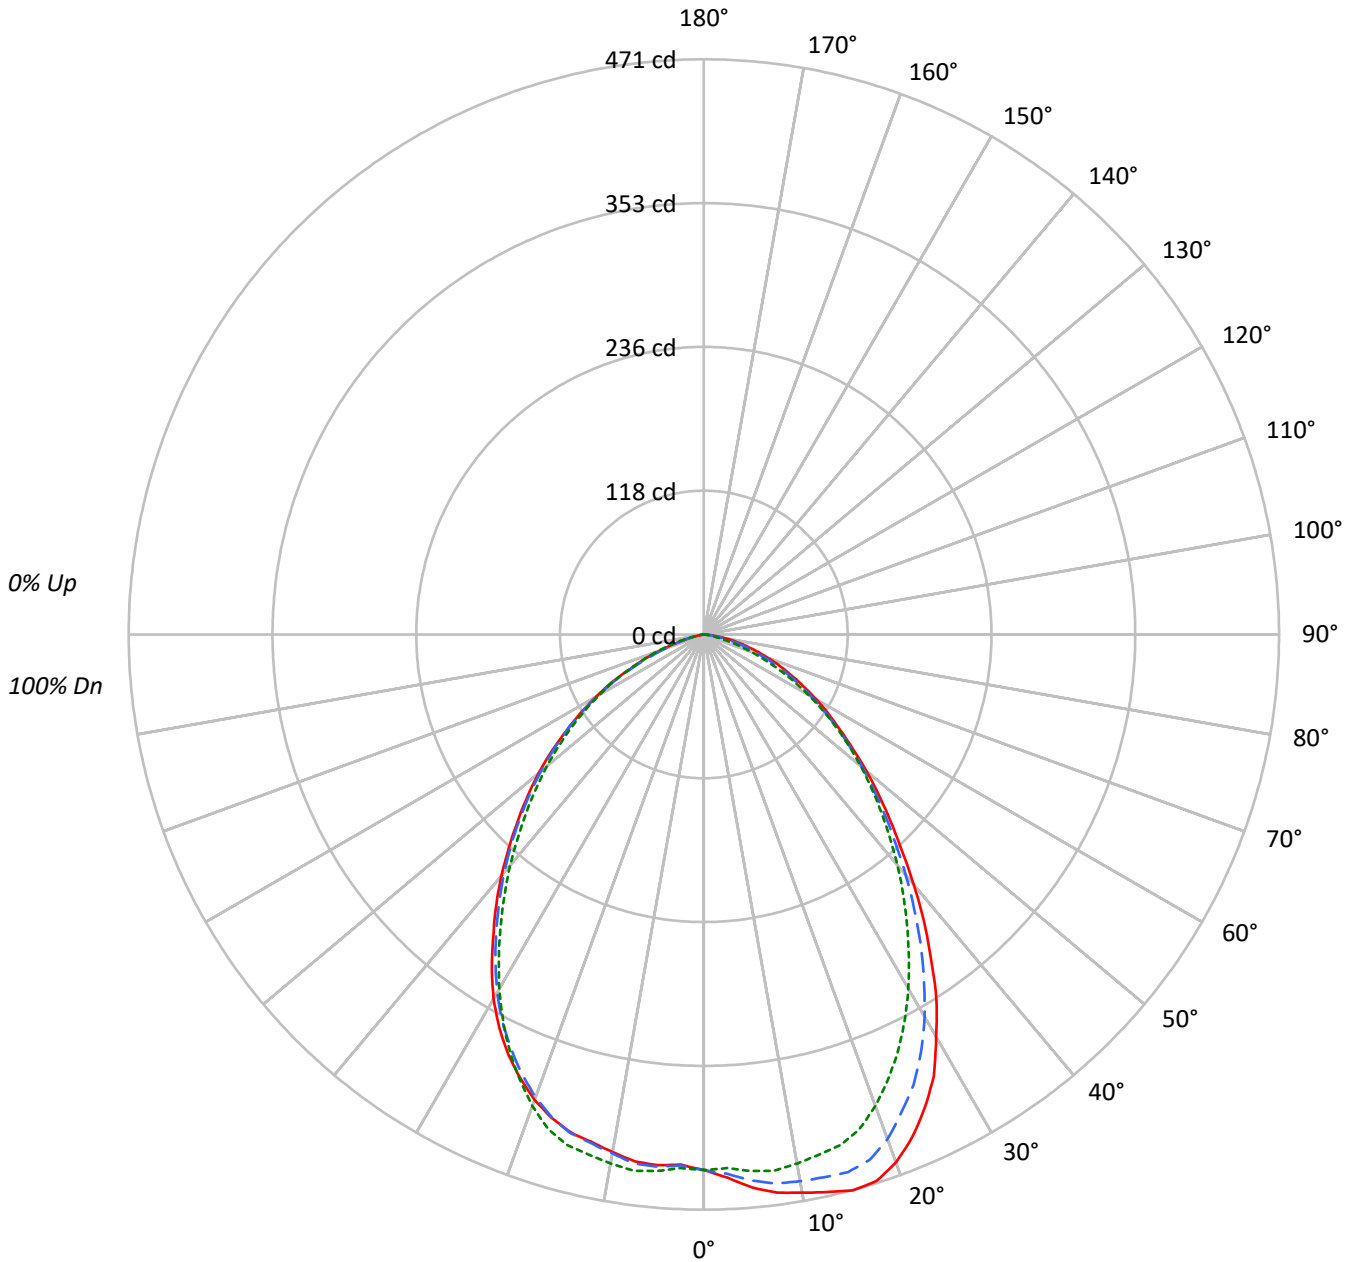

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581456

CATALOG NUMBER: HCC4W07D010MW-HM40525835-41RWWC

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20										
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88								
2	102	95	90	85	100	94	88	84	90	86	82	87	83	80	84	81	78	76								
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67								
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58								
5	81	70	62	56	79	68	61	55	66	60	55	65	59	54	63	58	54	52								
6	75	63	55	49	74	62	55	49	61	54	49	59	53	48	58	52	48	46								
7	70	58	50	44	69	57	49	44	56	49	44	54	48	44	53	47	43	41								
8	66	53	45	40	64	53	45	40	51	44	40	50	44	39	49	43	39	37								
9	62	49	42	36	60	49	41	36	47	41	36	46	40	36	45	40	36	34								
10	58	46	38	33	57	45	38	33	44	38	33	43	37	33	42	37	33	31								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	54099	54099	54099
5°	56287	54603	54009
10°	58128	55084	53894
15°	60171	55254	53888
20°	60380	53909	53227
25°	58236	51213	51622
30°	54194	47699	49052
35°	48817	43637	45248
40°	43040	39707	41526
45°	37644	35777	37539
50°	33332	32180	33888
55°	29311	28408	29569
60°	26174	24274	25014
65°	23028	19730	19350
70°	20124	14534	13271
75°	16632	8721	7053
80°	12644	3410	2131
85°	5802	849	849



TEST NUMBER: P581456  
 CATALOG NUMBER: HCC4W07D010MW-HM40525835-41RWWC

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	42.3	4.6
10°-20°	123.5	13.5
20°-30°	178.8	19.6
30°-40°	188.6	20.6
40°-50°	163.3	17.9
50°-60°	120.9	13.2
60°-70°	69.7	7.6
70°-80°	24.3	2.7
80°-90°	2.5	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	344.6	37.7
0°-40°	533.2	58.3
0°-60°	817.4	89.4
0°-90°	914.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	914.0	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	439	439	439	439	439	
5°	455	449	441	437	436	44
15°	471	456	433	423	422	133
25°	428	407	376	374	379	196
35°	324	309	290	296	300	203
45°	216	210	205	213	215	167
55°	136	133	132	137	138	123
65°	79	74	68	64	66	79
75°	35	30	18	15	15	38
85°	4	2	1	1	1	6
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581456

CATALOG NUMBER: HCC4W07D010MW-HM40525835-41RWWC

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	438.6	438.6	438.6	438.6	438.6	438.6	438.6	438.6	438.6
2.5°	445.2	443.9	442.1	439.8	437.4	435.6	435.1	434.5	434.5
5°	454.6	452.2	448.7	443.9	441.0	439.2	437.4	436.2	436.2
7.5°	461.1	458.7	453.4	446.9	442.8	439.2	436.9	435.1	435.1
10°	464.1	461.1	454.6	446.3	439.8	435.1	431.5	430.3	430.3
12.5°	467.6	464.1	455.2	444.5	436.2	430.3	426.7	425.6	425.6
15°	471.2	467.0	455.8	443.4	432.7	425.6	422.7	422.0	422.0
17.5°	469.4	464.1	451.1	436.2	424.4	417.3	414.3	414.3	414.9
20°	460.0	454.6	439.8	423.2	410.7	405.5	403.1	404.2	405.5
22.5°	445.8	439.2	423.2	407.2	394.2	389.4	389.4	391.2	393.0
25°	427.9	422.0	406.6	388.9	376.3	372.8	373.9	377.0	379.3
27.5°	407.7	401.3	385.2	368.7	356.2	354.5	357.4	361.5	362.8
30°	380.5	375.2	361.5	345.5	334.9	334.3	338.4	341.4	344.4
32.5°	354.5	348.6	335.5	320.1	312.4	313.0	317.7	321.3	323.1
35°	324.2	318.9	309.4	296.9	289.8	291.0	296.3	299.9	300.5
37.5°	295.8	292.2	282.7	273.2	267.9	270.3	275.1	279.2	279.2
40°	267.3	264.4	257.2	249.6	246.6	249.6	254.2	257.9	257.9
42.5°	240.0	238.3	232.4	227.0	225.2	229.4	233.5	236.5	235.9
45°	215.8	213.9	209.8	205.6	205.1	209.3	212.8	214.5	215.2
47.5°	193.8	192.7	189.0	186.1	186.1	190.3	193.2	195.1	195.6
50°	173.7	172.5	169.6	167.2	167.7	171.8	174.2	176.0	176.6
52.5°	153.5	152.9	150.6	147.6	149.4	152.4	155.3	156.5	157.0
55°	136.3	136.3	133.4	131.0	132.1	135.2	136.9	137.5	137.5
57.5°	121.0	120.3	116.8	114.4	114.9	117.9	119.1	119.7	119.7
60°	106.1	105.5	102.0	98.4	98.4	100.1	100.7	101.4	101.4
62.5°	91.8	91.3	87.2	84.2	83.0	82.4	82.4	83.5	85.9
65°	78.9	78.3	74.1	69.3	67.6	65.8	64.1	65.2	66.3
67.5°	67.0	65.8	61.7	57.5	53.4	50.4	47.5	49.2	51.6
70°	55.8	54.5	49.8	45.1	40.3	35.6	33.2	35.6	36.8
72.5°	45.1	43.8	39.1	34.4	28.4	23.7	23.1	23.7	24.4
75°	34.9	34.4	29.6	24.4	18.3	14.8	14.8	14.8	14.8
77.5°	26.1	24.9	20.1	15.4	10.7	8.3	7.7	7.7	7.7
80°	17.8	16.6	12.4	8.9	4.8	3.5	3.5	3.0	3.0
82.5°	10.1	9.4	6.5	3.5	1.8	1.1	1.1	1.1	1.1
85°	4.1	3.5	2.4	1.1	0.6	0.6	0.6	0.6	0.6
87.5°	0.6	0.6	0.6	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)