

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581477

Luminaire Tested: **HCC4W07D010BZ-HM40525840-41WWW**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581477
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4W07D010BZ-HM40525840-41WWW
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 924.6 lumens
Efficiency: N/A
Efficacy: 115.6 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.03 / 1.1
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581477
CATALOG NUMBER: HCC4W07D010BZ-HM40525840-41WWW

Luminous Intensity Polar Plot

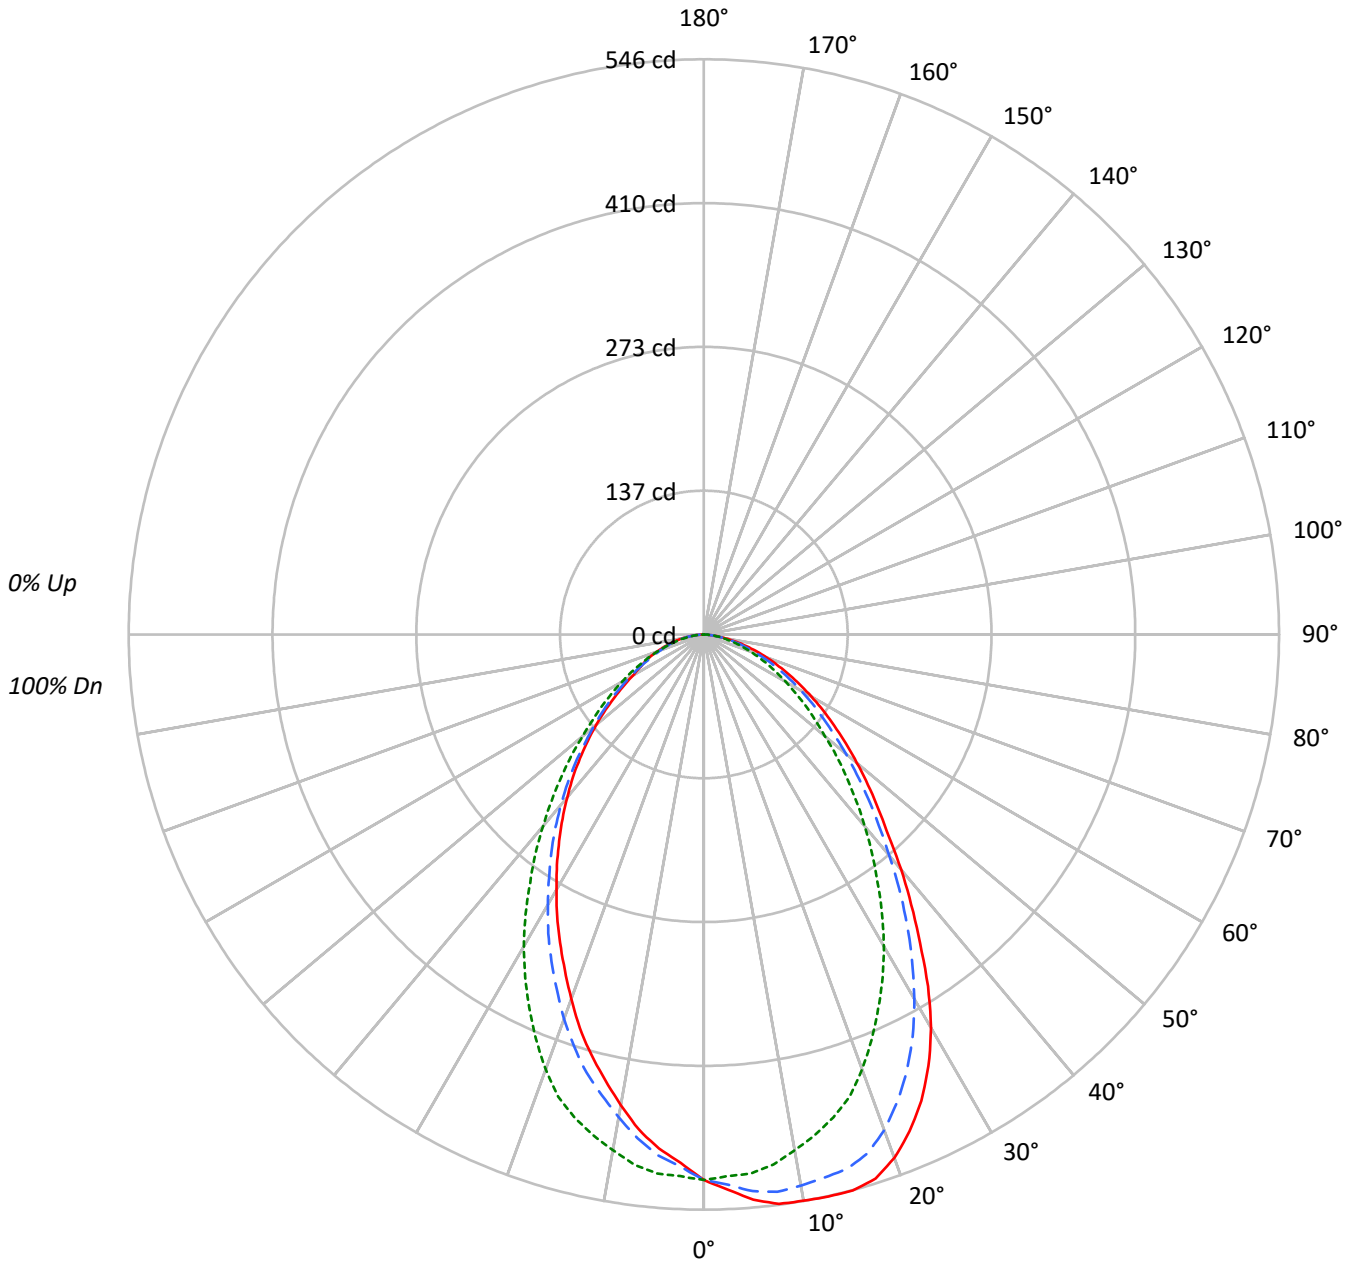

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P581477

CATALOG NUMBER: HCC4W07D010BZ-HM40525840-41WWW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	106	103	100	108	104	101	98	100	97	95	96	94	92	93	91	89	87								
2	102	95	89	84	100	93	88	83	90	85	81	87	83	80	84	81	78	76								
3	94	85	78	72	92	84	77	72	81	75	71	78	73	69	76	72	68	66								
4	87	77	69	63	85	76	68	63	73	67	62	71	66	61	69	64	60	58								
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52								
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47								
7	71	58	50	45	69	58	50	45	56	49	44	55	49	44	53	48	44	42								
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38								
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35								
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32								

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	63868	63868	63868
5°	66675	63580	60645
10°	68361	62261	56838
15°	69774	60592	52739
20°	69398	57650	48291
25°	66483	53309	43946
30°	61429	48667	39823
35°	53846	43291	36048
40°	46888	38257	32477
45°	40801	33370	29009
50°	36363	28765	25598
55°	32472	25289	22150
60°	29011	22104	19094
65°	25771	19350	18125
70°	22612	16698	16914
75°	19158	14202	15679
80°	14704	12146	14277
85°	8633	9482	12029



TEST NUMBER: P581477
 CATALOG NUMBER: HCC4W07D010BZ-HM40525840-41WWW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	48.5	5.2
10°-20°	133.9	14.5
20°-30°	182.9	19.8
30°-40°	183.7	19.9
40°-50°	151.9	16.4
50°-60°	110.1	11.9
60°-70°	69.7	7.5
70°-80°	35.3	3.8
80°-90°	8.6	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	365.3	39.5
0°-40°	549.0	59.4
0°-60°	811.0	87.7
0°-90°	924.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	924.6	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	518	518	518	518	518	
5°	538	530	514	496	490	52
15°	546	525	474	431	413	154
25°	488	456	392	342	323	223
35°	358	336	288	252	239	224
45°	234	220	191	172	166	182
55°	151	138	118	107	103	136
65°	88	78	66	60	62	88
75°	40	35	30	31	33	43
85°	6	6	7	8	8	8
90°	0	0	0	0	0	



TEST NUMBER: P581477

CATALOG NUMBER: HCC4W07D010BZ-HM40525840-41WWW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	517.8	517.8	517.8	517.8	517.8	517.8	517.8	517.8	517.8
2.5°	527.5	525.6	522.7	518.9	514.7	509.8	505.6	503.1	502.0
5°	538.5	536.0	530.5	522.7	513.5	504.4	496.4	491.6	489.8
7.5°	545.2	541.6	533.6	521.4	507.4	494.0	482.4	475.7	473.9
10°	545.8	541.6	531.2	514.7	497.1	479.4	465.3	455.7	453.8
12.5°	546.4	540.9	528.1	508.6	486.7	464.8	447.7	436.2	433.1
15°	546.4	540.9	525.1	502.0	474.5	449.5	430.6	417.3	413.0
17.5°	541.6	535.4	516.5	489.8	459.9	431.9	409.9	395.9	391.7
20°	528.7	522.0	500.7	471.5	439.2	409.9	388.1	373.4	367.9
22.5°	510.5	502.5	480.0	448.4	416.1	386.2	364.8	349.6	344.8
25°	488.5	480.6	456.2	425.2	391.7	363.7	342.3	328.3	322.9
27.5°	461.7	453.2	429.5	398.4	367.3	339.2	319.8	307.0	301.6
30°	431.3	422.1	399.6	369.7	341.7	314.9	296.0	285.6	279.6
32.5°	395.9	388.1	367.9	341.1	314.9	289.4	273.5	264.4	259.5
35°	357.6	353.3	336.3	313.1	287.5	266.2	252.2	243.6	239.4
37.5°	323.4	319.2	304.5	285.1	262.5	243.1	231.5	224.2	220.5
40°	291.2	287.5	273.5	257.1	237.6	220.5	210.8	205.3	201.7
42.5°	259.5	257.6	246.0	230.9	213.8	199.1	191.3	187.0	184.0
45°	233.9	231.5	220.5	205.9	191.3	179.1	172.4	169.3	166.3
47.5°	211.3	208.4	196.8	184.0	170.6	159.5	153.5	150.4	149.2
50°	189.5	186.4	176.0	163.3	149.9	141.9	137.0	134.1	133.4
52.5°	169.9	166.9	155.3	143.2	132.8	126.1	121.9	118.8	117.6
55°	151.0	147.4	137.7	126.1	117.6	111.5	107.2	104.1	103.0
57.5°	134.1	130.3	121.9	110.8	103.0	97.4	93.8	90.8	89.6
60°	117.6	114.5	106.6	96.3	89.6	84.7	81.0	78.5	77.4
62.5°	102.3	99.9	92.0	82.8	77.4	73.1	70.1	67.6	68.8
65°	88.3	85.9	78.5	70.7	66.3	62.1	59.7	59.7	62.1
67.5°	74.9	72.5	66.3	59.7	56.0	53.0	51.2	53.0	54.9
70°	62.7	60.3	54.9	49.4	46.3	43.8	43.8	45.6	46.9
72.5°	51.2	48.7	44.5	40.2	37.8	36.0	37.8	39.0	40.2
75°	40.2	38.4	34.7	31.6	29.8	29.2	31.1	32.3	32.9
77.5°	29.8	28.7	26.2	23.8	22.5	23.1	24.9	25.6	26.2
80°	20.7	20.1	18.3	17.1	17.1	17.6	18.9	19.5	20.1
82.5°	12.7	12.7	11.6	10.9	11.6	12.7	13.4	14.0	14.0
85°	6.1	6.7	6.1	6.1	6.7	8.0	8.0	8.5	8.5
87.5°	1.8	1.8	2.4	2.4	3.1	3.1	3.1	3.1	3.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)