

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581476

Luminaire Tested: **HCC4W07D010SL-HM40525840-41WWBB**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581476
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-17)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4W07D010SL-HM40525840-41WWBB
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, WHITE BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 739.5 lumens
Efficiency: N/A
Efficacy: 92.4 lumens/watt
Spacing Criteria (0/90/45): 1.11 / 1.04 / 1.12
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581476
CATALOG NUMBER: HCC4W07D010SL-HM40525840-41WWBB

Luminous Intensity Polar Plot

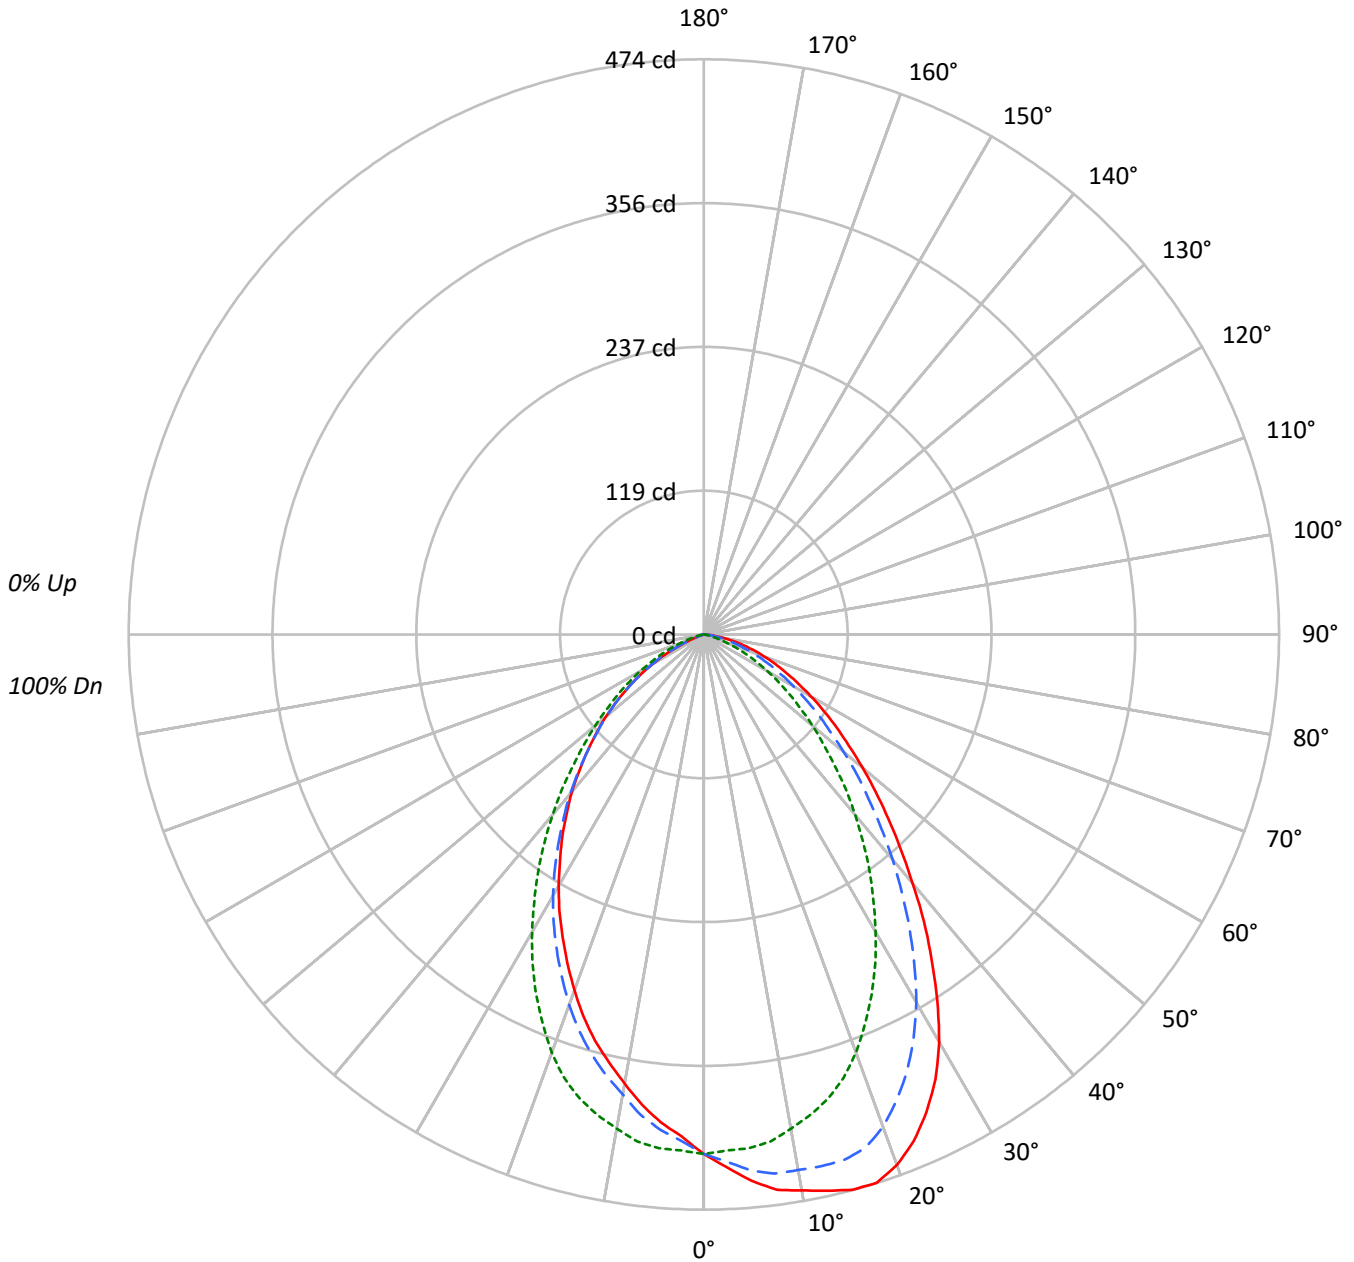

Cooper Lighting Solutions Photometric Lab
 1121 Highway 74 South
 Peachtree City, GA 30269



TEST NUMBER: P581476

CATALOG NUMBER: HCC4W07D010SL-HM40525840-41WWBB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89			89
2	103	97	91	87	101	95	90	86	92	87	84	88	85	82	85	83	80	78			78
3	96	87	80	75	94	86	79	74	83	78	73	80	76	72	78	74	71	69			69
4	89	79	72	66	87	78	71	65	75	69	65	73	68	64	71	67	63	61			61
5	83	72	64	58	81	71	64	58	69	62	58	67	61	57	65	60	56	55			55
6	77	66	58	52	75	65	57	52	63	57	52	61	56	51	60	55	51	49			49
7	72	60	53	47	71	59	52	47	58	51	47	57	51	46	55	50	46	44			44
8	68	56	48	43	66	55	48	43	54	47	42	53	47	42	51	46	42	40			40
9	64	52	44	39	62	51	44	39	50	43	39	49	43	39	48	43	39	37			37
10	60	48	41	36	59	47	41	36	46	40	36	46	40	36	45	39	36	34			34

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	52804	52804	52804
5°	55953	52622	49997
10°	58266	51778	47068
15°	60490	50542	44247
20°	61063	48107	40927
25°	59080	44517	37467
30°	55248	40321	34083
35°	49254	35852	30627
40°	43040	31189	27260
45°	37504	26445	23584
50°	32718	22432	20225
55°	28687	18602	16365
60°	25089	15023	12014
65°	21860	11207	6742
70°	19114	7249	2200
75°	15679	3813	620
80°	11649	1705	426
85°	6935	849	849



TEST NUMBER: P581476
 CATALOG NUMBER: HCC4W07D010SL-HM40525840-41WWBB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	40.4	5.5
10°-20°	113.1	15.3
20°-30°	156.3	21.1
30°-40°	157.2	21.3
40°-50°	126.9	17.2
50°-60°	85.8	11.6
60°-70°	43.7	5.9
70°-80°	14.0	1.9
80°-90°	2.1	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	309.8	41.9
0°-40°	467.0	63.2
0°-60°	679.7	91.9
0°-90°	739.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	739.5	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	428	428	428	428	428	
5°	452	443	425	410	404	44
15°	474	448	396	358	346	133
25°	434	396	327	287	275	199
35°	327	295	238	208	203	204
45°	215	192	152	135	135	167
55°	133	115	86	76	76	120
65°	75	61	38	25	23	75
75°	33	23	8	2	1	35
85°	5	2	1	1	1	7
90°	0	0	0	0	0	



TEST NUMBER: P581476

CATALOG NUMBER: HCC4W07D010SL-HM40525840-41WWBB

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	428.1	428.1	428.1	428.1	428.1	428.1	428.1	428.1	428.1
2.5°	439.6	437.2	434.8	430.5	425.6	420.8	417.8	415.3	414.1
5°	451.9	448.8	443.4	434.1	425.0	416.5	409.8	405.6	403.8
7.5°	461.6	457.4	448.1	435.4	421.4	408.0	399.4	393.4	390.9
10°	465.2	460.3	448.1	431.2	413.4	397.0	384.9	378.7	375.8
12.5°	469.5	464.1	448.8	427.4	405.6	386.1	372.1	364.2	361.1
15°	473.7	466.5	448.1	422.0	395.8	373.3	358.0	350.2	346.5
17.5°	473.7	465.2	443.4	412.9	383.1	359.3	342.2	333.1	330.0
20°	465.2	455.5	431.8	398.3	366.5	341.1	324.6	315.5	311.8
22.5°	451.9	440.9	415.3	380.5	347.1	322.2	305.7	297.1	293.5
25°	434.1	423.2	396.5	360.5	327.1	302.0	286.8	278.9	275.3
27.5°	413.4	401.3	374.5	338.6	305.7	282.0	267.9	260.6	257.6
30°	387.9	376.3	350.2	314.9	283.1	261.3	248.4	241.7	239.3
32.5°	358.0	348.3	322.7	289.8	260.0	239.9	228.4	222.8	220.4
35°	327.1	317.8	295.3	264.9	238.1	219.2	208.3	204.6	203.4
37.5°	297.8	289.8	267.9	239.9	215.5	199.1	189.4	187.0	185.7
40°	267.3	261.9	241.7	216.2	193.7	179.0	171.2	169.3	169.3
42.5°	239.9	233.9	216.2	193.0	173.0	158.3	152.8	151.0	151.6
45°	215.0	208.8	192.4	171.2	151.6	139.4	135.2	135.2	135.2
47.5°	191.9	186.3	171.2	149.2	133.4	123.6	119.4	119.4	119.9
50°	170.5	166.8	149.8	130.9	116.9	107.8	104.7	104.1	105.4
52.5°	150.4	146.1	130.9	113.9	100.5	93.2	90.1	89.6	90.1
55°	133.4	128.5	115.1	98.7	86.5	79.2	75.6	74.9	76.1
57.5°	116.9	113.2	99.2	84.7	73.1	65.8	62.7	61.5	62.1
60°	101.7	98.1	85.2	71.2	60.9	53.6	49.3	48.1	48.7
62.5°	87.7	84.7	72.5	59.1	48.7	42.0	37.8	34.7	36.0
65°	74.9	71.8	60.9	47.5	38.4	31.1	24.9	22.5	23.1
67.5°	64.0	60.3	50.0	37.8	28.7	20.7	14.0	12.7	12.7
70°	53.0	49.3	40.2	29.2	20.1	10.9	6.1	6.1	6.1
72.5°	42.7	39.6	31.1	22.0	12.7	4.9	2.4	2.4	2.4
75°	32.9	30.5	23.1	15.2	8.0	2.4	1.8	1.3	1.3
77.5°	24.4	22.0	16.4	10.4	4.9	1.3	1.3	1.3	1.3
80°	16.4	14.6	10.9	6.1	2.4	0.6	0.6	0.6	0.6
82.5°	9.8	8.5	6.1	3.1	1.3	0.6	0.6	0.6	0.6
85°	4.9	3.6	2.4	1.3	0.6	0.6	0.6	0.6	0.6
87.5°	1.3	0.6	0.6	0.6	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180° - - 45°-225° - - - - 90°-270°

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)