

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581547

Luminaire Tested: **HCC4S07D010SL-HM40525950-41RWWH**

Issue Date: 9/9/2021

**Test Information**

Test Method: LM-41-14  
Report Number: P581547  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-15)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 9/9/2021  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: HALO COMMERCIAL  
Catalog Number: HCC4S07D010SL-HM40525950-41RWWH  
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WALLWASH DISTRIBUTION, HAZE TRIM  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
CYLINDER  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 841.4 lumens  
Efficiency: N/A  
Efficacy: 105.2 lumens/watt  
Spacing Criteria (0/90/45): 1.14 / 1.08 / 1.16  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P581547  
CATALOG NUMBER: HCC4S07D010SL-HM40525950-41RWWH

### Luminous Intensity Polar Plot

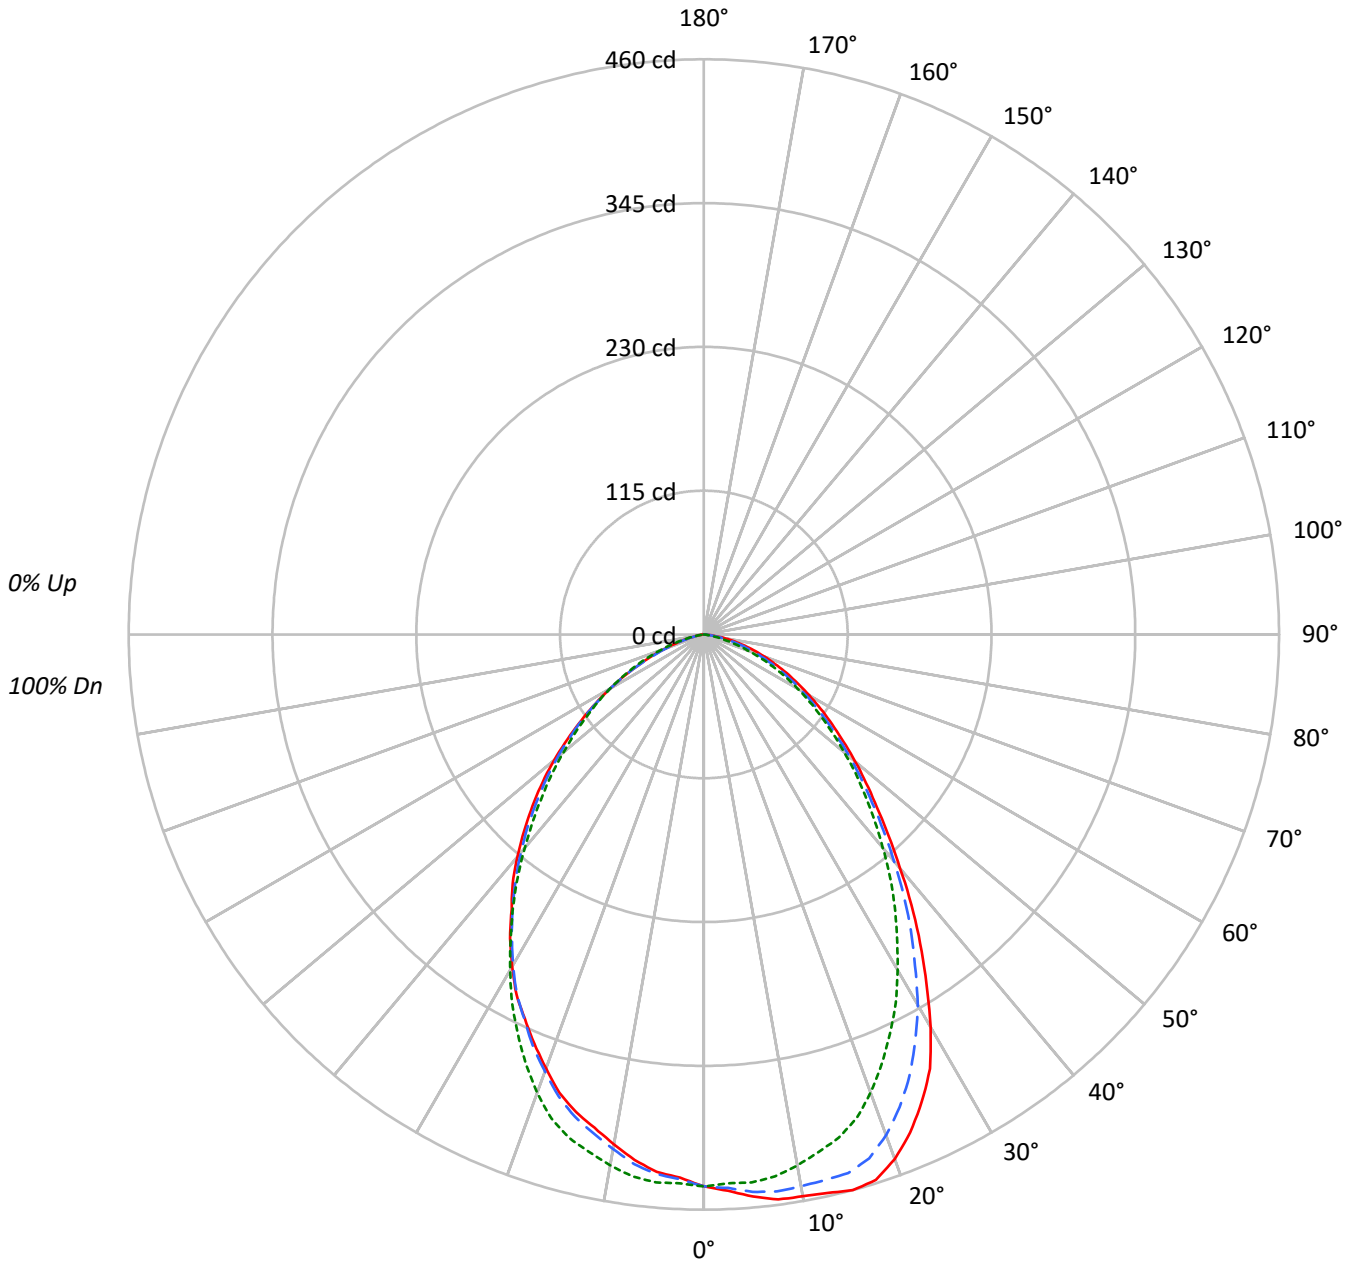

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581547

CATALOG NUMBER: HCC4S07D010SL-HM40525950-41RWWH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0					
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	111	107	104	100	108	105	102	99	101	98	96	97	95	93	93	92	90	88								
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77								
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67								
4	88	77	70	64	86	76	69	63	74	67	62	71	66	62	69	65	61	59								
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52								
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47								
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42								
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38								
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	37	35								
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32								

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°
0°	54445	54445	54445
5°	55879	54455	53427
10°	57138	53995	51853
15°	58753	53211	50479
20°	58595	51179	48449
25°	56126	47920	46123
30°	51630	44138	43668
35°	45414	40054	40370
40°	39288	35842	37340
45°	34137	31852	33771
50°	30319	28112	29973
55°	26902	24644	25720
60°	23954	21363	21363
65°	21277	17774	16636
70°	18393	13452	11865
75°	15393	8912	7339
80°	11720	4262	3907
85°	6227	1557	1557



TEST NUMBER: P581547  
 CATALOG NUMBER: HCC4S07D010SL-HM40525950-41RWWH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	41.8	5.0
10°-20°	118.5	14.1
20°-30°	167.2	19.9
30°-40°	172.7	20.5
40°-50°	146.4	17.4
50°-60°	106.5	12.7
60°-70°	62.2	7.4
70°-80°	23.1	2.7
80°-90°	3.0	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	327.5	38.9
0°-40°	500.2	59.4
0°-60°	753.0	89.5
0°-90°	841.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	841.4	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	441	441	441	441	441	
5°	451	448	440	433	432	43
15°	460	446	417	399	395	129
25°	412	389	352	340	339	189
35°	302	288	266	266	268	188
45°	196	190	183	189	194	152
55°	125	119	115	118	120	112
65°	73	67	61	57	57	72
75°	32	27	19	15	15	35
85°	4	3	1	1	1	6
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab  
 1121 Highway 74 South  
 Peachtree City, GA 30269



TEST NUMBER: P581547

CATALOG NUMBER: HCC4S07D010SL-HM40525950-41RWWH

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	441.4	441.4	441.4	441.4	441.4	441.4	441.4	441.4	441.4
2.5°	445.3	444.2	443.1	441.4	439.3	437.6	436.0	434.8	434.8
5°	451.3	449.6	447.5	443.6	439.8	436.5	433.2	431.5	431.5
7.5°	455.7	453.5	449.2	443.6	437.1	432.1	427.2	425.0	423.9
10°	456.2	454.1	448.0	439.8	431.1	423.3	417.9	414.6	414.0
12.5°	457.4	454.6	446.9	435.4	423.9	414.6	408.5	405.2	404.1
15°	460.1	456.2	445.9	431.1	416.7	405.8	399.2	396.5	395.3
17.5°	457.4	451.9	439.3	421.7	405.8	393.7	387.1	384.4	384.4
20°	446.4	440.9	426.1	406.9	389.9	378.4	371.8	370.2	369.1
22.5°	431.1	425.0	409.1	388.9	371.8	361.4	357.0	354.8	354.3
25°	412.4	406.4	389.3	368.5	352.1	343.3	339.5	339.5	338.9
27.5°	391.6	383.8	366.3	348.2	332.3	325.7	324.1	324.1	324.7
30°	362.5	357.0	342.2	324.7	309.9	305.4	305.4	306.6	306.6
32.5°	331.3	327.4	314.2	298.8	287.3	284.6	285.8	287.9	288.5
35°	301.6	297.2	288.5	274.7	266.0	264.8	266.5	268.1	268.1
37.5°	272.6	268.1	262.1	251.2	244.6	245.1	247.3	249.6	251.2
40°	244.0	240.7	236.4	227.6	222.6	224.9	227.6	229.8	231.9
42.5°	218.8	215.5	212.2	205.6	202.3	205.1	208.4	210.5	212.8
45°	195.7	193.6	190.3	184.8	182.6	185.4	189.1	191.4	193.6
47.5°	176.0	174.9	170.6	165.6	164.6	167.3	170.6	173.3	174.9
50°	158.0	156.2	152.5	147.5	146.5	150.8	152.9	154.7	156.2
52.5°	140.4	138.7	134.4	130.0	130.0	133.3	134.9	135.4	137.1
55°	125.1	123.4	119.0	115.7	114.6	117.3	118.5	118.5	119.6
57.5°	110.7	109.1	104.7	100.9	100.4	102.0	102.0	102.0	102.5
60°	97.1	95.4	91.0	87.7	86.6	87.2	86.6	86.1	86.6
62.5°	84.4	82.8	78.4	74.5	73.5	73.5	71.8	71.2	71.8
65°	72.9	70.2	66.9	63.0	60.9	59.2	57.0	57.0	57.0
67.5°	61.5	59.2	55.4	51.6	48.8	46.1	42.8	43.9	44.4
70°	51.0	49.4	45.0	41.1	37.3	34.0	31.3	32.3	32.9
72.5°	41.7	39.5	35.6	31.3	28.0	23.6	22.0	23.0	23.0
75°	32.3	30.2	26.9	22.5	18.7	14.8	14.8	15.4	15.4
77.5°	24.1	22.0	18.7	14.8	11.5	8.8	9.3	9.3	9.3
80°	16.5	14.8	12.1	8.8	6.0	4.9	4.9	4.9	5.5
82.5°	9.3	8.2	6.6	4.4	2.7	2.7	2.7	2.7	2.7
85°	4.4	3.3	2.7	1.6	1.1	1.1	1.1	1.1	1.1
87.5°	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°    - - 45°-225°    - - - - 90°-270°

Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Classified  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)